



ISO 9001, ISO 14001



OSS series

Automatic Transfer Switches



O-Sung Electric Machinery Co., Ltd.

Company History

Outstanding technology captivates the world!
Superior Quality satisfies our customers!

Established O-Sung Industrial
Become member of Korea Electrical Manufacturers Cooperative (KEMC)
Incorporated as O-Sung Electric Machinery Co., LTD.

Awarded honor of KOEMA for products development
Nominated as "Technology Intensive Enterprises" by the Ministry of commerce & Industry
Moved Company to Paju-si, Gyeonggi-do
Awarded the Presidential Prize at contest for Quality Control
Awarded Certificate of Quality System (ISO 9001)
ASTA certified for 2000A 50kA Air Circuit Breaker

ASTA certified for 1600A, 3200A, 5000A 65kA Air Circuit Breaker
Certified by Taiwan Power Corporation (TPC)
CE certified for 200A Automatic Transfer Switch by TUV
CB Test Certified by KTL for Air Circuit Breaker (SB-606~616 3P 4P 600V 50kA)
CE certified for 600A~1600A 3P, 4P 600V 50kA Air Circuit Breaker
CB Test Certified by KTL for Air Circuit Breaker (SB-620~632 3P 4P 600V 65kA)
Certified by Innovation Business Association.(INNO-BIZ)
Awarded Certificate of Environment Management System (ISO 14001)
V-Check MARK Certificate for Automatic Transfer Circuit Breaker(KESCO)
CE certified for 2000A~3200A 3P, 4P 600V 65kA Air Circuit Breaker
NET (New Excellent Technology) Certification : Automatic Transfer Circuit Breaker

Awarded honor of Small and Medium Business Administration
Awarded honor of The Ministry of Knowledge Economy
NEP (New Excellent Product) Certification : Automatic Transfer Circuit Breaker
(2,000A or less, 60Hz, 42 kA, 1s)
Certified by PRODUCT-SPECIFIC APPROVED EXPORTER (010-14-200194)
Certified by KEPSCO Trusted Partner (2014-KTP-008)
Awarded the Grand Prize at contest for Quality Control in a Field Improvement(Gyeonggi-do)
New Excellent Transport Technology Certification
Certificate of Authentication by the Gyeonggi Provincial Government
NEP (New Excellent Product) Certification : Automatic Transfer Circuit Breaker
Certificate of Electrical Construction Business
Women's Company Certification
Awarded honor of Public Procurement Service
Awarded honor of Ministry of Trade, Industry and Energy
Awarded honor of Korea International Trade Association(A million dollars Exporting)
Awarded honor of National Tax Service(Model Taxpayer)
CE / CB test certified for Automatic Transfer Switch (TN , PCN) by INTERTEK

1986.12 오성산업사 설립
1987.01 한국전기공업협동조합(KEMC) 가입
1989.08 오성기전 주식회사 법인 설립
1990.02 한국전기공업협동조합 표창(개발건, 수출실적)
1990.03 상공부 기술집약형 업체 선정
1993.08 본사 이전 (서울 마포 → 경기도 파주)
1993.11 대통령상 수상 (전국품질기술 분임조 경진대회)
1999.02 ISO 9001 인증 획득
1999.04 ASTA 인증 획득 (SB 2000A, 50kA)
2000.02 ASTA 인증 획득 (SB 1600A, 3200A, 5000A 65kA)
2000.05 대만전력공사 승인취득 (저압기중차단기, 자동절체 개폐기)
2003.05 CE 인증 획득 (ATS TN 200A)
2006.11 CB 인증 획득 (SB-606~616 3P 4P 600V 50kA)
2006.11 CE 인증 획득 (SB-606~616 3P 4P 600V 50kA)
2007.05 CB 인증 획득 (SB-620~632 3P 4P 600V 65kA)
2007.07 기술혁신형 중소기업(INNO-BIZ) 인증
2008.06 ISO 14001 인증 획득
2008.10 KAS공인 V-Check마크 인증 (자동절체차단기:OSS-ATCB)
2009.04 CE 인증 획득 (SB-620~632 3P, 4P 600V 65kA)
2009.04 NET(신기술)인증 : 자동절체차단기(ATCB)
2012.09 중소기업청장 표창 수상
2012.09 지식경제부장관 표창 수상
2013.10 신제품(NEP) 인증 획득 : 단일구동일체식 ATCB
(2,000A 이하, 60Hz, 42 kA, 1s)
2014.06 품목별 원산지인증수출자 인증 획득
2014.12 Certified by KEPSCO Trusted Partner
2015.06 경기도 품질분임조 경진대회 현장개선부문 최우수상 수상
2015.06 교통신기술(NET) 인증 획득
2016.10 경기도 유망중소기업 인증
2017.03 신제품(NEP) 인증 연장 : 단일구동일체식 ATCB
2017.05 전기공사업 등록
2018.02 여성기업 인증
2018.02 조달청장 표창
2018.11 산업통상자원부 장관 표창
2018.12 백만불 수출의 탑 수상
2019.02 국제청장 표창(모범납세자)
2021.07 CE / CB 인증 획득 (ATS TN , PCN)

Contents

OSS - T3 Type (100~630A) 04

Information to Order (주문정보)
Features (특징)
External View (외관명칭)
Application and Selection (적용과 선정)
Specification (정격사양)
Outline Dimension (외형도)

OSS - TO Type (100~630A) 10

Information to Order (주문정보)
Features (특징)
Specification (정격사양)
Outline Dimension (외형도)

OSS - T3 / TO Type 15

Wiring Diagram (결선도)

OSS - TN Type (60~630A) 16

Information to Order (주문정보)
Features (특징)
External View (외관명칭)
Specification (정격사양)
Outline Dimension (외형도)
Wiring Diagram (결선도)

OSS - PC Type (800~6300A) 22

Information to Order (주문정보)
External View (외관명칭)
Features (특징)
Specification (정격사양)
Outline Dimension (외형도)

OSS - PSO Type (630~6300A) 30

Information to Order (주문정보)
Features (특징)
Specification (정격사양)
Outline Dimension (외형도)

OSS - PC / PSO Type 38

Wiring Diagram (결선도)

OSS - PCN Type (800~6300A) 39

Information to Order (주문정보)
External View (외관명칭)
Features (특징)
Specification (정격사양)
Outline Dimension (외형도)
Circuit Diagram (회로도)

ATS Controller 51

Information to Order (주문정보)
Basic Function (기본기능)
Comparative Summary (제품별 기능 및 적용)
Outline Dimension (외형도)

* ACD-A

External View (외관명칭)

Wiring Diagram (결선도)

* ACD-III-D

External View (외관명칭)

Wiring Diagram (결선도)

* ACD-M

External View (외관명칭)

Specification (정격사양)

Functions (기능)

Wiring Diagram (결선도)

Technical Details (기술자료) 64

Safety Manual (안전 지침서) 66





T3 Type

ATS(100~630A)

◆ Information to Order_ 주문정보

OSS - 6□ - T3 - □ - □P - □ - □c
A B C D E

A Rated Current 정격전류

1	2	4	6
100A	200A	400A	630A

D Operating Voltage(조작전압)

- A1 : AC 110V
- A2 : AC 220V
- D1 : DC 110V
- D2 : DC 125V

B Connection(접속방식)

- F : Front (표면)
- B : Back (배면)
- D : Draw-out (인출형)

E Aux switch(보조접점)

- 1 : 1 c (기본)
- 2 : 2 c (옵션)

C Number of Poles(극수)

- 2 : 2 P
- 3 : 3 P
- 4 : 4 P

◆ Features_ 특징

Transfer method (2-Position ATS)

A ⇒ B, B ⇒ A

One-coil mechanism

One-coil mechanism is applied

Excellent Breaking Capacity

Designed for sufficiently large chamber to extinguish the arc when transferred. Arc-extinguishing area is designed for convenient inspection and maintenance.

Transfer indicator provided

Transfer indicator is fitted to indicate the transfer status.

Perfect transfer mechanism

By spring transfer mechanism, ATS can be completely and perfectly transferred. There will be no unattached position in any case.

Mechanically Interlock

Electrically held and mechanically interlock to prevent parallel two live source.

Protection against the remaining power source

Mechanical protection against the contact confliction caused by remaining power source of input and load side.

Last Break, 1st make Neutral contact

Last Break, 1st make Neutral contact to reduce nuisance tripping in the ground fault protection system. IEC 60947-1 (Clause 7.1.9)

Construction for Safety

For safe operation, molded construction is employed on breaking parts.

Compact & Lightweight design

Compact & lightweight design makes the minimized mounting space and convenient installation

■ 절체 방식 (2-Position ATS)

A ⇒ B, B ⇒ A

■ 단일 코일 절체 기구

한 개의 코일로 절체하는 기구

■ 강력한 차단능력

독특한 소호구조설계로 아크차단이 짧고 접점의 소모가 적어 장시간 사용 가능하며 전면에서 소호실을 탈착하여 내부점검이 편리합니다.

■ 절체표시기 부착

절체의 상태를 확인할 수 있는 절체표시기 부착

■ 불완전 투입요소 완전 제거

스프링 절체방식에 의해서 완전하고 완벽한 절체

■ 기계적 인터록

A-Power와 B-Power의 혼축을 기계적 인터록으로 방지

■ 부하측 잔류전원 혼축방지

절체시 기구적으로 전원과 부하측의 잔류전압으로 인한 혼축을 방지

■ 중성선 선 투입 후 개방

투입 시 중성선이 삼상(L1, L2, L3)보다 먼저 투입되고 개방 시 나중에 끊어지는 구조로 순간적으로 중성선이 개방되어 발생할 수 있는 사고를 방지. IEC 60947-1 (Clause 7.1.9)

■ 안전 구조 설계

차단부가 분진 방지형 몰드구조로 설계

■ 소형 경량


작고 가벼워 공간 활용 및 작업자 능률 극대화

T3 Type

ATS(100~630A)



◆ External View_ 외관명칭

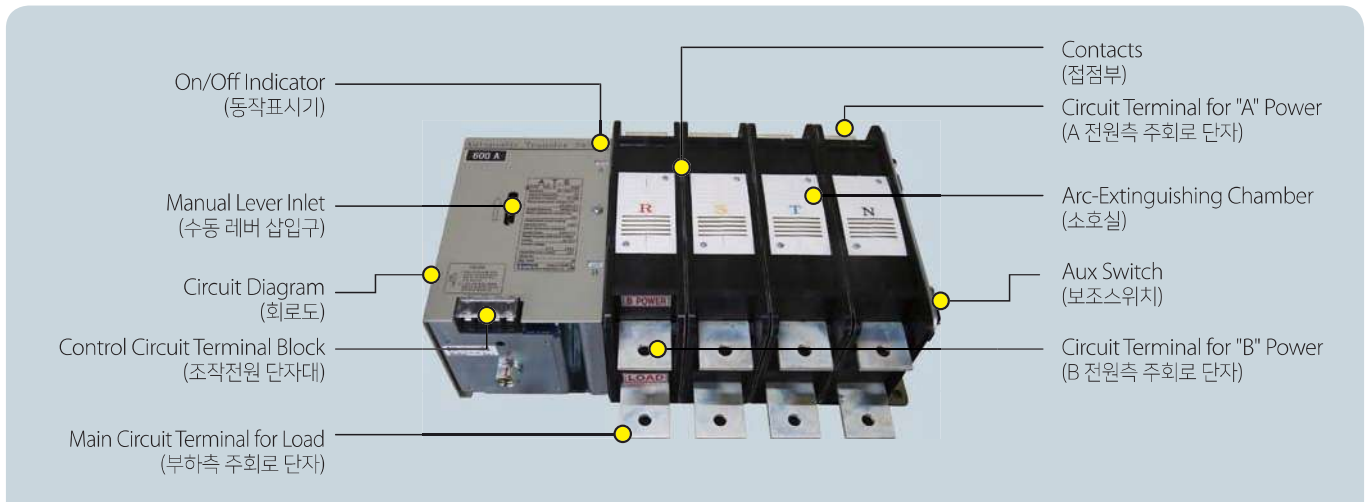

◆ Application and Selection_ 적용과 선정

Applicable Standards

- IEC 60947-6-1
- UL 1008

Control Order

It is recommended to give more than 0.5sec for operation, though transfer time is completed

Interlock

Interlocking is required for control circuit so that control order should not supply to both A power source side and B power source side simultaneously.

Selection of TR Capacity

TR capacity should be selected more than the value calculated by the following formula.

Operation Voltage x Operation Current x 0.5 = () JVA
 e.g.) Operation Voltage AC 220V, Operation Current 4A
 $220 \times 4 \times 0.5 = 440\text{VA}$,
 TR capacity of more than 440VA is recommended.

Control Circuit

ATS is designed so that operation current should be off by internal switch after completion of operation. If operation current is off with auxiliary switch of the unit, it may cause a malfunction.

Selection of Control Relay

The capacity of UVR, Operating Relay and Timer contactor should be higher than ATS operating current.

Note : If the control power source is not stable, it is recommended to use Automatic Voltage Regulator.

Caution on operation of manual handle

Manual operation of ATS should be done for the emergency and maintenance purpose while no load condition only.

■ 관련 규격

- IEC 60947-6-1
- UL 1008

■ 제어 지령

절체동작은 0.3초 이내에 완료되지만 0.5초 이상의 제어지령으로 동작될 수 있도록 Sequence를 설정하여 주십시오.

■ 인터록

조작회로에는 A 전원 측과 B 전원 측에 동시지령이 되지 않도록 인터록(전기적)을 설치하여 주십시오.

■ 조작용 TR 용량

조작회로용 TR 용량은 하기 계산식에 의한 계산치 이상의 용량을 사용하여 주십시오.
 조작전압 x 조작전류 x 0.5 = () JVA
 예) 조작전압 AC 220V, 조작전류 4A
 $220 \times 4 \times 0.5 = 440\text{VA}$,
 440VA 이상의 TR을 사용하여 주십시오.

■ 제어회로

ATS는 동작완료 후 내부 SW에 의해 조작전류를 OFF 하도록 설계되어 있습니다. 본체의 보조 SW로 조작전류를 OFF하면 오동작의 원인이 됩니다.

■ 제어 Relay의 선정

전압 Relay 27, 84 및 Timer는 접점 통전전류가 ATS 조작전류 이상의 것을 사용하여 주십시오. 제어 Relay의 Chattering 등을 고려하여 조작전류의 차단이 가능한 Relay를 선정하여 사용하시면 보다 안전합니다.

주) 조작전원이 불안정한 경우에는 전압확립 Relay를 사용하여 주십시오.

■ 수동핸들 조작 시 주의

ATS의 수동조작은 무부하 상태에서 응급조치 및 정비의 목적으로만 작동하여 주십시오. 수동조작은 조작자에 따라 개폐력과 개폐속도 등의 차이가 있으므로 ATS의 개폐특성을 보증할 수 없습니다.



ATS(100~630A)

◆ Specification 정격사양

TYPE			61-T3-F/B			62-T3-F/B			64-T3-F/B			66-T3-F/B		
Rated Operational Voltage (정격사용전압)		Ue	AC 600V											
Rated Insulation Voltage (정격절연전압)		Ui	AC 600V											
Rated Current (정격전류)		Ie	100 A			200 A			400 A			630 A		
Neutral Phase Current (중성극전류)			100 A			200 A			400 A			630 A		
Kind of Throw (투수)			Double Throw (쌍투)											
Connection (접속방식)			Fixed (고정형) [Front (표면 : F), Back (배면 : B)]											
Number of Poles (극수)			2P	3P	4P	2P	3P	4P	2P	3P	4P	2P	3P	4P
Weight [kg] (중량)			6	7	8	7	9	10	12	15	18	12	15	18
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw	5 kA			10 kA			12 kA			12 kA		
Rated Short-Circuit Making Capacity (단락 투입 전류)		Icm peak	7.5 kA			17 kA			24 kA			24 kA		
Switching Capacity (개폐용량)			AC-33B											
Switching Frequency (개폐빈도)			60 Time / Hour											
Operating Current (조작전류) peak	DC 110V ~ 125V		18 A						25 A					
	AC 100V ~ 110V		18 A						25 A					
	AC 200V ~ 240V		8 A						8 A					
Operating Time (동작시간)	Operating Transfer Time		≤ 130 ms						≤ 160 ms					
	Opening Time		≤ 50 ms						≤ 60 ms					
	Contact Transfer Time		≤ 80 ms						≤ 120 ms					
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)		10,000											
	With Current (통전)		5,000											
Cautions (주의사항)			1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.											

TYPE			61-T3-D			62-T3-D			64-T3-D			66-T3-D		
Rated Operational Voltage (정격사용전압)		Ue	AC 600 V											
Rated Insulation Voltage (정격절연전압)		Ui	AC 600 V											
Rated Current (정격전류)		Ie	100 A		200 A		400 A		630 A					
Neutral Phase Current (중성극전류)			100 A		200 A		400 A		630 A					
Kind of Throw (투수)			Double Throw (쌍투)											
Connection (접속방식)			Draw-out (인출형)											
Number of Poles (극수)			2P	3P	4P	2P	3P	4P	2P	3P	4P	2P	3P	4P
Weight [kg] (중량)				40	49		40	49		40	49		40	49
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw	10 kA		10 kA		12 kA		12 kA					
Rated Short-Circuit Making Capacity (단락 투입 전류)		Icm peak	17 kA		17 kA		24 kA		24 kA					
Switching Capacity (개폐용량)			AC-33B											
Switching Frequency (개폐빈도)			60 Time / Hour											
Operating Current (조작전류) peak	DC 110V ~ 125V		25 A											
	AC 100V ~ 110V		25 A											
	AC 200V ~ 240V		8 A											
Operating Time (동작시간)	Operating Transfer Time		≤ 160 ms											
	Opening Time		≤ 60 ms											
	Contact Transfer Time		≤ 120 ms											
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)		10,000											
	With Current (통전)		5,000											
Cautions (주의사항)			1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.											

T3-F Type

ATS(100~630A)





◆ Outline Dimension_ 외형도

Unit : mm

100A



OSS-61-T3-F

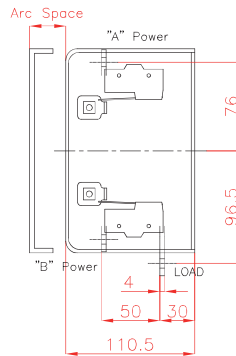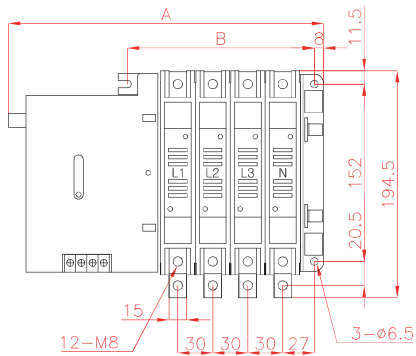

	Dimension (mm)	
Pole	A	B
2P	204	100
3P	234	130
4P	264	160

200A



OSS-62-T3-F

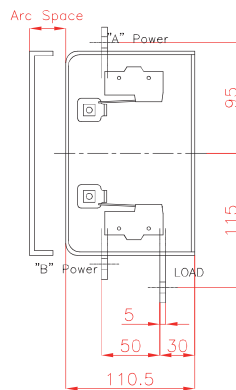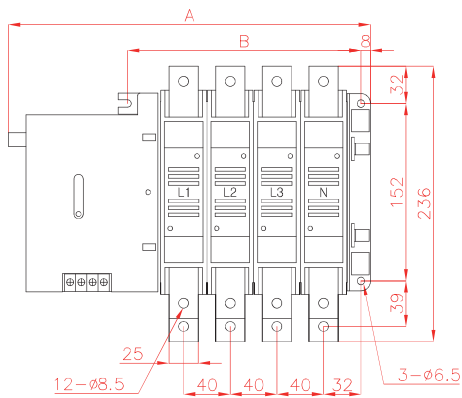

	Dimension (mm)	
Pole	A	B
2P	224	120
3P	264	160
4P	304	200

400A, 630A

OSS-64~66-T3-F

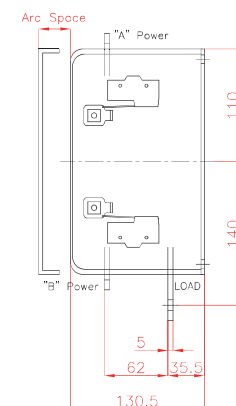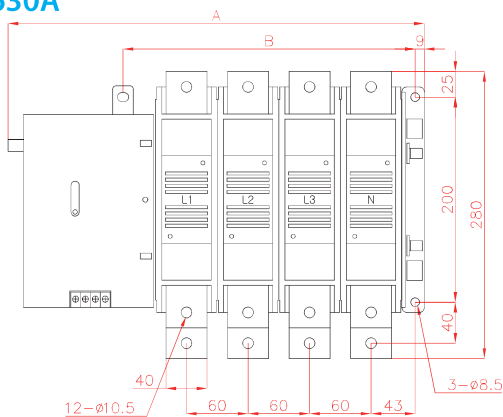

Arc space for main circuit

- 30mm for AC 220V
- 60mm for AC 600V

	Dimension (mm)	
Pole	A	B
2P	283	165
3P	343	225
4P	403	285





T3-B Type

ATS(100~630A)


◆ Outline Dimension_ 외형도

OSS-61~66-T3-B

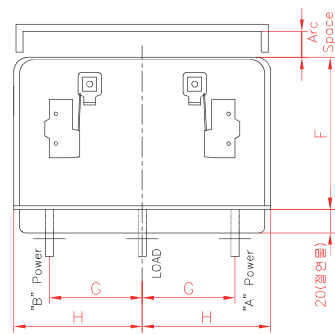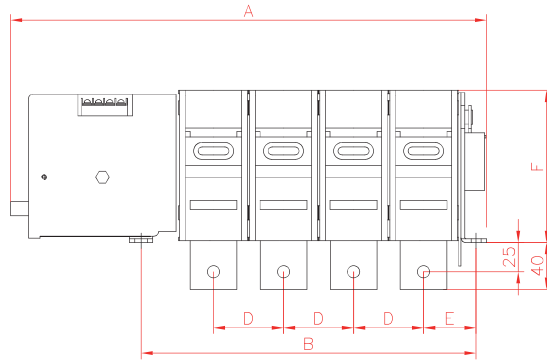


Arc space for main circuit

- 30mm for AC 220V
- 60mm for AC 600V

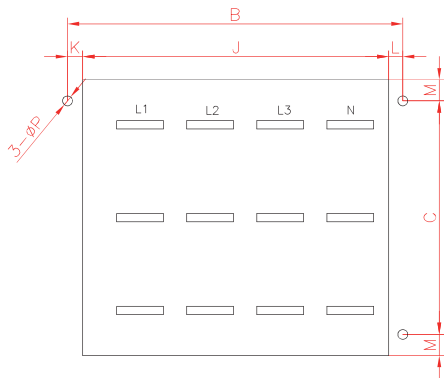

PANEL CUTTING



TERMINAL THICKNESS

	61-T3-B	62-T3-B	64-T3-B	66-T3-B
W	15	25	40	
U	Ø 8.5		Ø 10.5	
T	LINE	4	5	5
	LOAD	4	5	7

Unit : mm

		A	B	C	D	E	F	G	H	J	K	L	M	P
61-T3-B	2P	206	102	152	30	29	110.5	62.5	87.5	82	9	11	19	Ø 6.5
	3P	236	132							112				
	4P	266	162							142				
62-T3-B	2P	226	122	152	40	34	110.5	63	87.5	102	9	11	19	Ø 6.5
	3P	266	162							142				
	4P	306	202							182				
64-T3-B 66-T3-B	2P	285	167	200	60	45	130.5	80.5	110	142	13	12	18	Ø 8.5
	3P	345	227							202				
	4P	405	287							262				



T3-D Type



ATS(100~630A)

Automatic Transfer Switches 08 | 09




◆ Outline Dimension_ 외형도

Unit : mm

OSS-61~66-T3-D

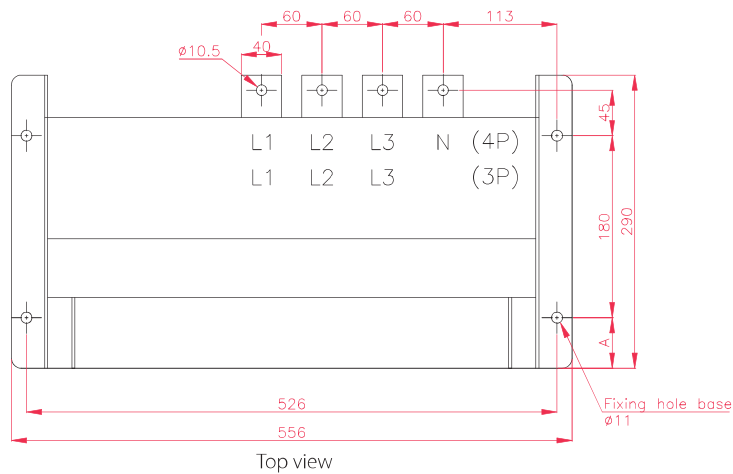


Terminal Thickness		
T	LINE	5
	LOAD	7

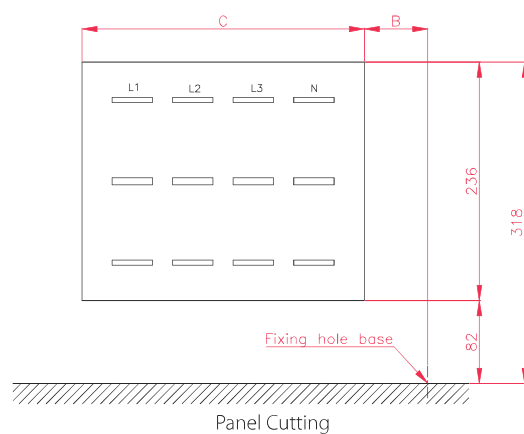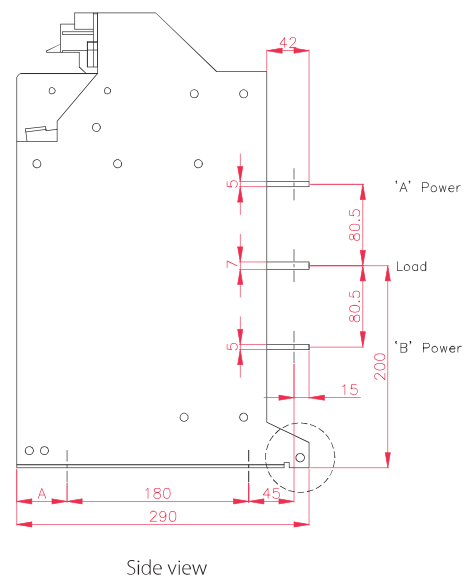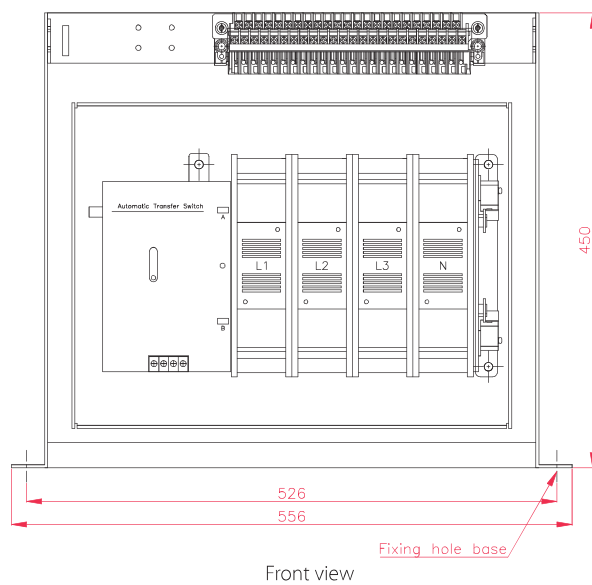

POSITION	A
CONNECTED	50
TEST	87
DISCONNECTED	117

Poles	B	C
3 P	123	220
4 P	63	280



Earthing Hole



TO Type

ATS(100~630A)

◆ Information to Order_ 주문정보

OSS - 6 - TO - - P - - c
A B C D E

A Rated Current 정격전류

1	2	4	6
100A	200A	400A	630A

B Connection (접속방식)

- F : Front (표면)
- B : Back (배면)
- D : Draw-out (인출형)

C Number of Poles(극수)

- 4 : 4 P

D Operating Voltage(조작전압)

- A1 : AC 110V
- D1 : DC 110V
- A2 : AC 220V
- D2 : DC 125V

E Aux switch(보조접점)

- 1 : 1 c (가본)
- 2 : 2 c (오피선)

◆ Features_ 특징

In addition to every function of T3 Type ATS, TO Type ATS has additional function of Overlapping Neutral Contact. (2-Position ATS)

■ Function of Overlapping Neutral Contact

When general ATS will be transferred, Arc will be generated between fixed contacts and moving contacts. Thus, current flows between contacts and arc will be eliminated when current will be at zero level.

Eliminating time of arc is 10~12ms. Therefore, various device of load side can be protected when neutral contacts should be opened 10~12ms later than other 3-phases contacts. Load side devices of general ATS cannot be sufficiently protected because opening time gap between neutral contacts and other 3-phases contacts is less than 10ms. In order to solve this problem, Overlapping between neutral contacts of A-power (Normal) and B-power (Emergency) during transfer of switch functions to protect various devices of load side more safely.

In addition, Non-linear load increases the earth potential and potential difference is occurred between earth and neutral line. When general ATS will be transferred, Neutral line is separated from load and reference potential difference cannot be established. Thus, Floating is occurred and electronic devices can be malfunctioned. When ATS with overlapping neutral contact will be applied, Floating can be protected.

TO Type ATS는 T3 Type ATS의 모든 기능에 N상 중첩 절체 기능을 추가로 가지고 있습니다. (2-Position ATS)

■ N상 중첩절체 기능

일반적인 절체 시 고정자와 가동자의 접점 사이에서 ARC가 발생하여 접촉자 간에 전류를 지속시키게 되며, ARC는 전류의 영점에서 사라져 없어지게 됩니다. 이때 ARC의 소멸시간은 대략 10~12ms 정도가 됩니다. 그러므로 중성접점 (N상)은 다른 삼상 (L1, L2, L3) 보다 10~12ms 후에 떨어져야 부하측의 각종 장비가 보호됩니다. 그러나 일반적인 ATS는 중성접점(N상)과 다른 삼상 (L1, L2, L3)의 시간차가 10ms 이내가 되므로 부하측의 설비를 보호하는데 다소 미흡하다 할 수 있습니다.

이러한 문제를 해결하기 위하여 상용전원의 중성접점과 예비전원의 중성 접점을 중첩시켜 절체시킴으로써 보다 안전하게 부하측의 각종 장비를 보호할 수 있습니다.


또한 비선형 부하는 대지전위를 상승시켜 대지와 중성선 간에 전위차가 생기므로 일반적인 ATS는 절체 시 중성선이 부하측과 분리되어 기준 전위가 확립되지 않아 플로팅 현상이 발생되어 전자장비의 오동작을 유발합니다. 그러므로 중첩절체 기능이 내장된 ATS를 사용함으로써 플로팅 현상을 예방할 수 있습니다.

Location Needed for Overlapping Neutral Contact (중첩절체기능을 필요로 하는 장소)

- Broadcasting System and Telecommunication System (방송국 및 통신전화국)
- Military Communication System and Radar Facilities (군 통신 및 레이더 시설)
- Bank and Computer Center (은행 및 전산시설)
- Large Harmonic Load : Elevator & Escalator, etc.) (다량의 고조파 발생 부하 : 엘리베이터, 에스컬레이터 등)

- Arc Furnace (각종 전기로)
- Petrochemical Plant (석유화학 플랜트)

N-phase Transfer (N상 절체방식)

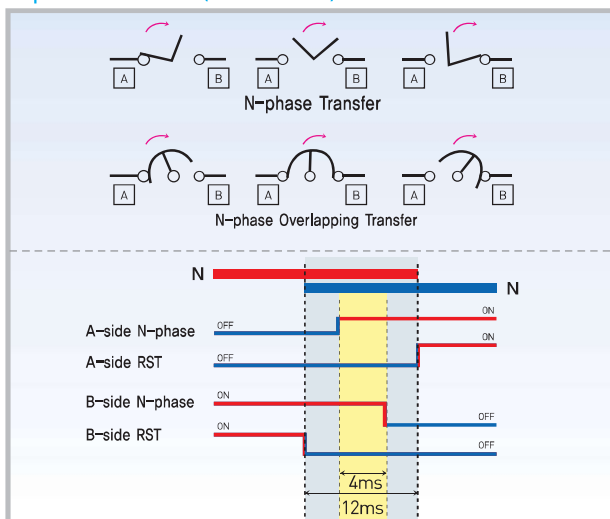


Limits of 4P Transfer (4Pole 절체시 문제점)

- Opening neutral wire is forbidden.
N상이 OPEN 안됨
- The neutral is the common reference to 3-phases.
N상은 3상의 기준이 됨.



- If N-phase will be opened, Ph/Ph voltage can go up to 400V.
For transfer of 4P, Overlapping of N-phase is necessary
N상이 Open되게 되면 상간전압이 400V까지 상승할 수 있음.
4Pole 절체 시 부분적인 N상이 중첩절체가 필요함.

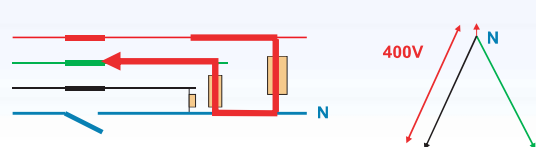



TO Type

ATS(100~630A)

Automatic Transfer Switches 10111

◆ Specification_ 정격사양

TYPE		61-TO-F/B	62-TO-F/B	64-TO-F/B	66-TO-F/B
Rated Operational Voltage (정격사용전압)		Ue AC 600 V			
Rated Insulation Voltage (정격절연전압)		Ui AC 600 V			
Rated Current (정격전류)		Ie 100 A	200 A	400 A	630 A
Neutral Phase Current (중성극전류)		100 A	200 A	400 A	630 A
Kind of Throw (투수)		Double Throw (쌍투)			
Connection (접속방식)		Fixed (고정형) [Front (표면 : F), Back (배면 : B)]			
Number of Poles (극수)		4P	4P	4P	4P
Weight [kg] (중량)		8	10	18	18
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw 5 kA	10 kA	12 kA	12 kA
Rated Short-Circuit Making Capacity (단락 투입 전류)		Icm 7.5 kA	17 kA	24 kA	24 kA
Switching Capacity (개폐용량)		AC-33B			
Switching Frequency (개폐빈도)		60 Time / Hour			
Operating Current (조작전류) peak	DC 110V ~ 125V	18 A		25 A	
	AC 100V ~ 110V	18 A		25 A	
	AC 200V ~ 240V	8 A		8 A	
Operating Time (동작시간)	Operating Transfer Time	≤ 130 ms		≤ 160 ms	
	Opening Time	≤ 50 ms		≤ 60 ms	
	Contact Transfer Time	≤ 80 ms		≤ 120 ms	
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)	10,000			
	With Current (통전)	5,000			
Cautions (주의사항)		1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.			

TYPE		61-T3-D	62-T3-D	64-T3-D	66-T3-D
Rated Operational Voltage (정격사용전압)	Ue	AC 600 V			
Rated Insulation Voltage (정격절연전압)	Ui	AC 600 V			
Rated Current (정격전류)	Ie	100 A	200 A	400 A	630 A
Neutral Phase Current (중성극전류)		100 A	200 A	400 A	630 A
Kind of Throw (투수)		Double Throw (쌍투)			
Connection (접속방식)		Draw-out (인출형)			
Number of Poles (극수)		4P	4P	4P	4P
Weight [kg] (중량)		49	49	49	49
Rated Short-Time Withstand Current (정격 단시간 내전류)	Icw	10 kA	10 kA	12 kA	12 kA
Rated Short-Circuit Making Capacity (단락 투입 전류)	Icm peak	17 kA	17 kA	24 kA	24 kA
Switching Capacity (개폐용량)		AC-33B			
Switching Frequency (개폐빈도)		60 Time / Hour			
Operating Current (조작전류) peak	DC 110V ~ 125V	25 A			
	AC 100V ~ 110V	25 A			
	AC 200V ~ 240V	8 A			
Operating Time (동작시간)	Operating Transfer Time	≤ 160 ms			
	Opening Time	≤ 60 ms			
	Contact Transfer Time	≤ 120 ms			
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)	10,000			
	With Current (통전)	5,000			
Cautions (주의사항)		1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.			



TO-F Type



ATS(100~630A)

◆ Outline Dimension_ 외형도

Unit : mm

100A



OSS-61-TO-F

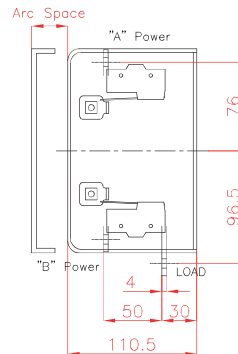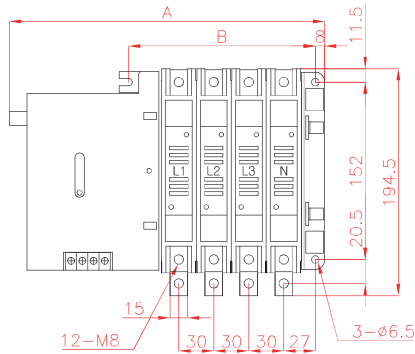

	Dimension (mm)	
Pole	A	B
4P	264	160

200A



OSS-62-TO-F

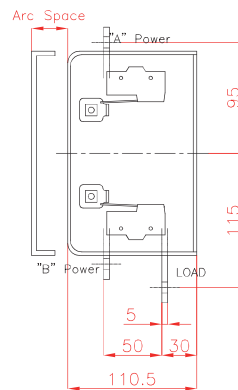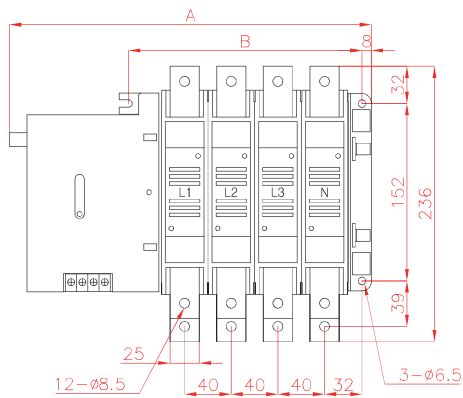

	Dimension (mm)	
Pole	A	B
4P	304	200

400A, 630A

OSS-64~66-TO-F

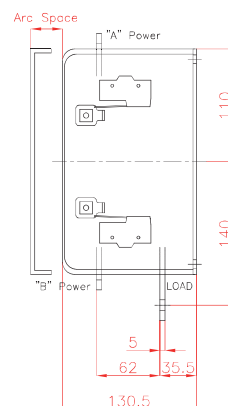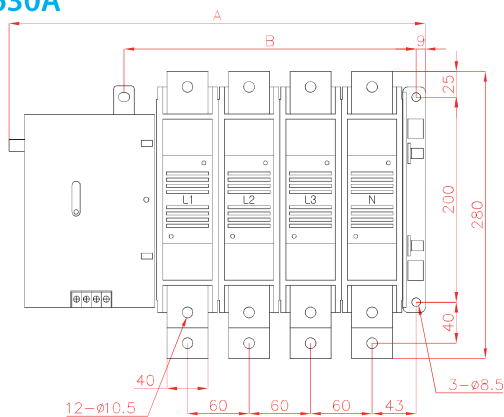

Arc space for main circuit
- 30mm for AC 220V
- 60mm for AC 600V

	Dimension (mm)	
Pole	A	B
4P	403	285





TO-B Type

ATS(100~630A)


◆ Outline Dimension_ 외형도

OSS-61~66-TO-B

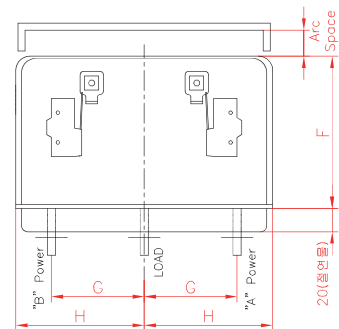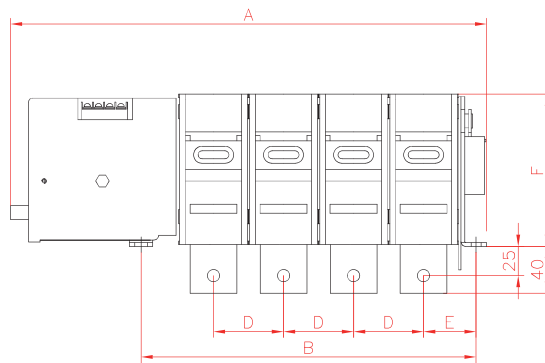


Arc space for main circuit

- 30mm for AC 220V
- 60mm for AC 600V

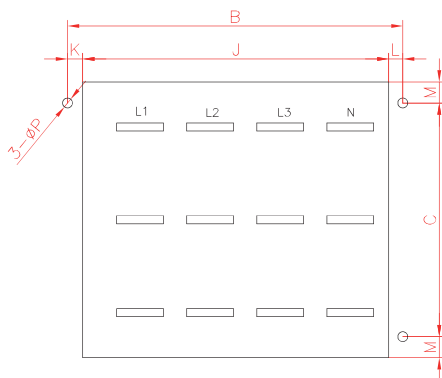

PANEL CUTTING



TERMINAL THICKNESS

	61-TO-B	62-TO-B	64-TO-B	66-TO-B
W	15	25	40	
U	Ø 8.5		Ø 10.5	
T	LINE	4	5	5
	LOAD	4	5	7

Unit : mm

		A	B	C	D	E	F	G	H	J	K	L	M	P
61-TO-B	4P	266	162	152	30	29	110.5	62.5	87.5	142	9	11	19	Ø 6.5
62-TO-B	4P	306	202	152	40	34	110.5	63	87.5	182	9	11	19	Ø 6.5
64-TO-B	4P	405	287	200	60	45	130.5	80.5	110	262	13	12	18	Ø 8.5





TO-D Type

ATS(100~630A)




◆ Outline Dimension_ 외형도

Unit : mm

OSS-61~66-TO-D

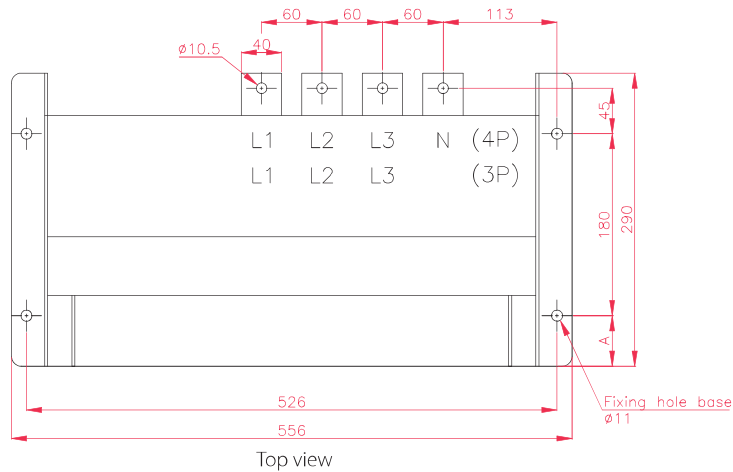


Terminal Thickness		
T	LINE	5
	LOAD	7

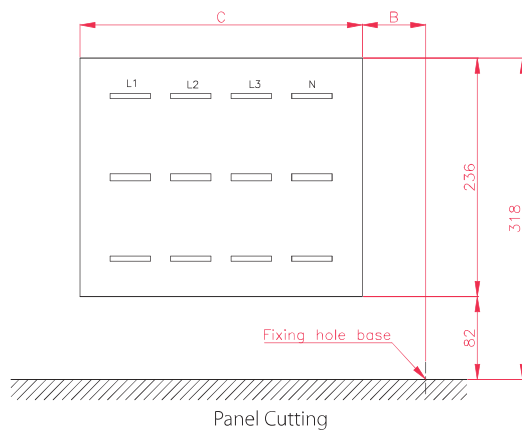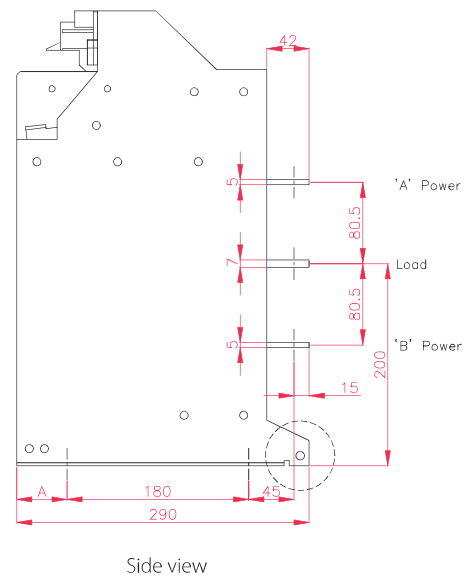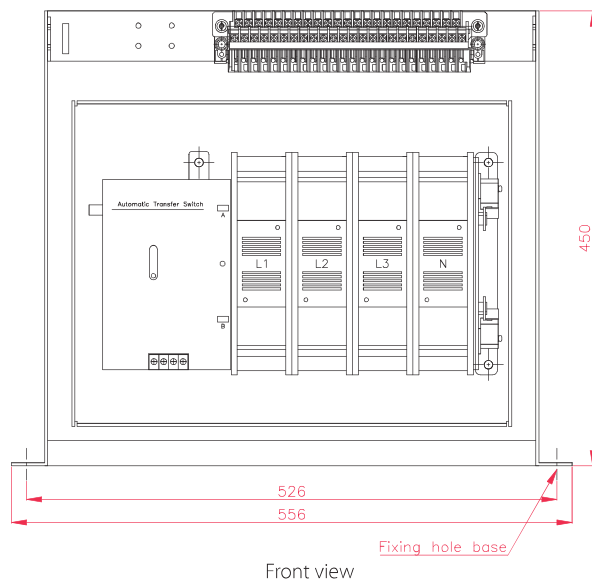

POSITION	A
CONNECTED	50
TEST	87
DISCONNECTED	117

Poles	B	C
4 P	63	280



Earthing Hole




T3, TO Type


ATS(100~630A)

Circuit Diagram (회로도)


Control Voltage AC

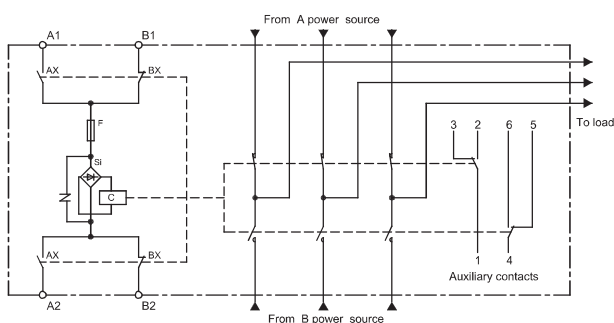

Control Voltage DC

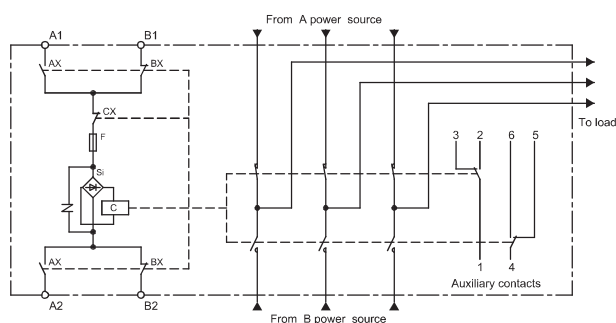


A1, A2	A-Power Closing Terminal	AX, BX, CX	Closing Control Switch	C	Closing Coil
B1, B2	B-Power Closing Terminal	1 ~ 6	Indication Contacts	F	Fuse

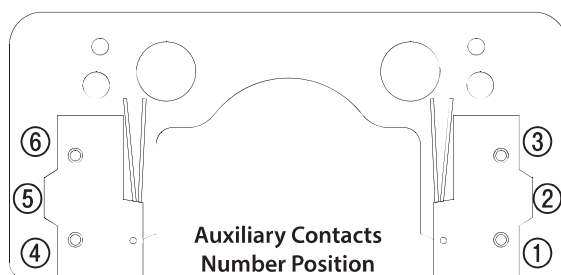


Wiring Diagram (결선도)

Control Voltage AC

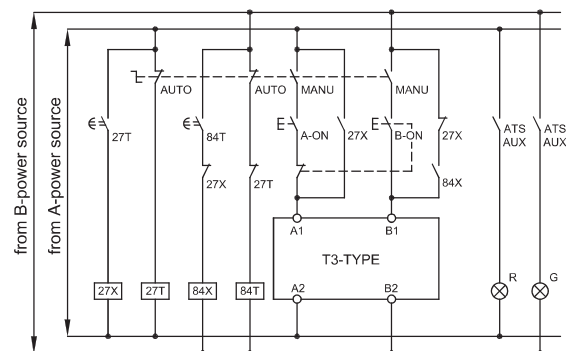

Control Voltage DC

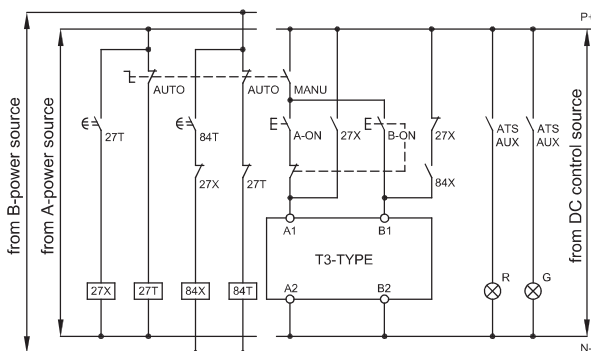

27X	Source-A Operating Relay	84X	Source-B Operating Relay
27T	A-Power Closing Delay Timer	84T	B-Power Closing Delay Timer
AUTO	Automatic Operation	MANU	Manual Operation



TN Type

ATS(63~630A)

Information to Order_ 주문정보

OSS - 6□ - TN - □ - □P - □ - □c
A B C D E

A Rated Current 정격전류

06	1	2	4	6
63A	100A	200A	400A	630A

D Operating Voltage(조작전압)

- A1 : AC 110V
- D1 : DC 110V
- A2 : AC 220V
- D2 : DC 125V

B Connection(접속방식)

- F : Front (표면)
- B : Back (배면)
- D : Draw-out (인출형)

C Number of Poles(극수)

- 2 : 2 P
- 3 : 3 P
- 4 : 4 P

E Aux switch(보조접점)

- 1 : 1 c (기본)
- 2 : 2 c (옵션)

Features_ 특징

Neutral position stop method (3-Position ATS)

In case with the uninterrupted power system, it is recommended to stop at the OFF position set by tripping mechanism for the stable power. Instantaneous transfer without stop can be also performed by operating signal.

A ⇒ Off ⇒ B, B ⇒ Off ⇒ A, and A ⇒ Off ⇒ A, B ⇒ Off ⇒ B

Excellent Breaking Capacity

Designed for sufficiently large chamber to extinguish the arc when transferred. Arc-extinguishing area is designed for convenient inspection and maintenance.

Last Break, 1st make Neutral contact

Last Break, 1st make Neutral contact to reduce nuisance tripping in the ground fault protection system. IEC 60947-1 (Clause 7.1.9)

Applicable Standards

- IEC 60947-6-1 - UL 1008

Control Order

It is recommended to give more than 0.5sec for operation, though transfer time is completed

Interlock

Interlocking is required for control circuit so that control order should not supply to both A power source side and B power source side simultaneously.

Control Circuit

ATS is designed so that operation current should be off by internal switch after completion of operation. If operation current is off with auxiliary switch of the unit, it may cause a malfunction.

See page 65 for calculation of TR capacity for operation.

■ 중간정지 방식 (3-Position ATS)

무정전 전원장치가 있는 경우 정전 또는 복전 시 긴급 절체되는 것 보다는 회로의 안정 및 안전을 확인한 후 절체할 수 있는 방식으로 트립장치에 의해 중간위치(Off)가 가능합니다.

A ⇒ Off ⇒ B, B ⇒ Off ⇒ A, and A ⇒ Off ⇒ A, B ⇒ Off ⇒ B

■ 강력한 차단 능력

독특한 구조의 소화실 설계로 아크차단이 짧고 접점의 소모가 작아 장기간 사용 가능하며 전면에서 소화실을 열 수 있어 내부 접점의 점검이 편리합니다.

■ 중성선 선 투입 후 개방

투입 시 중성선이 삼상(L1, L2, L3)보다 먼저 투입되고 개방 시 나중에 끊어지는 구조로 순간적으로 중성선이 개방되어 발생될 수 있는 사고를 방지. IEC 60947-1 (Clause 7.1.9)

■ 관련 규격

- IEC 60947-6-1 - UL 1008

■ 제어 지령

투입 및 트립 절체동작은 0.3초 이내에 완료되지만 0.5초 이상의 제어지령으로 동작될 수 있도록 Sequence를 설정하여 주십시오.

■ 인터록

조작회로에는 A 전원 측과 B 전원 측에 동시지령이 되지 않도록 인터록(전기적)을 설치하여 주십시오.


■ 제어회로

ATS는 동작완료 후 내부 SW에 의해 조작전류를 OFF 하도록 설계되어 있습니다. 본체의 보조 SW로 조작전류를 OFF하면 오동작의 원인이 됩니다.

■ 조작용 TR 용량 선정은 65 페이지 참조

External View_ 외관명칭

- ① Earthing Terminal (접지단자)
- ② Manual Operating Shaft (Anti-Clockwise) (수동조작 바)
- ③ Circuit Diagram (회로도)
- ④ Name Plate (명판)
- ⑤ Trip Button (트립 버튼)
- ⑥ Selective Button for "B" Power-Closing (선택 버튼)
- ⑦ On/Off Indicator (동작표시기)
- ⑧ Circuit Terminal for "A" Power (A전원측 주회로 단자)
- ⑨ Contacts (접점부)
- ⑩ Arc-Extinguishing Chamber (소화실)
- ⑪ Aux Switch (보조스위치)
- ⑫ Circuit Terminal for "B" Power (B전원측 주회로 단자)
- ⑬ Control Circuit Terminal Block (조작전원 단자대)
- ⑭ Main Circuit Terminal for Load (부하측 주회로 단자)
- ⑮ Amature for Closing Coil (투입 코일)

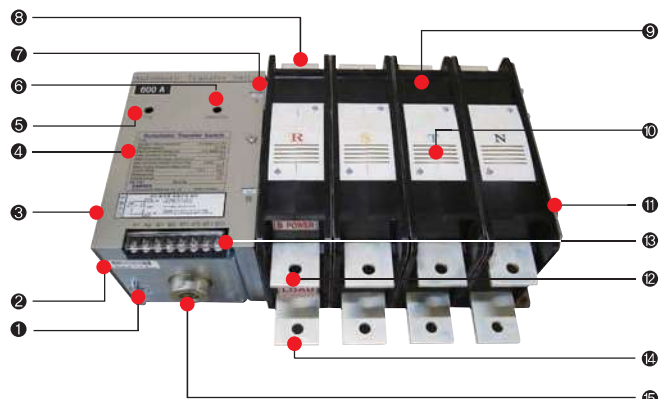



TN Type

ATS(63~630A)

◆ Specification_ 정격사양

TYPE			606/61-TN-F/B			62-TN-F/B			64-TN-F/B			66-TN-F/B						
Rated Operational Voltage (정격사용전압)			Ue		AC 600 V													
Rated Insulation Voltage (정격절연전압)			Ui		AC 600 V													
Rated Current (정격전류)			Ie		63 A / 100 A			200 A			400 A			630 A				
Neutral Phase Current (중성극전류)					63 A / 100 A			200 A			400 A			630 A				
Kind of Throw (투수)					Double Throw (쌍투)													
Connection (접속방식)					Fixed (고정형) [Front (표면 : F), Back (배면 : B)]													
Number of Poles (극수)					2P	3P	4P	2P	3P	4P	2P	3P	4P	2P	3P	4P		
Weight [kg] (중량)					6	7	8	7	8	10	12	15	18	12	15	18		
Rated Short-Time Withstand Current (정격 단시간 내전류)			Icw		5 kA			10 kA			12 kA			12 kA				
Rated Short-Circuit Making Capacity (단락 투입 전류)			Icm peak		7.5 kA			17 kA			24 kA			24 kA				
Switching Capacity (개폐용량)					AC-33B													
Switching Frequency (개폐빈도)					60 Time / Hour													
Operating Current (조작전류) peak			DC 110V ~ 125V		7 A						8 A							
			AC 100V ~ 110V		7 A						8 A							
			AC 200V ~ 240V		6 A													
			Trip Coil Current		DC 110 = 4.5 A, AC 110 = 4.5 A, AC 220 = 3 A													
Operating Time (동작시간)			"A" Power		Making		≤ 55 ms						≤ 60 ms					
					Breaking		≤ 20 ms						≤ 25 ms					
			"B" Power		Making		≤ 80 ms						≤ 90 ms					
					Breaking		≤ 20 ms						≤ 25 ms					
Number of Operating Cycles (정격 개폐 회수)			Without Current (무통전)		10,000													
			With Current (통전)		5,000													
Cautions (주의사항)					1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.													

TYPE			606/61-TN-D			62-TN-D			64-TN-D			66-TN-D				
Rated Operational Voltage (정격사용전압)			Ue		AC 600 V											
Rated Insulation Voltage (정격절연전압)			Ui		AC 600 V											
Rated Current (정격전류)			Ie		63 A / 100 A			200 A			400 A			630 A		
Neutral Phase Current (중성극전류)					63 A / 100 A			200 A			400 A			630 A		
Kind of Throw (투수)					Double Throw (쌍투)											
Connection (접속방식)					Draw-out (인출형)											
Number of Poles (극수)					2P	3P	4P	2P	3P	4P	2P	3P	4P	2P	3P	4P
Weight [kg] (중량)						40	49		40	49		40	49		40	49
Rated Short-Time Withstand Current (정격 단시간 내전류)			Icw		10 kA			10 kA			12 kA			12 kA		
Rated Short-Circuit Making Capacity (단락 투입 전류)			Icm peak		17 kA			17 kA			24 kA			24 kA		
Switching Capacity (개폐용량)					AC-33B											
Switching Frequency (개폐빈도)					60 Time / Hour											
Operating Current (조작전류) peak			DC 110V ~ 125V		8 A											
			AC 100V ~ 110V		8 A											
			AC 200V ~ 240V		6 A											
			Trip Coil Current		DC 110 = 4.5 A, AC 110 = 4.5 A, AC 220 = 3 A											
Operating Time (동작시간)			"A" Power		Making		≤ 60 ms									
					Breaking		≤ 25 ms									
			"B" Power		Making		≤ 90 ms									
					Breaking		≤ 25 ms									
Number of Operating Cycles (정격 개폐 회수)			Without Current (무통전)		10,000											
			With Current (통전)		5,000											
Cautions (주의사항)					1. For complete operation, Be sure to provide control source for more than 0.5sec. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. When control source will be provided to A side and B side simultaneously, coil may be damaged. 2. A측, B측 동시 조작지령 시 코일소손의 원인이 됩니다.											



TN-F Type



ATS(63~630A)

◆ Outline Dimension_ 외형도

Unit : mm

63A, 100A



OSS-606~61-TN-F

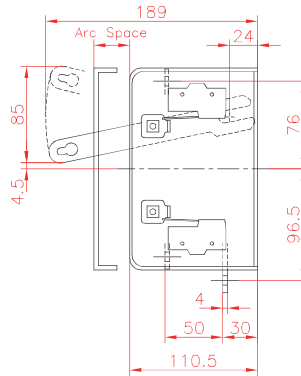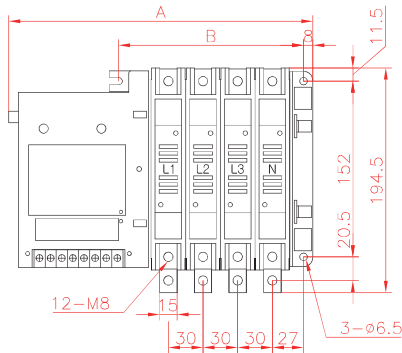

	Dimension (mm)	
Pole	A	B
2 P	204	100
3 P	234	130
4 P	264	160

200A



OSS-62-TN-F

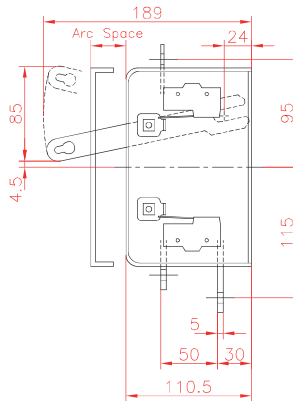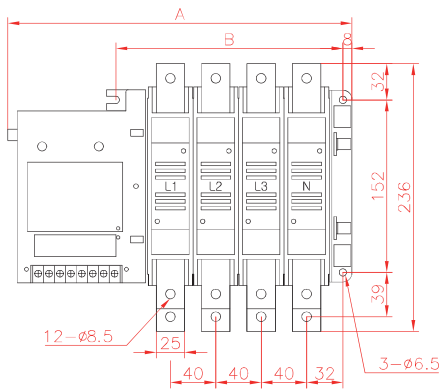

	Dimension (mm)	
Pole	A	B
2P	224	120
3P	264	160
4P	304	200

400A, 630A

OSS-64~66-TN-F

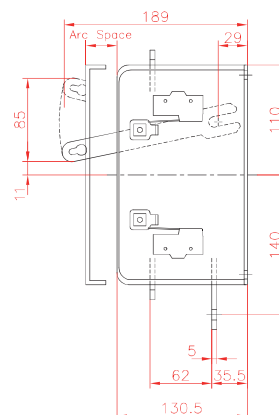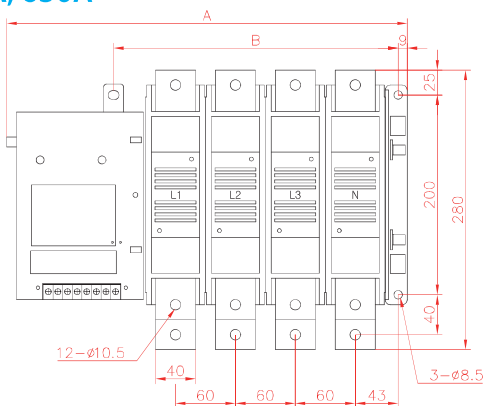

Arc space for main circuit



- 30mm for AC 220V
- 60mm for AC 600V

	Dimension (mm)	
Pole	A	B
2P	283	165
3P	343	225
4P	403	285




◆ Outline Dimension 외형도

OSS-606~66-TN-B

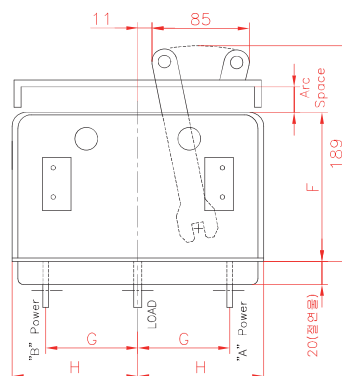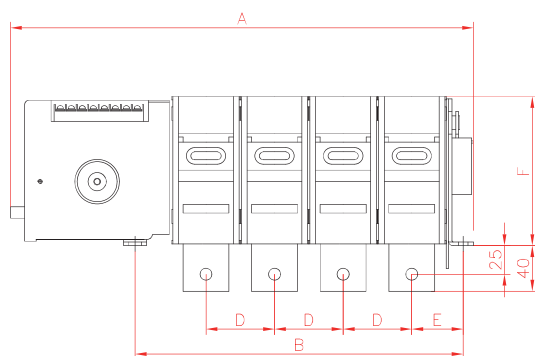


Arc space for main circuit

- 30mm for AC 220V
- 60mm for AC 600V

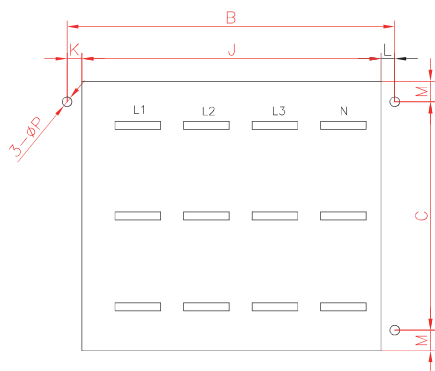

PANEL CUTTING



		606-TN-B 61-TN-B	62-TN-B	64-TN-B	66-TN-B
W		15	25	40	
U		Ø 8,5		Ø 10,5	
T	LINE	4	5	5	
	LOAD	4	5	7	

TERMINAL THICKNESS

Unit : mm

		A	B	C	D	E	F	G	H	J	K	L	M	P
606-TN-B 61-TN-B	2P	206	102	152	30	29	110.5	62.5	87.5	82	9	11	19	Ø 6.5
	3P	236	132							112				
	4P	266	162							142				
62-TN-B	2P	226	122	152	40	34	110.5	63	87.5	102	9	11	19	Ø 6.5
	3P	266	162							142				
	4P	306	202							182				
64-TN-B 66-TN-B	2P	285	167	200	60	45	130.5	80.5	110	142	13	12	18	Ø 8.5
	3P	345	227							202				
	4P	405	287							262				

TN-D Type


ATS(63~630A)




◆ Outline Dimension_ 외형도

Unit : mm


OSS-606~66-TN-D

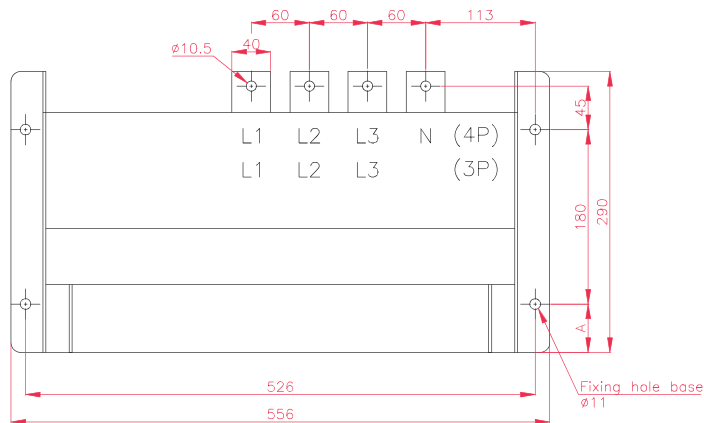


Top view




Terminal Thickness		
T	LINE	5
	LOAD	7

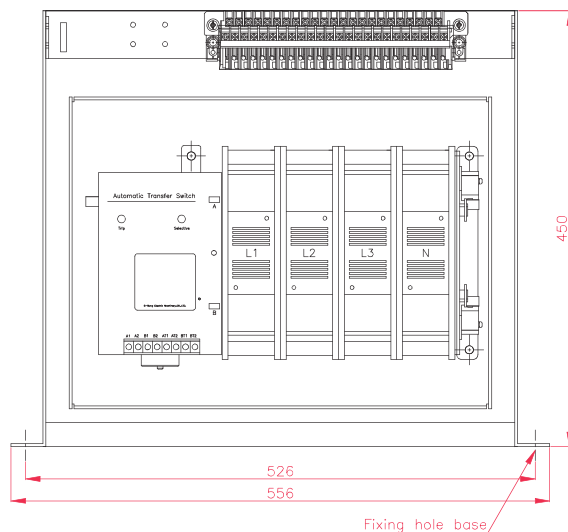

Front view

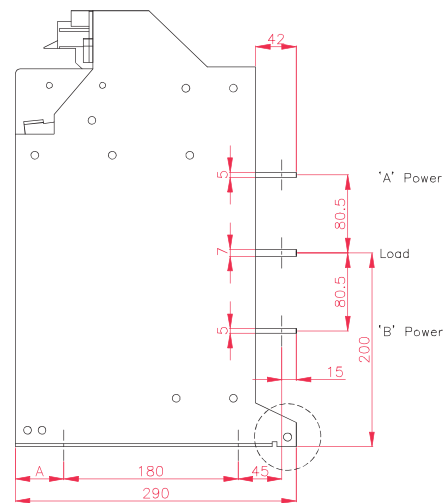


Side view

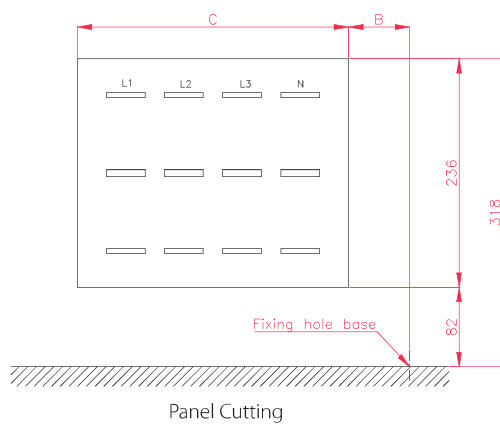

Panel Cutting

POSITION	A
CONNECTED	50
TEST	87
DISCONNECTED	117

Poles	B	C
3 P	123	220
4 P	63	280



Earthing Hole




TN Type


ATS(63~630A)

Automatic Transfer Switches 20121

Circuit Diagram (회로도)

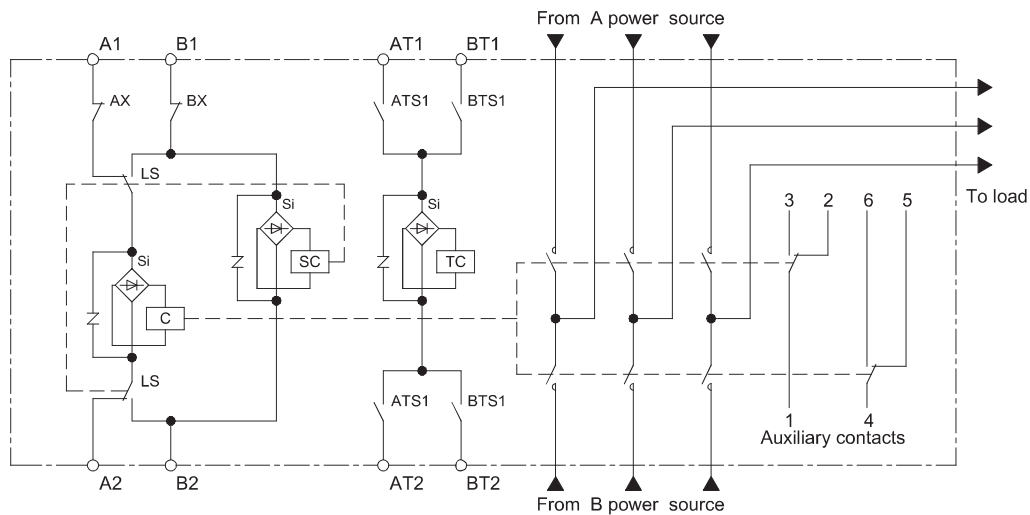


A1, A2	A-Power Closing Terminal	LS	Selective Switch	SC	Selective Coil
B1, B2	B-Power Closing Terminal	Si	Silicon Rectifier	AX, BX	Closing Control Switch
AT1, AT2	A-Power Tripping Terminal	C	Closing Coil	ATS, BTS	Tripping Control Switch
BT1, BT2	B-Power Tripping Terminal	TC	Tripping Coil	1~6	Indication Contacts

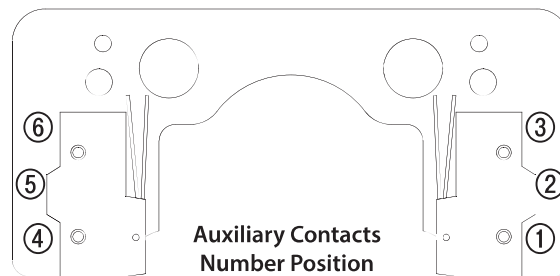


Wiring Diagram (결선도)

Control Voltage AC

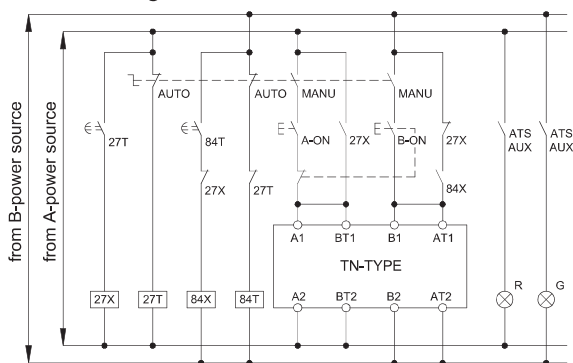

Control Voltage DC

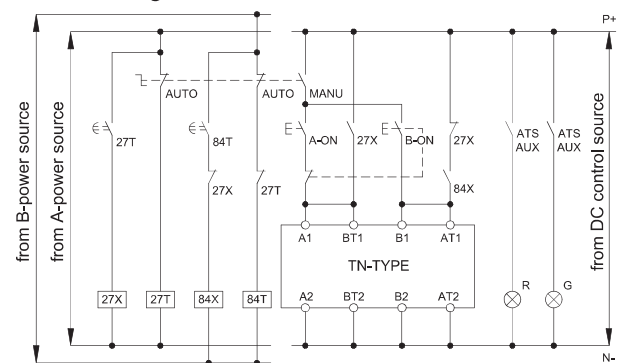

27X	Source-A Operating Relay	84X	Source-B Operating Relay
27T	27X Operating Delay Timer	84T	B-Power Closing Delay Timer
AUTO	Automatic Operation	MANU	Manual Operation

PC Type

ATS(800~6300A)



Information to Order_ 주문정보

OSS - 6 A - PC - B - C P - D

A Rated Current

08	10	12	16	20	25	32	40	50	63
800A	1000A	1250A	1600A	2000A	2500A	3200A	4000A	5000A	6300A

B Connection (접속방식)

- F : Fixed (고정형)
- D : Draw-out (인출형)

C Number of Poles

- 3 : 3P
- 4 : 4P

D Operating Voltage

- A1 : AC 110V ● D1 : DC 110V
- A2 : AC 220V ● D2 : DC 125V

External View_ 외관명칭

①	Arc-Extinguishing Chamber (소호실)
②	Manual Lever Inlet (수동 레버 삽입구)
③	Manual Lever (수동 레버)
④	Name Plate (명판)
⑤	Lifting Hook (견인고리)
⑥	Circuit Diagram (회로도)
⑦	ON-OFF Indicator (절체상태표시기)
⑧	Terminal Block (단자대) - Product below 1600A are connector (1600A 이하 제품은 커넥터입니다.)



Features_ 특징

Transfer method (2-Position ATS)

A ⇒ B, B ⇒ A

One coil mechanism

One coil mechanism is applied

Transfer indicator provided

Transfer indicator is fitted to indicate the transfer status.

Easier busbar arrangement

If the ATS is installed with the ACB in switchgear, Busbar can be easily arranged.

Fixed Type & Drawout Type available

Fixed Type and Drawout Type, Can satisfy a variety of customer needs.

Quick replacement of ATS

If malfunction occurs, Drawout Type of ATS can be changed within 5 minutes.

Perfect transfer mechanism

By spring transfer mechanism, ATS can be completely and perfectly transferred. There will be NO unattached position in any case.

Sufficient current capacity

Sufficient current carrying contacts are designed to withstand against over current.

Minimized opening & closing impact

Opening and closing impact is minimized.

Last Break, 1st make Neutral contact

Last Break, 1st make Neutral contact to reduce nuisance tripping in the ground fault protection system. IEC 60947-1 (Clause 7.1.9)

See page 65 for calculation of TR capacity for operation.

■ 절체 방식 (2-Position ATS)

A ⇒ B, B ⇒ A

■ 1 코일 절체 기구

정평이 있는 순시 여자 방식의 1 코일 절체 기구를 채택했습니다.

■ 절체 표시기 부착

절체의 상태를 확인할 수 있는 절체 표시기를 부착하였습니다.

■ 부스바 작업 간편

ACB와 함께 배전반 설치 시 부스바 작업이 간편합니다.

■ 다양한 고객요구 만족

고정형과 인출형이 있어 다양한 고객요구를 만족시킬 수 있습니다.

■ ATS 교체시간 단축

인출형의 경우, 사고 발생 시 ATS 교체시간은 5분 이하입니다.

■ 불완전 투입요소 완전 제거

스프링 절체방식에 의해서 완전하고 완벽한 절체가 되도록 하였습니다. 양쪽 전원 중 어느 한쪽으로 반드시 접촉되도록 구조가 이루어져 있습니다.

■ 접점부 과전류 설계

통전부의 독특한 접점구조에 의해서 과전류에 충분히 이겨낼 수 있도록 설계되어 있습니다.

■ 개폐 쇼크 미미

개폐 조작 시 개폐 쇼크가 극소합니다.

■ 중성선 선 투입 후 개방

투입 시 중성선이 삼상(L1, L2, L3)보다 먼저 투입되고 개방 시 나중에 끊어지는 구조로 순간적으로 중성선이 개방되어 발생할 수 있는 사고를 방지. (IEC 60947-1 Clause 7.1.9)

■ 조작용 TR 용량 선정은 65 페이지 참조



ATS(800~6300A)

◆ Specification_ 정격사양

TYPE		608-PC		610-PC		612-PC		616-PC		620-PC		
Rated Operational Voltage (정격사용전압)		Ue	AC 600V									
Rated Insulation Voltage (정격절연전압)		Ui	AC 800V									
Rated Current (정격전류)		Ie	800 A	1000 A	1250 A	1600 A	2000 A					
Neutral Phase Current (중성극전류)			800 A	1000 A	1250 A	1600 A	2000 A					
Kind of Throw (투수)			Double Throw (쌍투)									
Connection (접속방식)			Fixed (고정형), Draw-out (인출형)									
Number of Poles (극수)			3P	4P	3P	4P	3P	4P	3P	4P	3P	4P
Weight (중량 : kg)	Fixed (고정)		52	58	52	58	55	63	57	67	85	115
	Draw-out (인출)		86	104	86	104	94	115	102	120	135	180
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw	25 kA			30 kA		35 kA		40 kA		
Rated Short-Circuit Making Capacity (단락 투입 전류) peak		Icm	52.5 kA			63 kA		73.5 kA		84 kA		
Switching Capacity (개폐용량)			AC -33B									
Switching Frequency (개폐빈도)			60 Time / Hour			20 Time / Hour			10 Time / Hour			
Operating Current (조작전류) peak	DC 110V ~ 125V		45 A			50 A			65 A			
	AC 100V ~ 110V		45 A			50 A			65 A			
	AC 200V ~ 240V		30 A			40 A			50 A			
Operating Time (동작시간)	Operating Transfer Time		AC Control ≤ 120 ms / DC Control ≤ 150 ms								≤ 150ms / ≤ 180ms	
	Opening Time		AC Control ≤ 90 ms / DC Control ≤ 120 ms								≤ 120ms / ≤ 150ms	
	Contact Transfer Time		≤ 30 ms								≤ 25 ms	
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)		10,000					5,000				
	With Current (통전)		5,000					3,000				

Cautions (주의사항)

1. For complete operation, Be sure to provide control source for more than 0.5sec.
 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged.
1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오.
2. A측, B측 동시 조작 지령 시 코일 소손의 원인이 됩니다.

TYPE		625-PC		632-PC		640-PC		650-PC		663-PC		
Rated Operational Voltage (정격사용전압)		Ue	AC 600 V									
Rated Insulation Voltage (정격절연전압)		Ui	AC 800 V									
Rated Current (정격전류)		Ie	2500 A		3200 A		4000 A		5000 A		6300 A	
Neutral Phase Current (중성극전류)			2500 A		3200 A		4000 A		5000 A		6300 A	
Kind of Throw (투수)			Double Throw (쌍투)									
Connection (접속방식)			Fixed (고정형), Draw-out (인출형)									
Number of Poles (극수)			3P	4P	3P	4P	3P	4P	3P	4P	3P	4P
Weight (중량 : kg)	Fixed (고정)		92	123	98	133	164	203	191	235	191	235
	Draw-out (인출)		158	203	171	217	265	330	340	400	340	400
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw	50 kA				65 kA					
Rated Short-Circuit Making Capacity (단락 투입 전류) peak		Icm	105 kA				143 kA					
Switching Capacity (개폐용량)			AC -33B									
Switching Frequency (개폐빈도)			10 Time / Hour									
Operating Current (조작전류) peak	DC 110V ~ 125V		65 A				90 A					
	AC 100V ~ 110V		65 A				90 A					
	AC 200V ~ 240V		50 A				65 A					
Operating Time (동작시간)	Operating Transfer Time		AC Control ≤ 150 ms / DC Control ≤ 180 ms									
	Opening Time		AC Control ≤ 120 ms / DC Control ≤ 150 ms									
	Contact Transfer Time		≤ 25 ms									
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)		5,000								3,000	
	With Current (통전)		3,000								1,500	

Cautions (주의사항)

1. For complete operation, Be sure to provide control source for more than 0.5sec.
 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged.
1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오.
2. A측, B측 동시 조작 지령 시 코일 소손의 원인이 됩니다.




PC Type

ATS(800~6300A)





◆ Outline Dimension_ 외형도

800~1600A Fixed

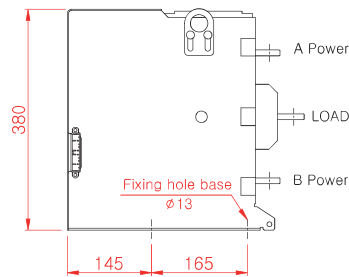
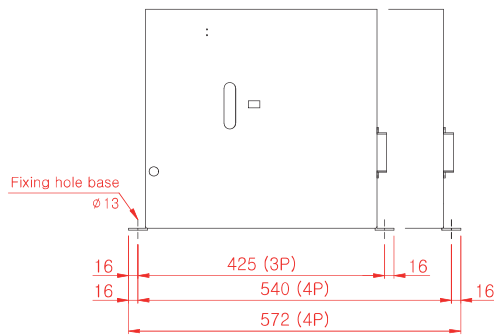


Poles	A	B
3P	425	325
4P	540	440



Panel cutting
(Fixing hole)

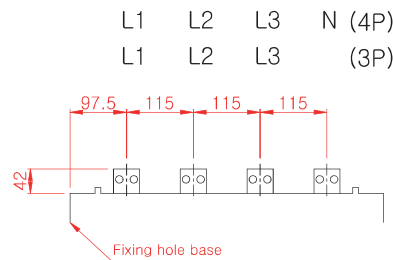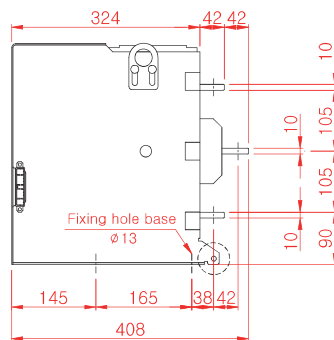



OSS-608~610-PC





Earthing Hole

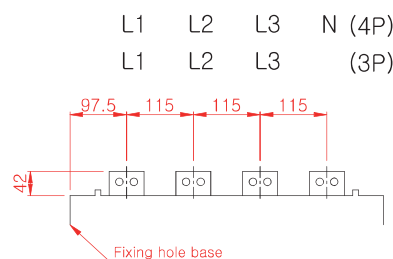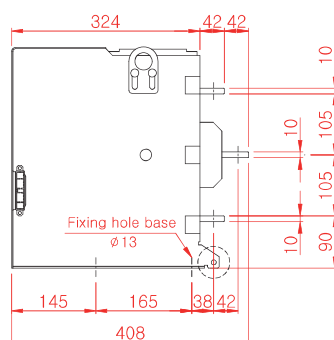



OSS-612-PC



Earthing Hole

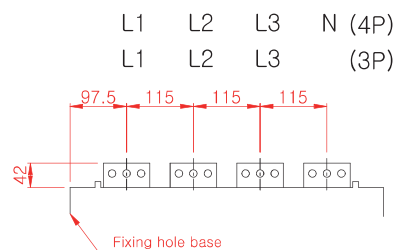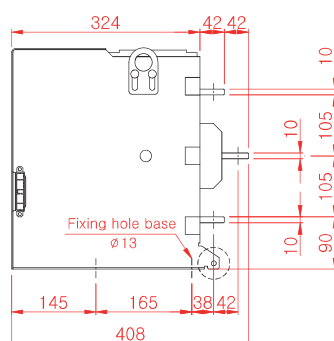

OSS-616-PC






Earthing Hole



◆ Outline Dimension_ 외형도



2000~3200A Fixed

Unit : mm

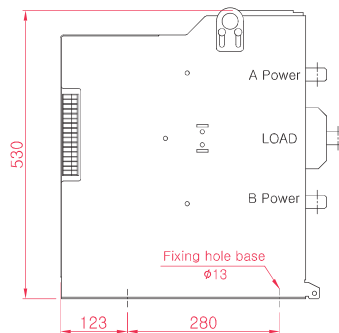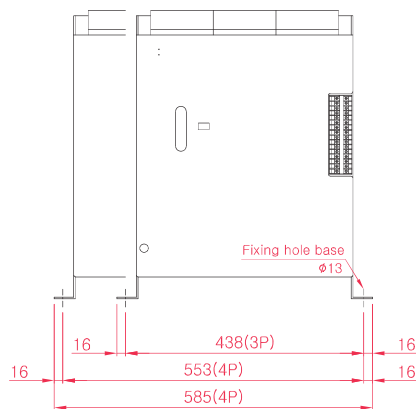


Poles	A	B
3P	438	338
4P	553	453




Panel Cutting
(Fixing Hole)

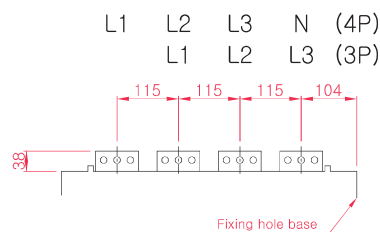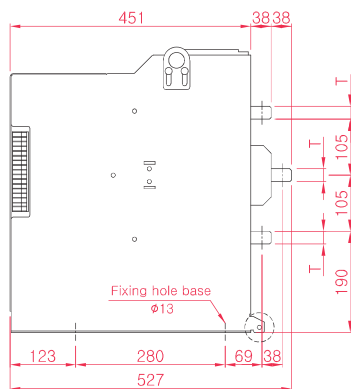

Current	T
2000A	15
2500A	24



Earthing Hole

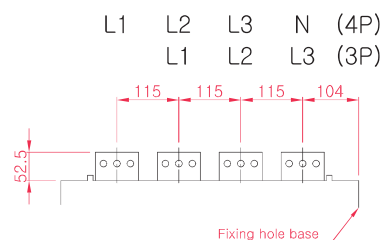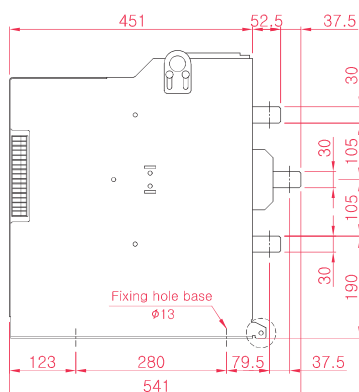

Earthing Hole

PC Type



ATS(800~6300A)






◆ Outline Dimension_ 외형도

4000~6300A Fixed




Unit : mm

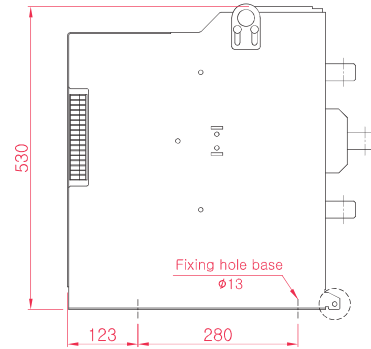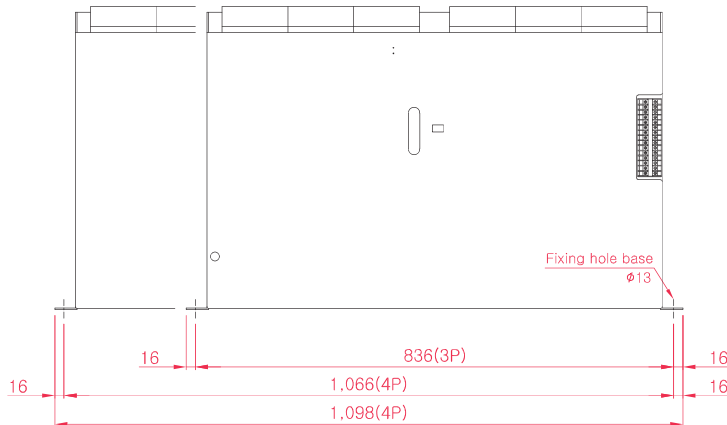


OSS-640-PC

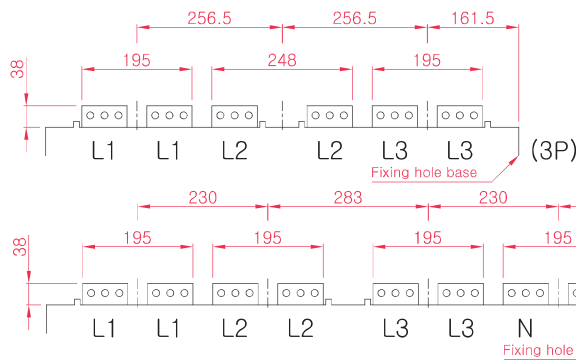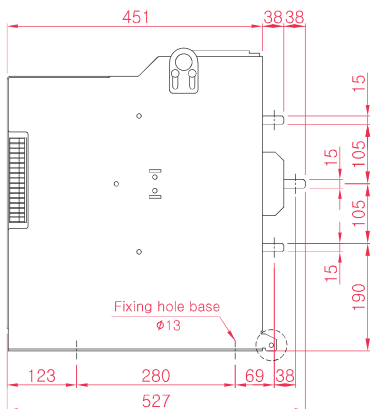


OSS-650~663-PC

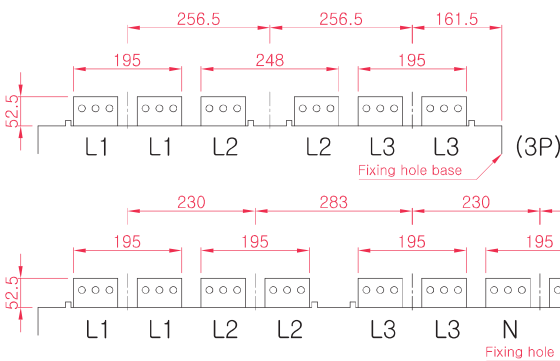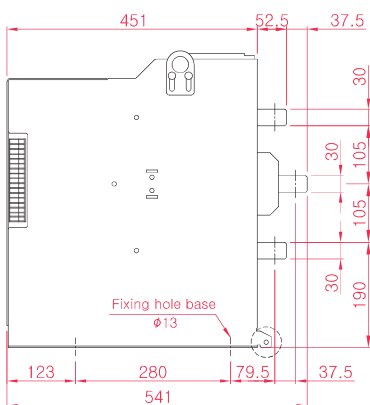

Panel cutting (Fixing hole)

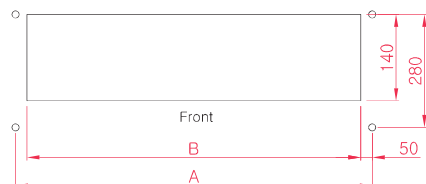

Poles	A	B
3P	836	736
4P	1066	966





Earthing Hole





◆ Outline Dimension_ 외형도

800~1600A Draw-out




Unit : mm

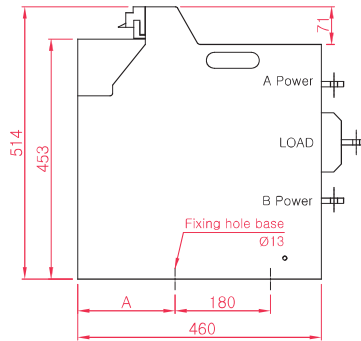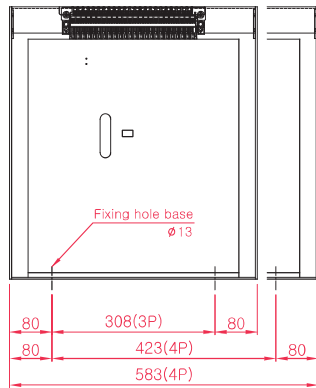




POSITION	A
CONNECTED	184
TEST	225
DISCONNECTED	254

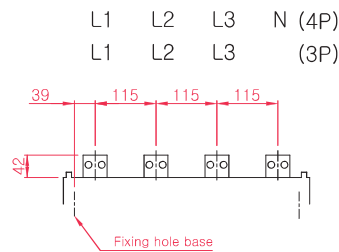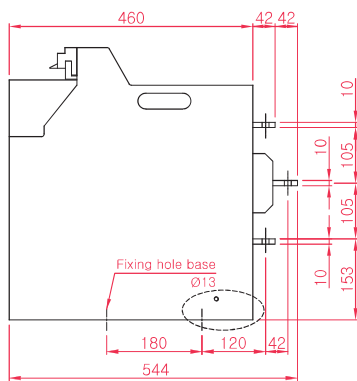


OSS-608~610-PC

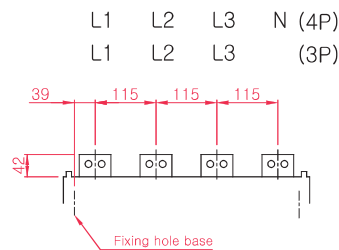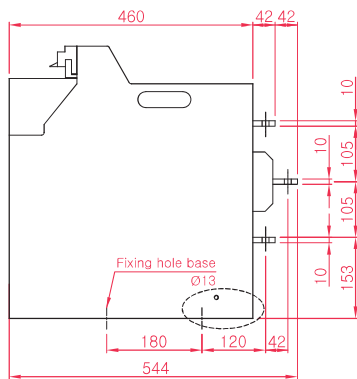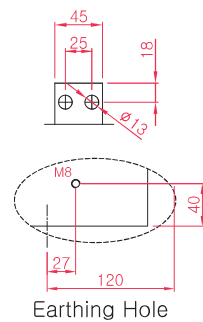

OSS-612-PC

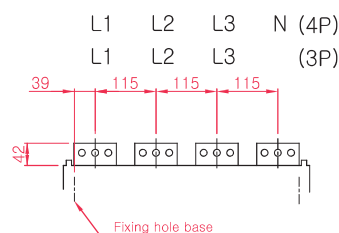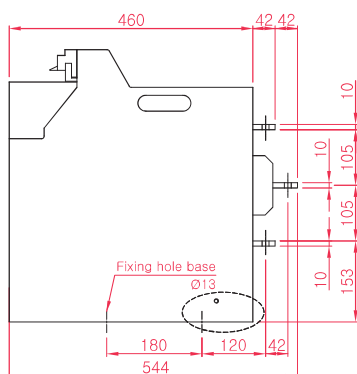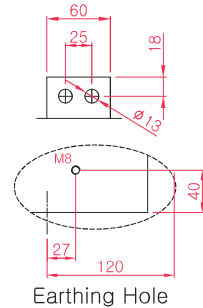

OSS-616-PC

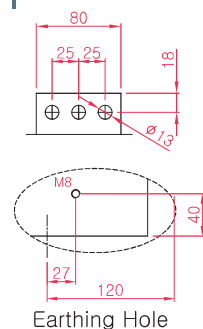

PC Type



ATS(800~6300A)





◆ Outline Dimension_ 외형도

2000~3200A Draw-out

Unit : mm

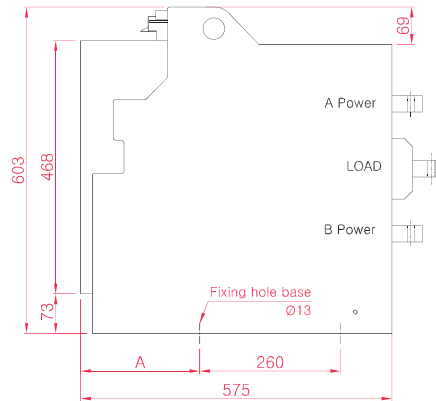
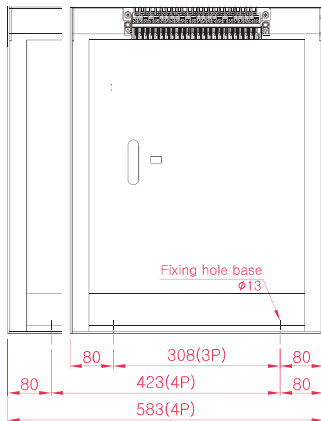


POSITION	A
CONNECTED	220
TEST	261
DISCONNECTED	290

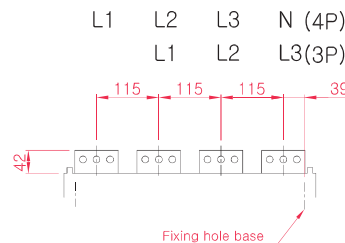
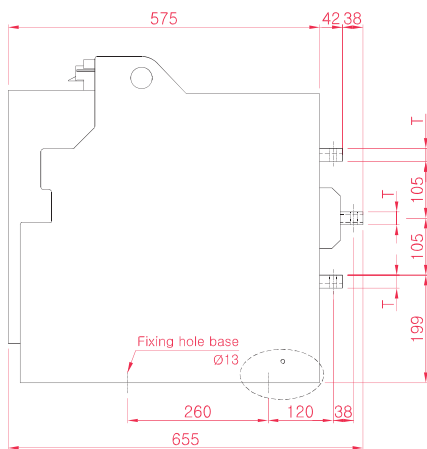


Current	T
2000A	15
2500A	24



OSS-620~625-PC



Earthing Hole

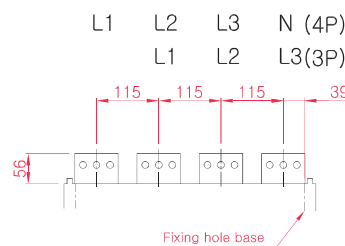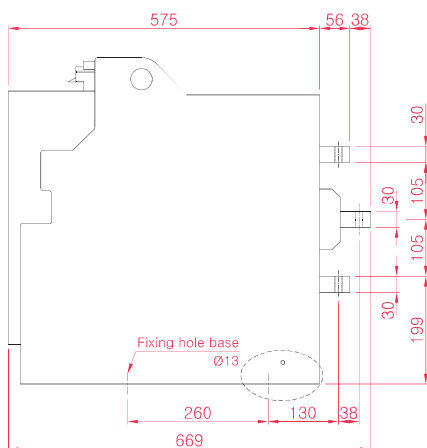

OSS-632-PC



Earthing Hole





ATS(800~6300A)





◆ Outline Dimension_ 외형도

4000~6300A Draw-out

Unit : mm



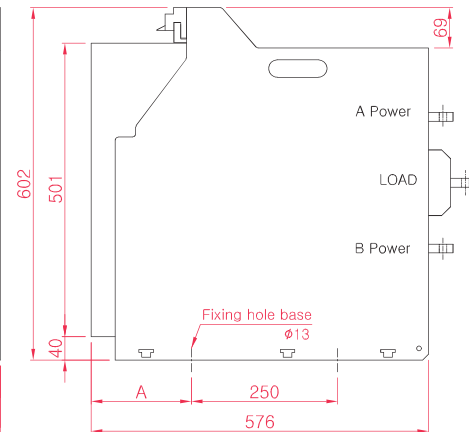
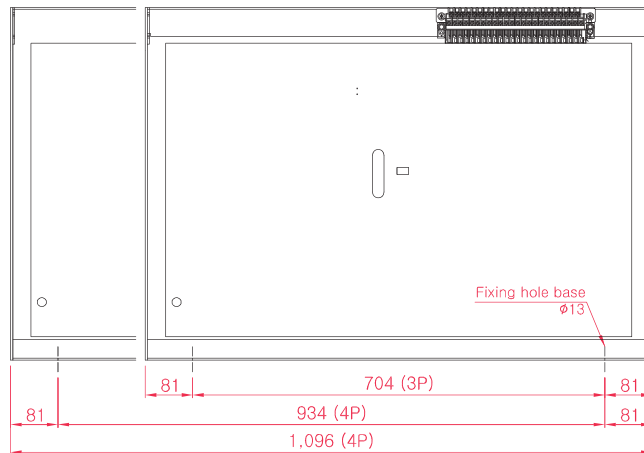


POSITION	A
CONNECTED	171
TEST	212
DISCONNECTED	241

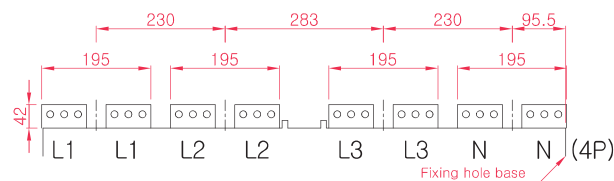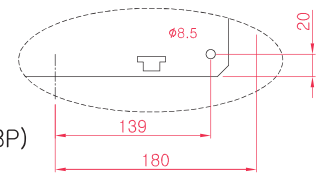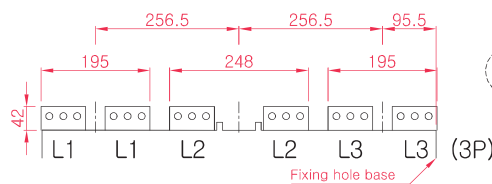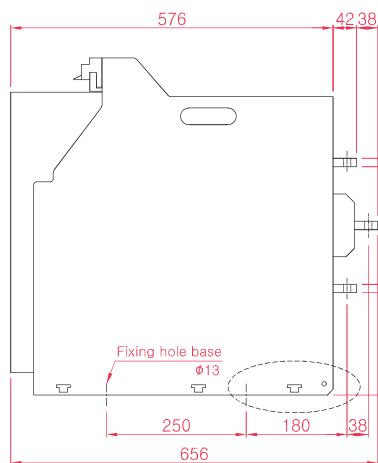

Earthing Hole

OSS-640-PC

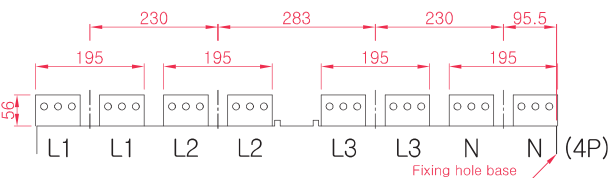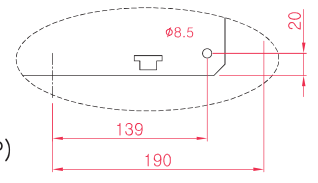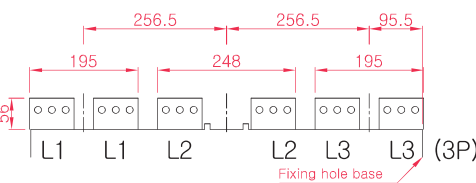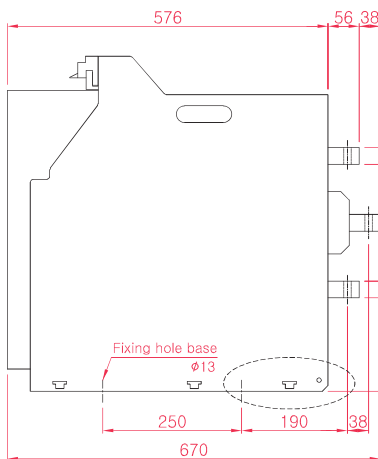

Earthing Hole

OSS-650~663-PC

PSO Type

ATS(630~6300A)



Information to Order_ 주문정보

OSS - 6 - PSO - - P -
A B C D

A Rated Current

06	08	10	12	16	20	25	32	40	50	63
630A	800A	1000A	1250A	1600A	2000A	2500A	3200A	4000A	5000A	6300A

B Connection (접속방식)

- F : Fixed (고정형)
- D : Draw-out (인출형)

C Number of Poles

- 4 : 4P

D Operating Voltage

- A1 : AC 110V ● D1 : DC 110V
- A2 : AC 220V ● D2 : DC 125V

Features_ 특징

In addition to every function of PC Type ATS, PSO Type ATS has additional function of Overlapping Neutral Contact. (2-Position ATS)

Function of Overlapping Neutral Contact

When general ATS will be transferred, Arc will be generated between fixed contacts and moving contacts. Thus, current flows between contacts and arc will be eliminated when current will be at zero level. Eliminating time of arc is 10~12ms. Therefore, various device of load side can be protected when neutral contacts should be opened 10~12ms later than other 3-phases contacts. Load side devices of general ATS cannot be sufficiently protected because opening time gap between neutral contacts and other 3-phases contacts is less than 10ms. In order to solve this problem, Overlapping between neutral contacts of A-power (Normal) and B-power (Emergency) during transfer of switch functions to protect various devices of load side more safely.

In addition, Non-linear load increases the earth potential and potential difference is occurred between earth and neutral line. When general ATS will be transferred, Neutral line is separated from load and reference potential difference cannot be established. Thus, Floating is occurred and electronic devices can be malfunctioned. When ATS with overlapping neutral contact will be applied, Floating can be protected.

PSO Type ATS는 PC Type ATS의 모든 기능에 N상 중첩 절체 기능을 추가로 가지고 있습니다. (2-Position ATS)

■ N상 중첩절체 기능

일반적인 절체 시 고정자와 가동자의 접점 사이에서 ARC가 발생하여 접촉자 간에 전류를 지속시키게 되며, ARC는 전류의 영점에서 사라져 없어지게 됩니다. 이때 ARC의 소멸시간은 대략 10~12ms 정도가 됩니다. 그러므로 중성 접점 (N상)은 다른 상상 (L1, L2, L3) 보다 10~12ms 후에 떨어져야 부하측의 각종 장비가 보호됩니다. 그러나 일반적인 ATS는 중성접점 (N상)과 다른 상상 (L1, L2, L3)의 시간차가 10ms 이내가 되므로 부하측의 설비를 보호하는데 다소 미흡하다 할 수 있습니다.


이러한 문제를 해결하기 위하여 상용전원의 중성접점과 예비전원의 중성접점을 중첩시켜 절체시킴으로써 보다 안전하게 부하측의 각종 장비를 보호할 수 있습니다.

또한 비선형 부하는 대지전위를 상승시켜 대지와 중성선 간에 전위차가 생기므로 일반적인 ATS는 절체 시 중성선이 부하측과 분리되어 기준전위가 확립되지 않아 플로팅 현상이 발생되어 전자장비의 오동작을 유발합니다. 그러므로 중첩절체 기능이 내장된 ATS를 사용함으로써 플로팅 현상을 예방할 수 있습니다.

Location Needed for Overlapping Neutral Contact (중첩절체기능을 필요로하는 장소)


- Broadcasting System and Telecommunication System (방송국 및 전신전화국)
- Military Communication System and Radar Facilities (군 통신 및 레이더 시설)
- Bank and Computer Center (은행 및 전산시설)
- Large Harmonic Load : Elevator & Escalator, etc.) (다량의 고조파 발생 부하 : 엘리베이터, 에스컬레이터 등)
- Arc Furnace (각종 전기로)
- Petrochemical Plant (석유화학 플랜트)

N-phase Transfer (N상 절체방식)

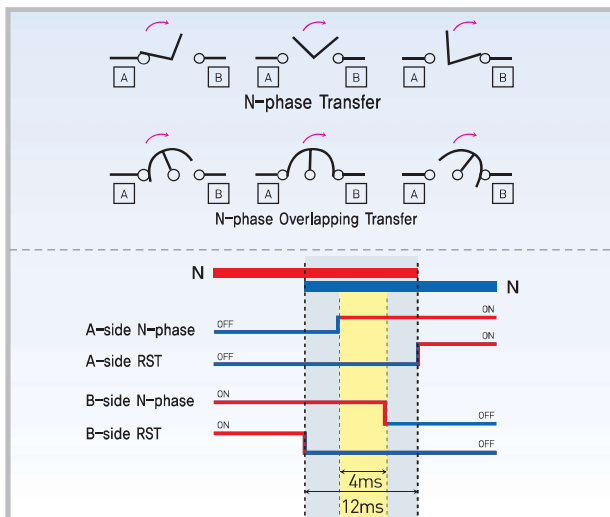


Limits of 4P Transfer (4Pole 절체시 문제점)

- Opening neutral wire is forbidden.
N상이 OPEN 안됨
- The neutral is the common reference to 3-phases.
N상은 3상의 기준이 됨.



- If N-phase will be opened, Ph/Ph voltage can go up to 400V.
For transfer of 4P, Overlapping of N-phase is necessary
N상이 Open되게 되면 상간전압이 400V까지 상승할 수 있음.
4Pole 절체 시 부분적인 N상이 중첩절체가 필요함.

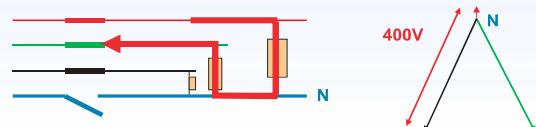



ATS(630~6300A)

◆ Specification_ 정격사양

TYPE		606-PSO	608-PSO	610-PSO	612-PSO	616-PSO
Rated Operational Voltage (정격사용전압)	Ue	AC 600 V				
Rated Insulation Voltage (정격절연전압)	Ui	AC 800 V				
Rated Current (정격전류)	Ie	630 A	800 A	1000 A	1250 A	1600 A
Neutral Phase Current (중성극전류)		630 A	800 A	1000 A	1250 A	1600 A
Kind of Throw (투수)		Double Throw (쌍투)				
Connection (접속방식)		Fixed (고정형), Draw-out (인출형)				
Number of Poles (극수)		4P				
Weight (중량 : kg)	Fixed (고정)	70	75	80	85	
	Draw-out (인출)	100	105	115	120	
Rated Short-Time Withstand Current (정격 단시간 내전류)	Icw	25 kA			30 kA	35 kA
Rated Short-Circuit Making Capacity (단락 투입 전류) peak	Icm	52.5 kA			63 kA	73.5 kA
Switching Capacity (개폐용량)		AC -33B				
Switching Frequency (개폐빈도)		60 Time / Hour			20 Time / Hour	
Operating Current (조작전류) peak	DC 110V ~ 125V	45 A			50 A	
	AC 100V ~ 110V	45 A			50 A	
	AC 200V ~ 240V	30 A			40 A	
Operating Time (동작시간)	Operating Transfer Time	AC Control ≤ 150 ms / DC Control ≤ 180 ms				
	Opening Time	AC Control ≤ 120 ms / DC Control ≤ 150 ms				
	Contact Transfer Time	≤ 30 ms				
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)	10,000				
	With Current (통전)	5,000				
Cautions (주의사항)		1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작 지령 시 코일 소손의 원인이 됩니다.				

TYPE		620-PSO	625-PSO	632-PSO	640-PSO	650-PSO	663-PSO	
Rated Operational Voltage (정격사용전압)		Ue	AC 600 V					
Rated Insulation Voltage (정격절연전압)		Ui	AC 800 V					
Rated Current (정격전류)		Ie	2000 A	2500 A	3200 A	4000 A	5000 A	6300 A
Neutral Phase Current (중성극전류)			2000 A	2500 A	3200 A	4000 A	5000 A	6300 A
Kind of Throw (투수)			Double Throw (쌍투)					
Connection (접속방식)			Fixed (고정형), Draw-out (인출형)					
Number of Poles (극수)			4P					
Weight (중량 : kg)	Fixed (고정)		115	123	133	203	235	235
	Draw-out (인출)		180	203	217	330	400	400
Rated Short-Time Withstand Current (정격 단시간 내전류)		Icw	40 kA	50 kA		65 kA		
Rated Short-Circuit Making Capacity (단락 투입 전류) peak		Icm	84 kA	105 kA		143 kA		
Switching Capacity (개폐용량)			AC -33B					
Switching Frequency (개폐빈도)			10Time / Hour					
Operating Current (조작전류) peak	DC 110V ~ 125V		65 A			90 A		
	AC 100V ~ 110V		65 A			90 A		
	AC 200V ~ 240V		50 A			65 A		
Operating Time (동작시간)	Operating Transfer Time		AC Control ≤ 150 ms / DC Control ≤ 180 ms					
	Opening Time		AC Control ≤ 120 ms / DC Control ≤ 150 ms					
	Contact Transfer Time		≤ 25 ms					
Number of Operating Cycles (정격 개폐 회수)	Without Current (무통전)		5,000			3,000		
	With Current (통전)		3,000			1,500		
Cautions (주의사항)			1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작 지령 시 코일 소손의 원인이 됩니다.					

PSO Type




ATS(630~6300A)





◆ Outline Dimension_ 외형도

630~1600A Fixed


Unit : mm

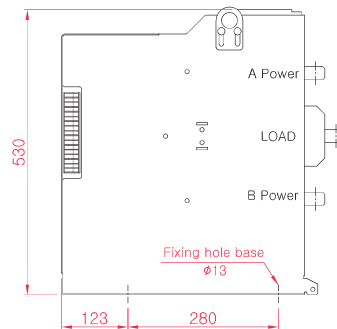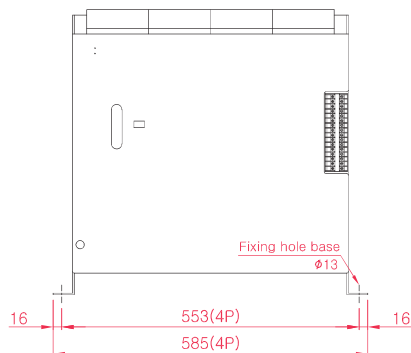

Panel cutting
(Fixing hole)

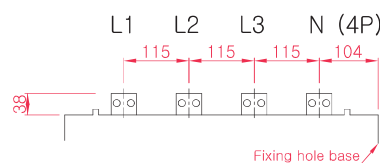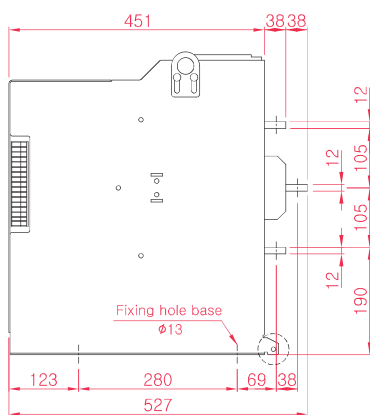


OSS-606~610-PSO

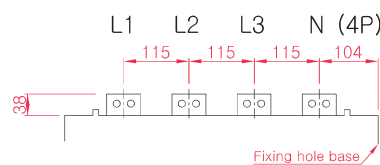


OSS-612-PSO


OSS-606~612-PSO





OSS-606~610-PSO





OSS-612-PSO



Earthing Hole

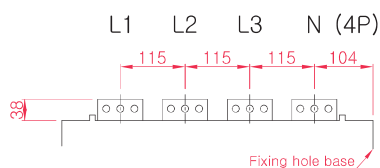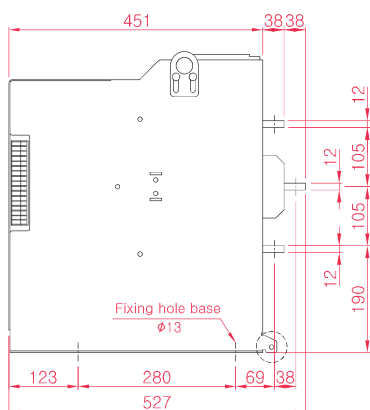

OSS-616-PSO



Earthing Hole






ATS(630~6300A)




◆ Outline Dimension_ 외형도

2000~3200A Fixed


Unit : mm

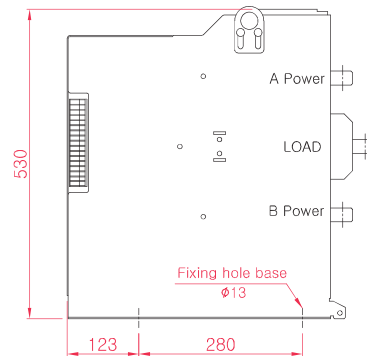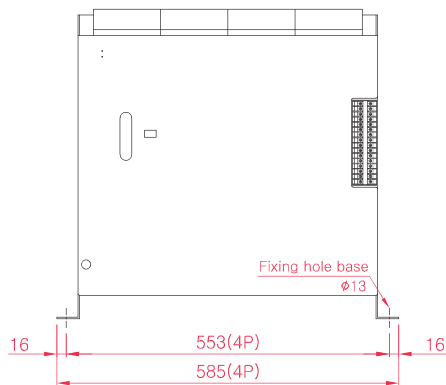





Panel cutting
(Fixing hole)

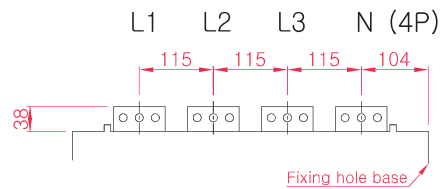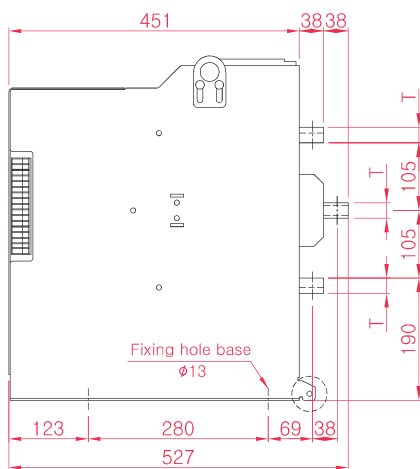

Current	T
2000A	15
2500A	24



Earthing Hole

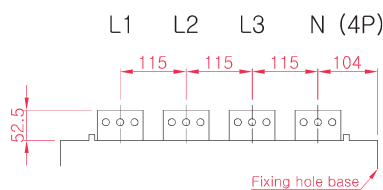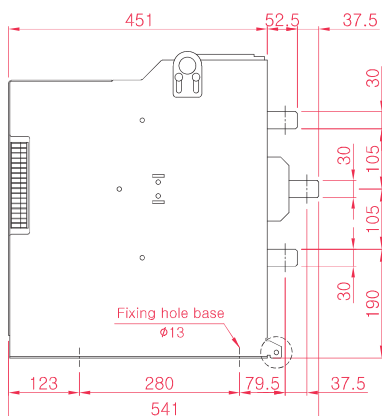

Earthing Hole

PSO Type



ATS(630~6300A)






◆ Outline Dimension_ 외형도

4000~6300A Fixed



Unit : mm

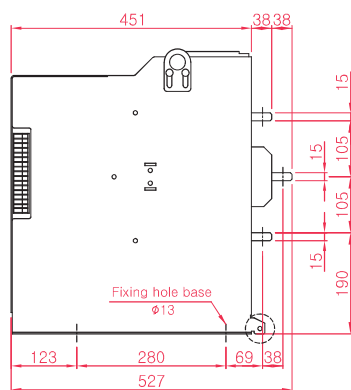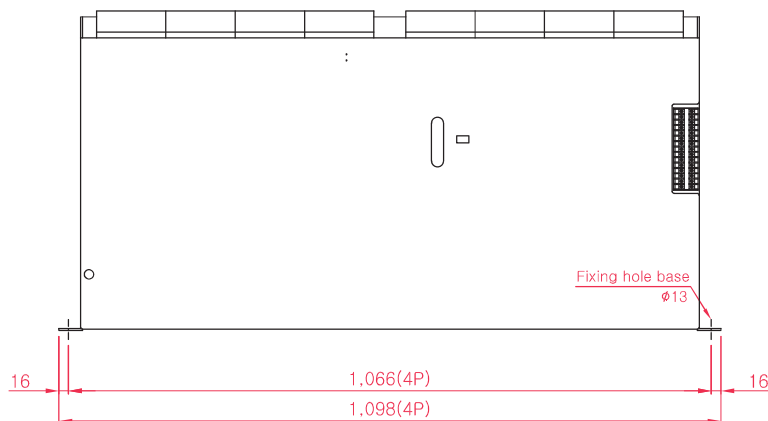



OSS-640-PSO

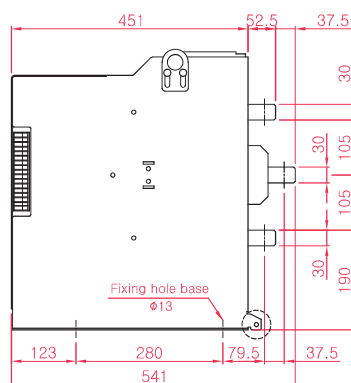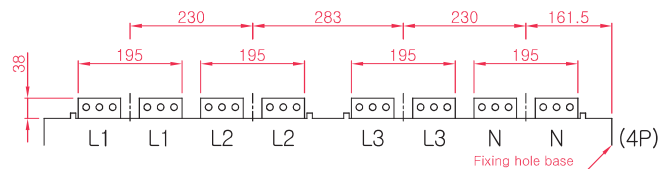

OSS-650~663-PSO

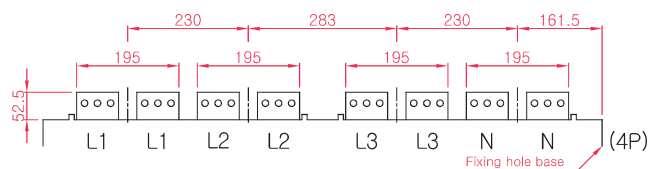

Panel cutting (Fixing hole)

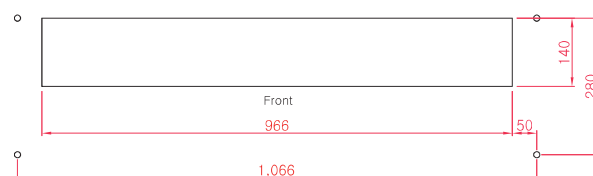

PSO Type

Automatic Transfer Switches 34 | 35



ATS(630~6300A)






◆ Outline Dimension_ 외형도

630~1600A Draw-out






Unit : mm

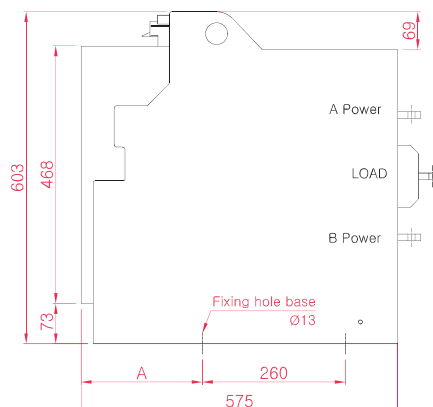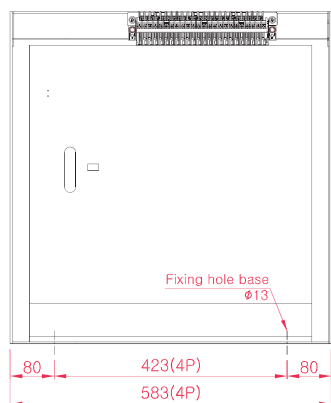



POSITION	A
CONNECTED	220
TEST	261
DISCONNECTED	290

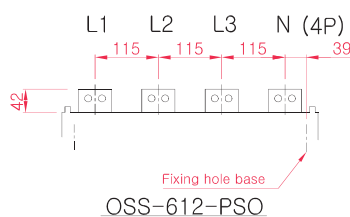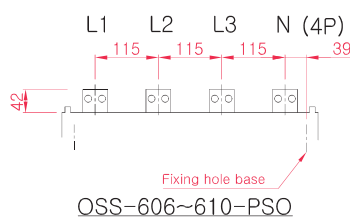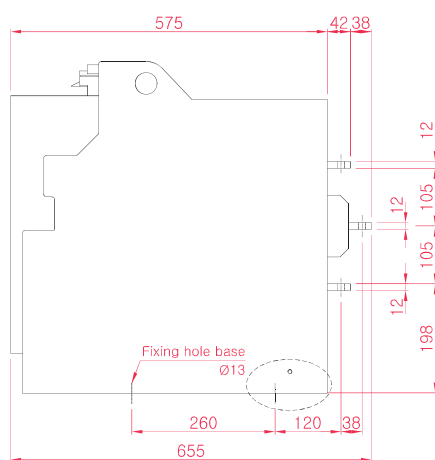

OSS-606~612-PSO

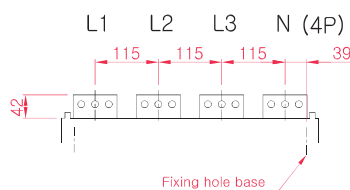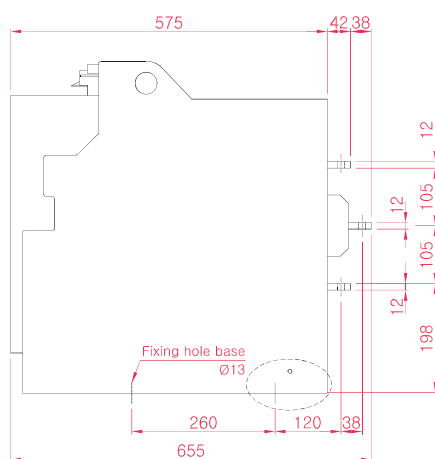

OSS-616-PSO



PSO Type



ATS(630~6300A)





◆ Outline Dimension_ 외형도

2000~3200A Draw-out

Unit : mm

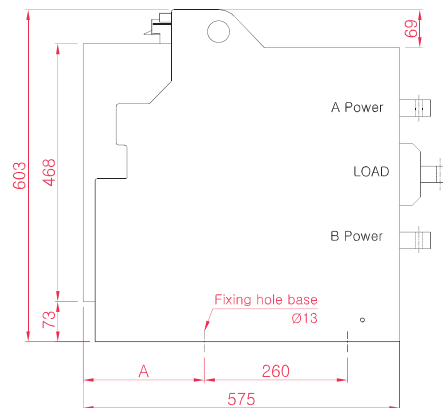
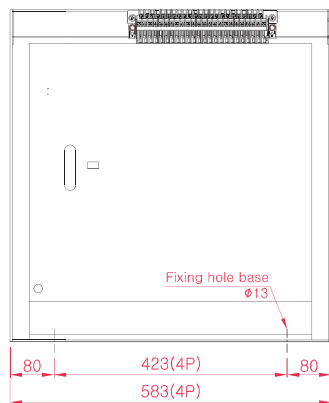


POSITION	A
CONNECTED	220
TEST	261
DISCONNECTED	290

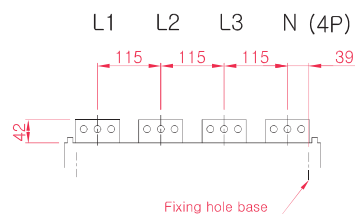
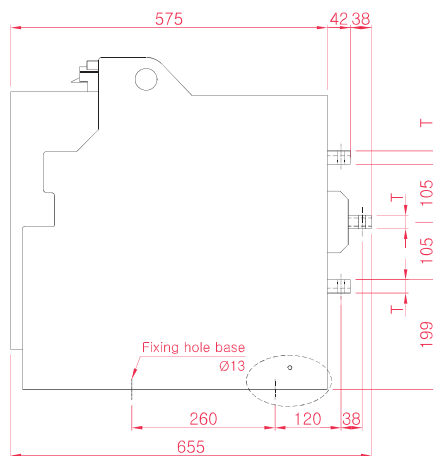


Current	T
2000A	15
2500A	24



OSS-620~625-PSO



Earthing Hole

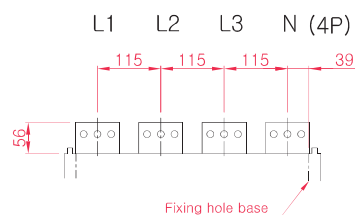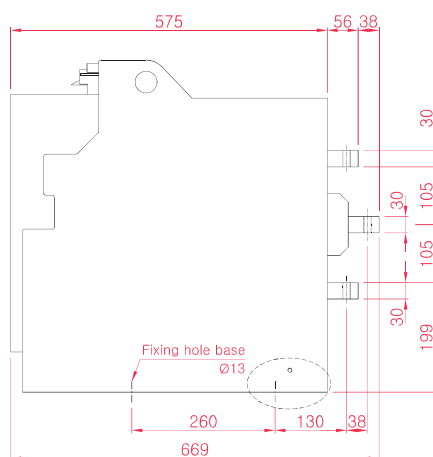

OSS-632-PSO





Earthing Hole



◆ Outline Dimension_ 외형도





4000~6300A Draw-out

Unit : mm

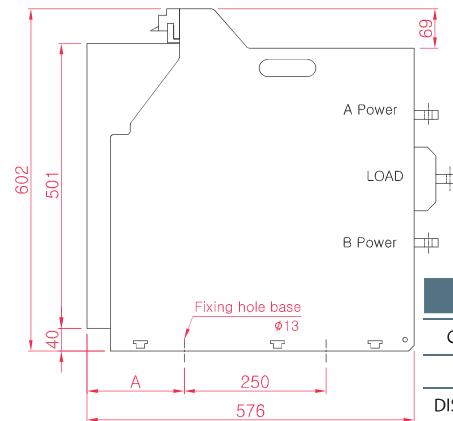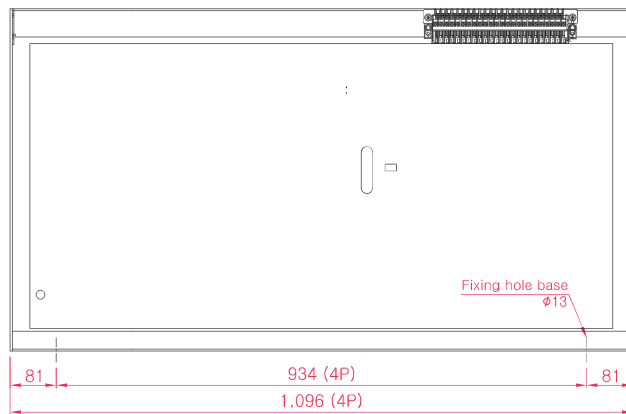





POSITION	A
CONNECTED	171
TEST	212
DISCONNECTED	241

OSS-640-PSO

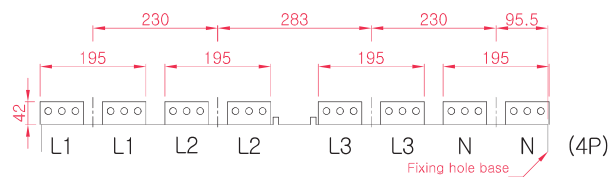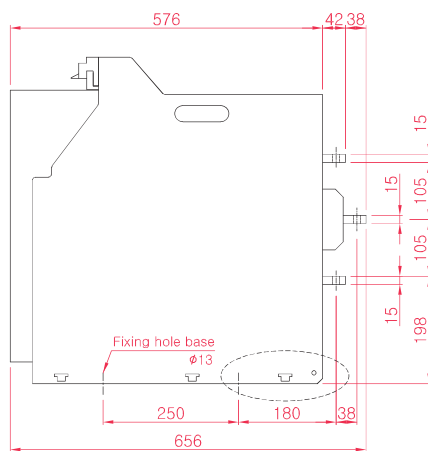

Earthing Hole

OSS-650~663-PSO

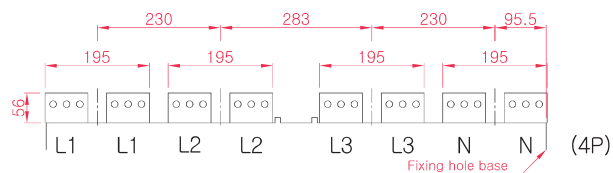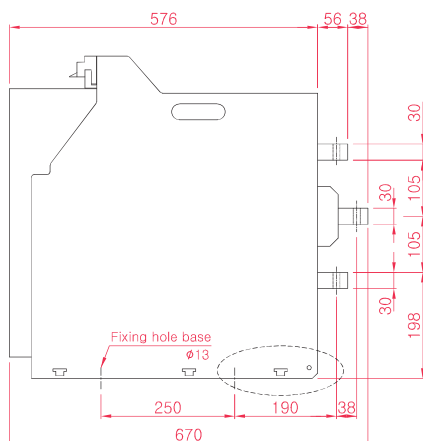

Earthing Hole


PC, PSO Type

ATS(630~6300A)




Circuit Diagram (회로도)

Control Voltage AC

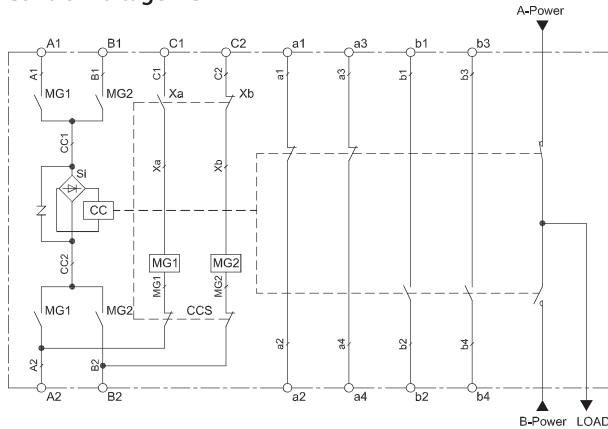


Control Voltage DC

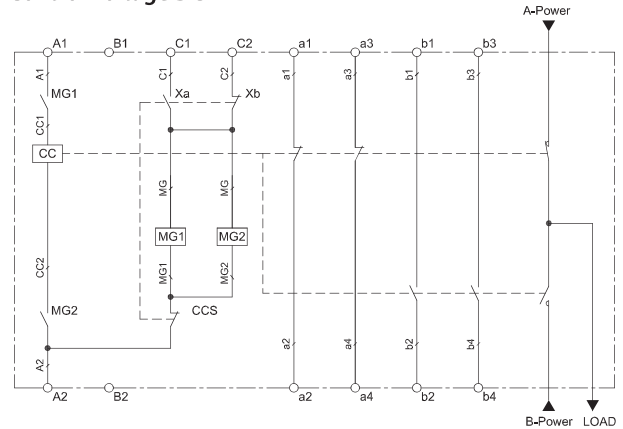


A1, A2	A-Power Terminal (Control Power Input)	a1 ~ a4	A-Power Indication Contacts
B1, B2	A-Power Terminal (Control Power Input)	b1 ~ b4	B-Power Indication Contacts
C1	A-Power Closing Terminal	MG1, MG2	Closing Magnetic Contacts
C2	B-Power Closing Terminal	CCS	Closing Control Switch
CC	Closing coil	Si	Silicon Rectifier

Wiring Diagram (결선도)

Control Voltage AC

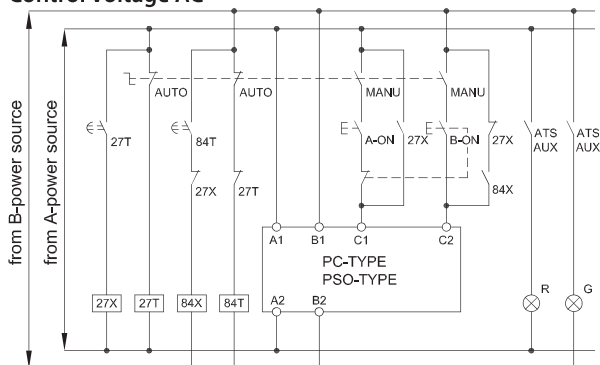

Control Voltage DC

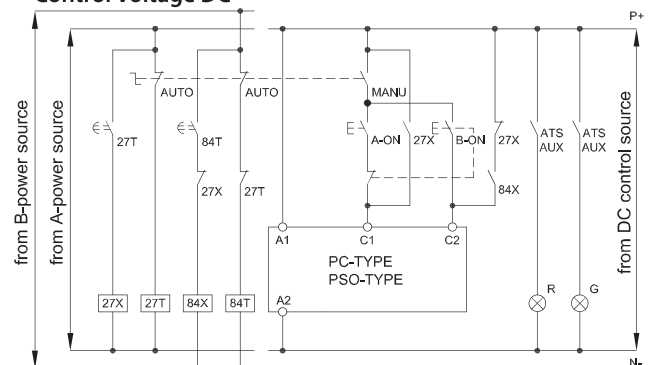

27X	Source-A Operating Relay	84X	Source-B Operating Relay
27T	27X Operating Delay Timer	84T	84X Operating Delay Timer
AUTO	Automatic Operation	MANU	Manual Operation

Caution) More than 2.5mm² power cable used for 1600A ATS or less.
More than 4.0mm² power cable used for 2000A ATS or over.
More than 6.0mm² power cable used for 4000A ATS or over.

주의) ATS 1600A 이하 사용 시 전선의 굵기는 2.5mm² 이상 사용합니다.
ATS 2000A 이상 사용 시 전선의 굵기는 4.0mm² 이상 사용합니다.
ATS 4000A 이상 사용 시 전선의 굵기는 6.0mm² 이상 사용합니다.



ATS(800~6300A)

◆ Information to Order_ 주문정보

OSS - 6 - PCN - - P -

A B C D

A Rated Current

08	10	12	16	20	25	32	40	50	63
800A	1000A	1250A	1600A	2000A	2500A	3200A	4000A	5000A	6300A

B Connection (접속방식)

- F : Fixed (고정형)
- D : Draw-out (인출형)


C Number of Poles

- 3 : 3P
- 4 : 4P

D Operating Voltage

- A1 : AC 110V ● D1 : DC 110V
- A2 : AC 220V ● D2 : DC 125V

◆ External View_ 외관명칭

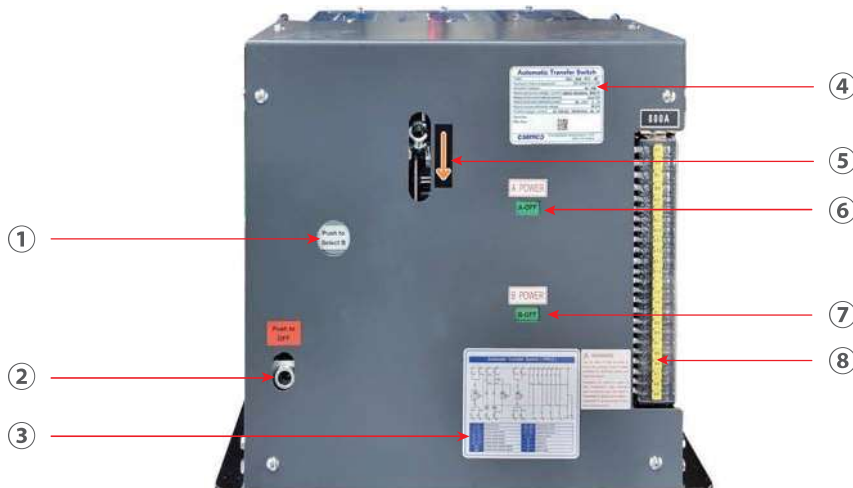

① Selective Button for "B"-Power Closing (B전원 투입 선택 버튼)	⑤ Manual Lever Inlet for Closing (투입용 수동 레버 삽입구)
② Manual Lever Inlet for Trip (트립용 수동 레버 삽입구)	⑥ "A"-Power ON/OFF Indicator (A전원 동작 표시기)
③ Circuit Diagram (회로도)	⑦ "B"-Power ON/OFF Indicator (B전원 동작 표시기)
④ Name Plate (명판)	⑧ Terminal Block (단자대)

◆ Features_ 특징

Neutral position stop method (3-Position ATS)

In case UPS is applied, It is available to transfer to neutral position by tripping mechanism after checking circuit stability and safety instantaneous transfer as follows. A ⇒ Off ⇒ B, B ⇒ Off ⇒ A and A ⇒ Off ⇒ A, B ⇒ Off ⇒ B instantaneous transfer can be available also by operating signal.

Sufficient contact capacity against accidental current.
(20 times of operating current)

On-load break and make type.

Easy busbar arrangement.

Prevent the simultaneous closing by complete mechanical and electrical tripping mechanism

Current carrying capacity of N-phase is 100% same as other phases.

Last Break, 1st make Neutral contact

See page 65 for calculation of TR capacity for operation.

■ 중단정지 방식 (3-Position ATS)

무정전 전원장치가 있는 경우 정전 또는 복전 시 긴급 절체되는 것 보다는 회로의 안정 및 선로의 안전을 확인한 후 절체할 수 있는 방식으로 트립장치에 의해 중단위치(OFF)가 가능합니다.

A ⇒ Off ⇒ B, B ⇒ Off ⇒ A and A ⇒ Off ⇒ A, B ⇒ Off ⇒ B 또한 조작 지령에 의해 긴급 절체도 가능합니다.

■ 사고전류(20배)에 대비한 충분한 접점 설계

■ 부하개폐 가능한 ON-LOAD TYPE ATS

■ 부스바 작업 간편

■ 완벽한 기계적, 전기적 트립 설계로 혼촉사고 방지

■ 전 기종 N상, 통전용량 100% 구현 (N상 동일)

■ N상 선투입 후개방 개폐 구조

■ 조작용 TR 용량 선정은 65 페이지 참조



TYPE			625-PCN		632-PCN		640-PCN		650-PCN		663-PCN			
Rated Operational Voltage (정격사용전압)			Ue		AC 600 V									
Rated Insulation Voltage (정격 절연 전압)			Ui		AC 800 V									
Rated Impulse Withstand Voltage (정격 임펄스 내전압)			Uimp		AC 8000 V									
Rated Current (정격전류)			Ie		2500 A		3200 A		4000 A		5000 A		6300 A	
Neutral Phase Current (중성극전류)					2500 A		3200 A		4000 A		5000 A		6300 A	
Kind of Throw (투수)			Double Throw (쌍투)											
Connection (접속방식)			Fixed (고정형), Draw-out (인출형)											
Number of Poles (극수)					3P	4P	3P	4P	3P	4P	3P	4P	3P	4P
Weight (중량 : kg)		Fixed (고정)			100	130	105	138	175	217	200	250	200	250
		Draw-out (인출)			176	210	180	234	275	340	350	410	350	410
Rated Short-Time Withstand Current (정격 단시간 내전류)			Icw		50 kA		50 kA		65 kA		65 kA		65 kA	
Rated Short-Circuit Making Capacity (단락 투입 전류)			peak Icm		105 kA		105 kA		143 kA		143 kA		143 kA	
Switching Capacity (개폐용량)			AC -33B											
Switching Frequency (개폐빈도)			10 Time / Hour											
Operating Current (조작전류) peak		DC 110V ~ 125V	60 A					100 A						
		AC 100V ~ 110V	60 A					100 A						
		AC 200V ~ 240V	30 A					50 A						
		Trip Coil Current(트립전류)		DC 110V = 20 A , AC 220 V = 12 A										
Operating Time (동작시간)		“A” Power	Making	≤ 150 ms					≤ 150 ms					
			Breaking	≤ 45 ms					≤ 65 ms					
		“B” Ppower	Making	≤ 200 ms					≤ 200 ms					
			Breaking	≤ 45 ms					≤ 65 ms					
Number of Operating Cycles (정격 개폐 회수)		Without Current (무통전)		5,000					3,000					
		With Current (통전)		3,000					1,500					
Cautions (주의사항)					1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작 지령 시 코일 소손의 원인이 됩니다.									





ATS(800~6300A)


◆ Outline Dimension_ 외형도

800~1600A Fixed


Unit : mm

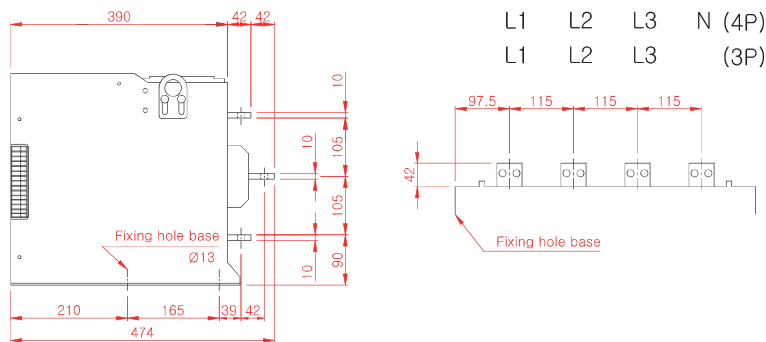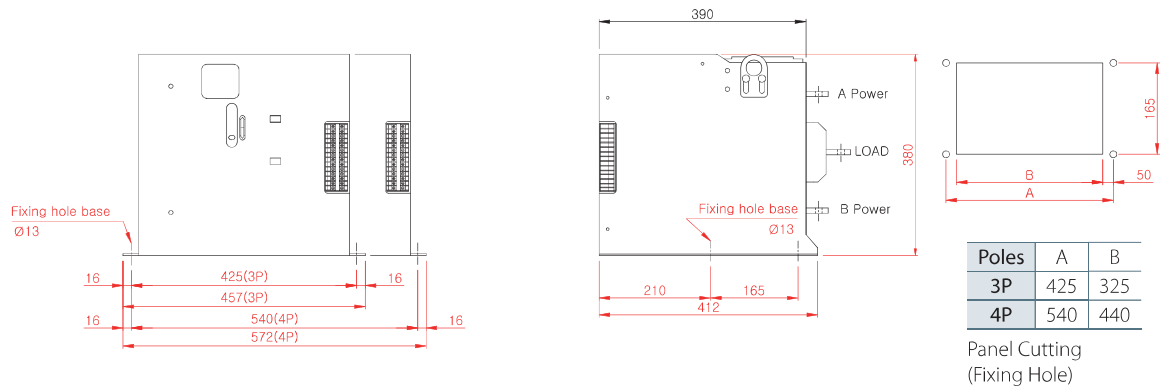

OSS-608~610-PCN

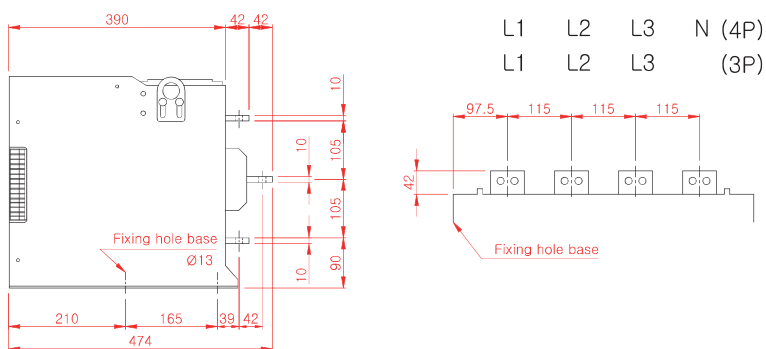

OSS-612-PCN

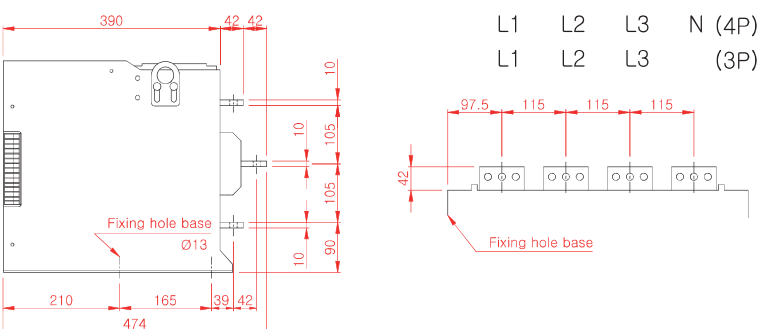

OSS-616-PCN






PCN Type

ATS(800~6300A)

◆ Outline Dimension_ 외형도




2000~3200A Fixed

Unit : mm

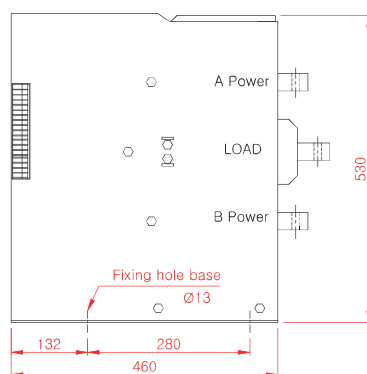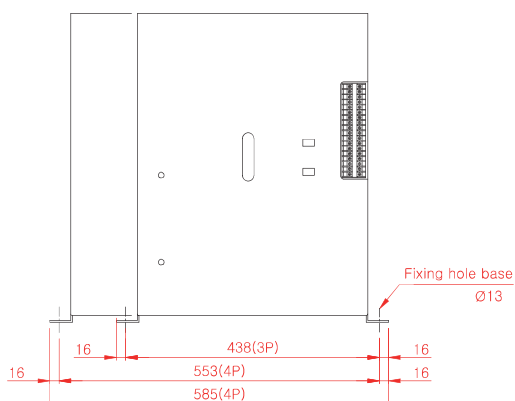




Poles	A	B
3P	438	338
4P	553	453

Panel Cutting
(Fixing Hole)

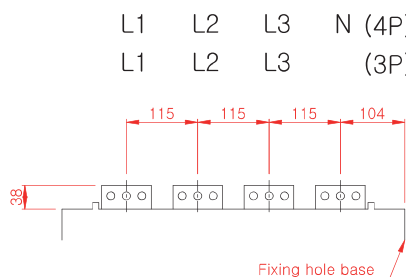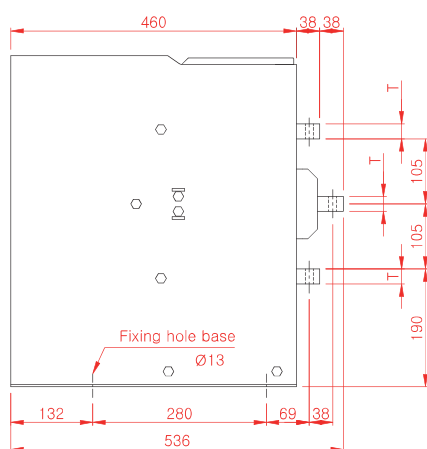

OSS-620~625-PCN

Current	T
2000A	15
2500A	24

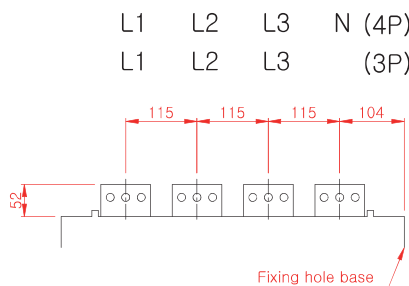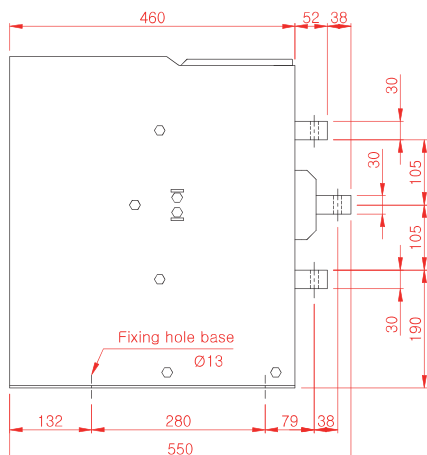


OSS-632-PCN




◆ Outline Dimension_ 외형도

4000~6300A Fixed


Unit : mm

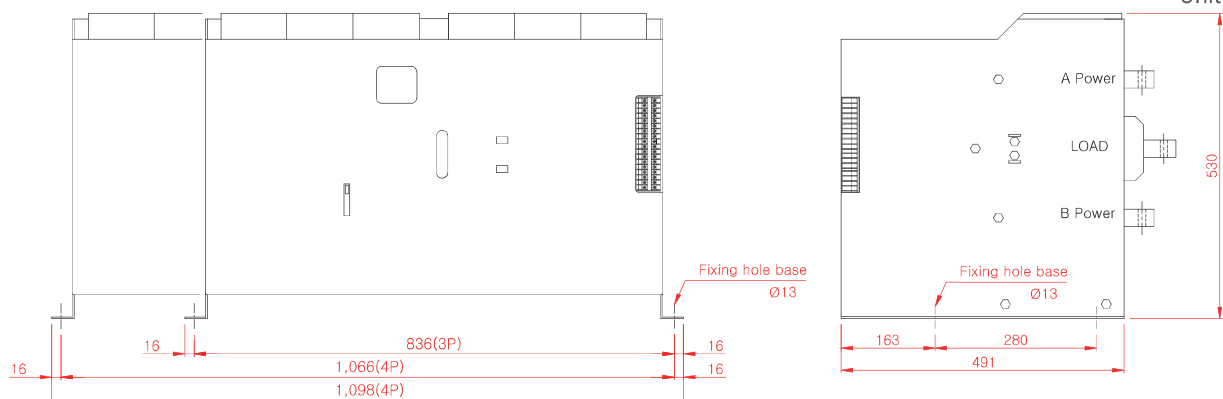


OSS-640-PCN

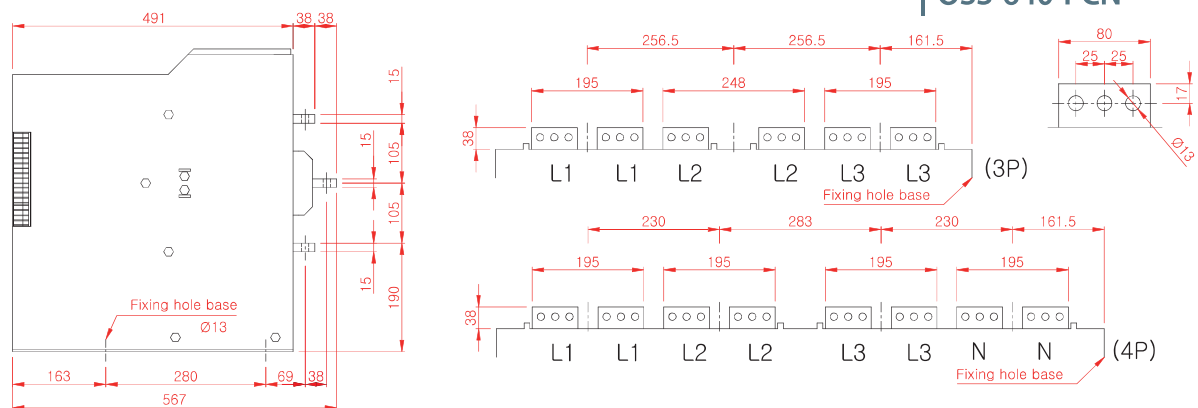

OSS-650~663-PCN

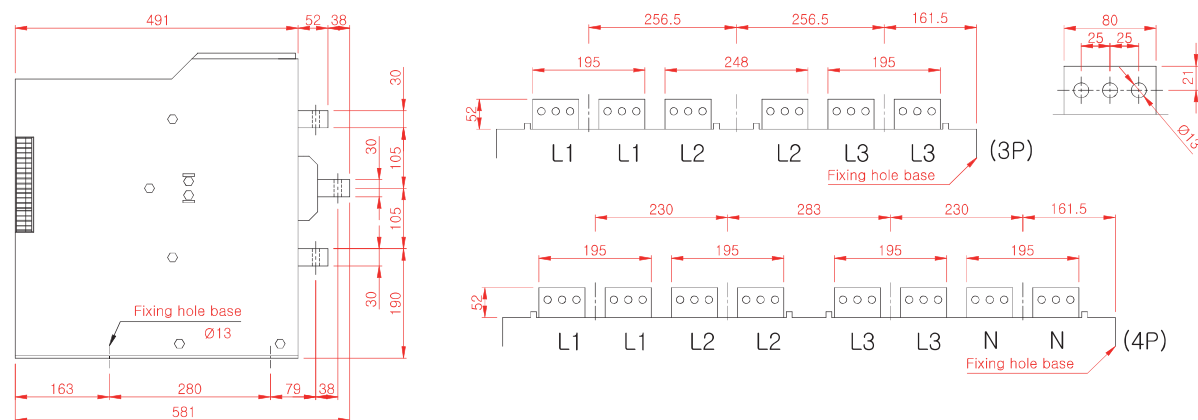

Panel cutting (Fixing hole)

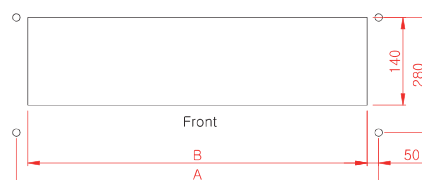

Poles	A	B
3P	836	736
4P	1066	966





PCN Type

ATS(800~6300A)



◆ Outline Dimension_ 외형도

800~1600A Draw-out




Unit : mm

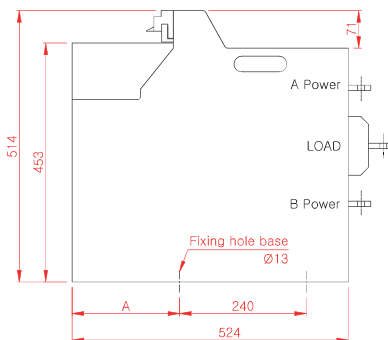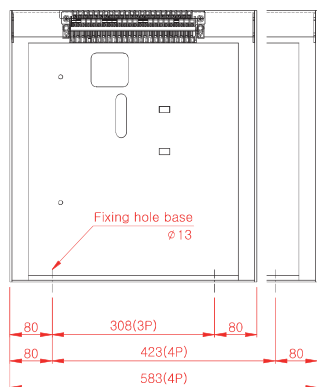




POSITION	A
CONNECTED	188
TEST	229
DISCONNECTED	258

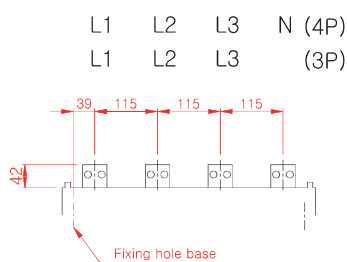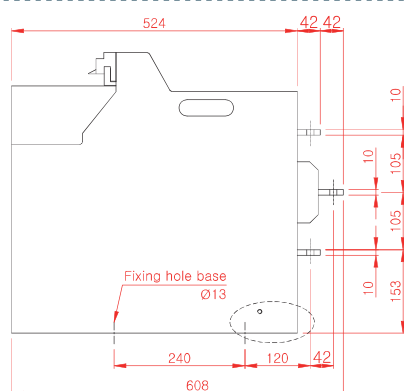


OSS-608~610-PCN

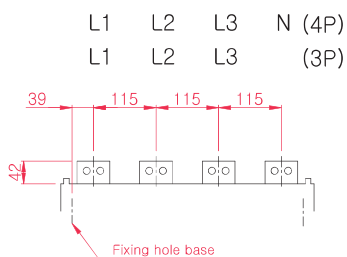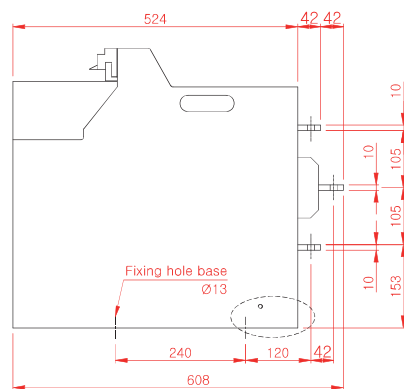

OSS-612-PCN

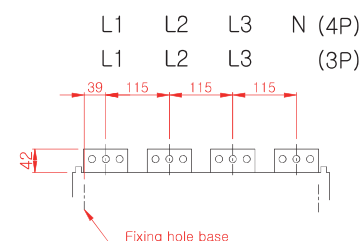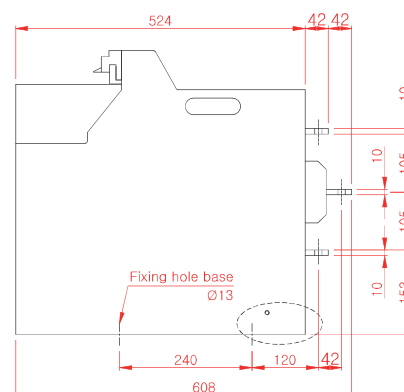

OSS-616-PCN

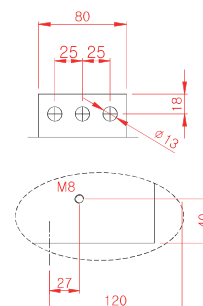





ATS(800~6300A)



◆ Outline Dimension 외형도

2000~3200A Draw-out


Unit : mm

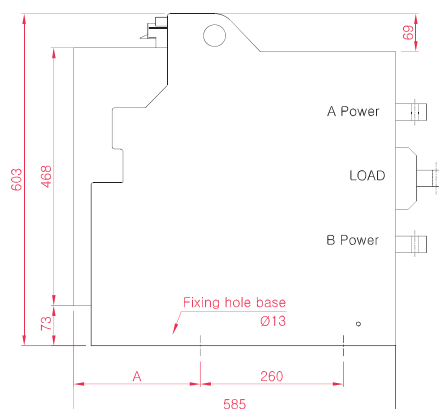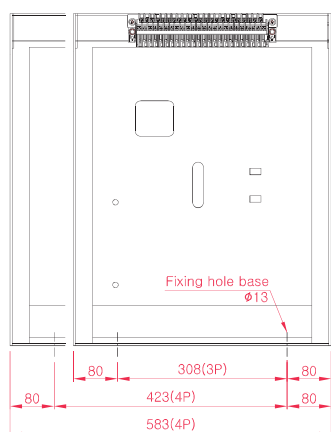




POSITION	A
CONNECTED	230
TEST	271
DISCONNECTED	300

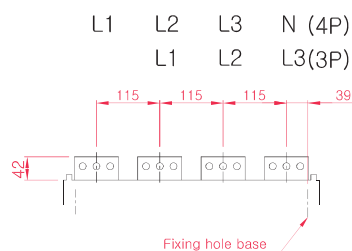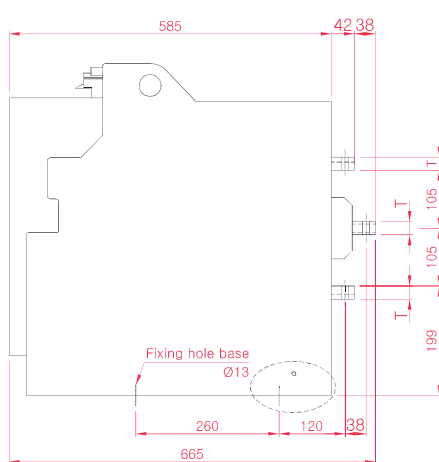

Current	T
2000A	15
2500A	24

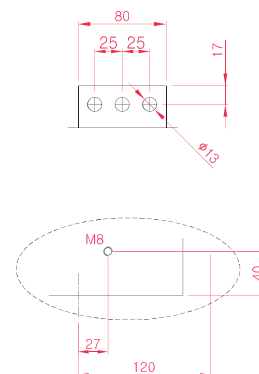

Earthing Hole

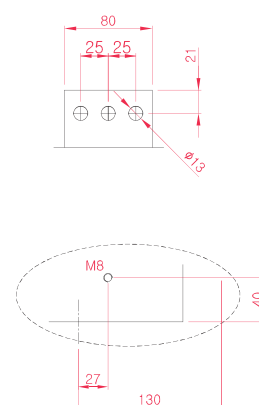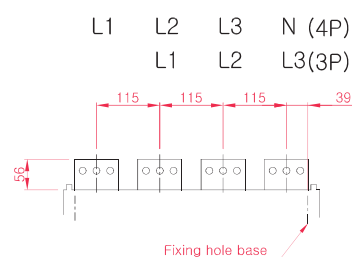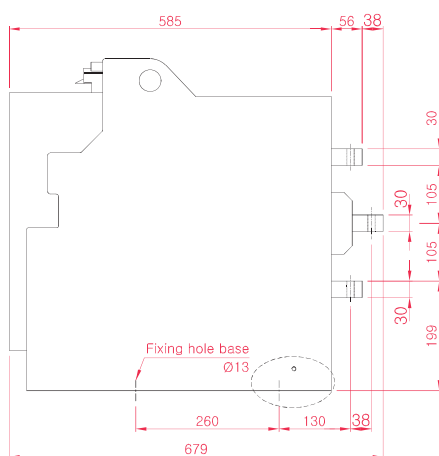

Earthing Hole





PCN Type

ATS(800~6300A)

◆ Outline Dimension_ 외형도



4000~6300A Draw-out

Unit : mm

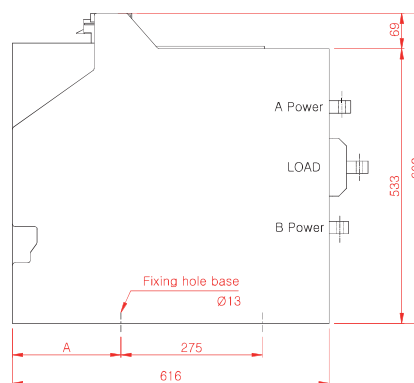
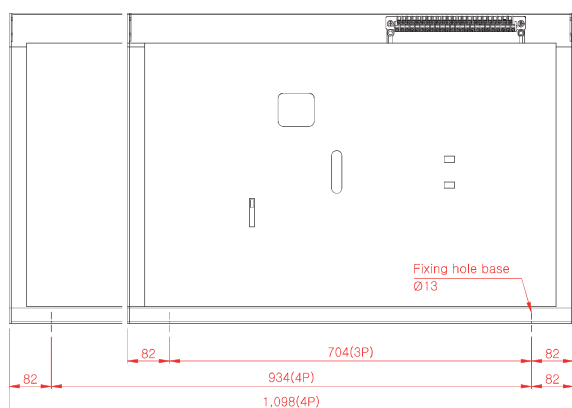


POSITION	A
CONNECTED	211
TEST	252
DISCONNECTED	281

OSS-640-PCN

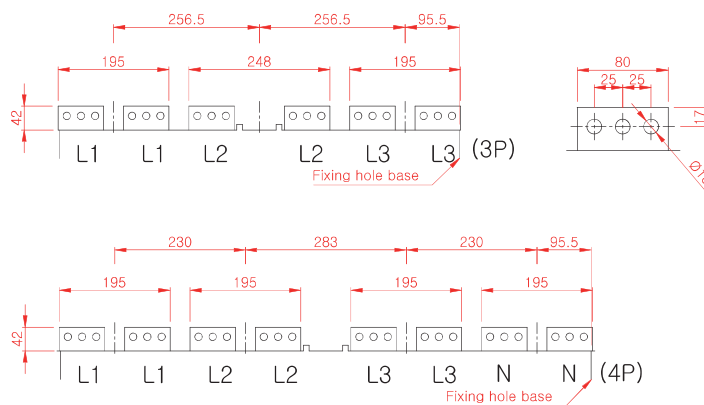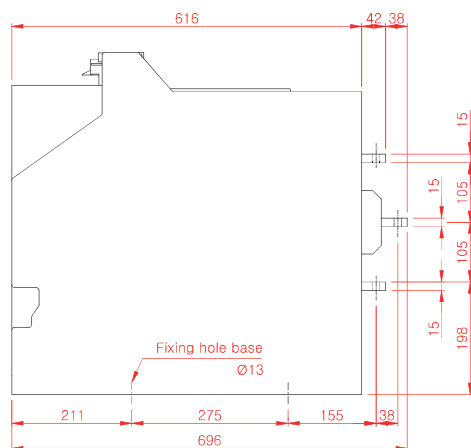

OSS-650~663-PCN

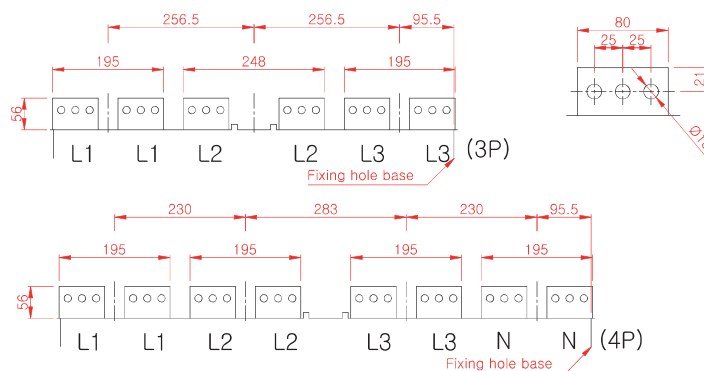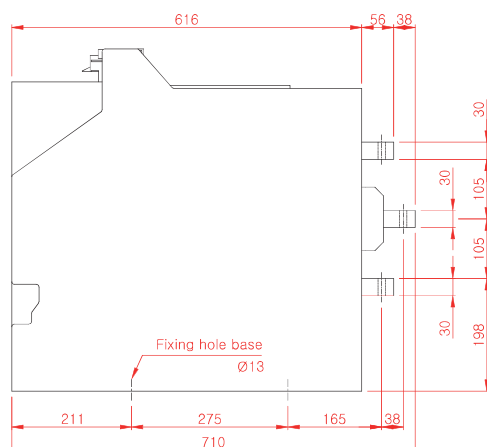





ATS(800~6300A)

AC Circuit Diagram (AC 회로도) Fixed

800A ~ 1600A

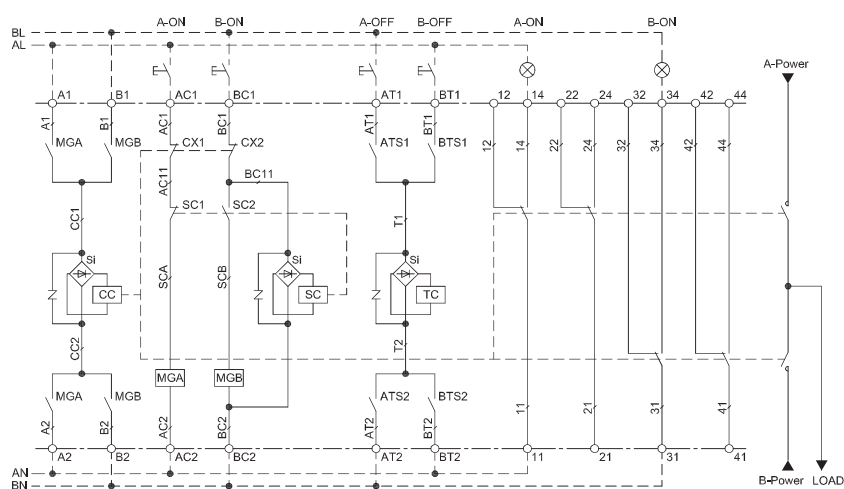

2000A ~ 6300A

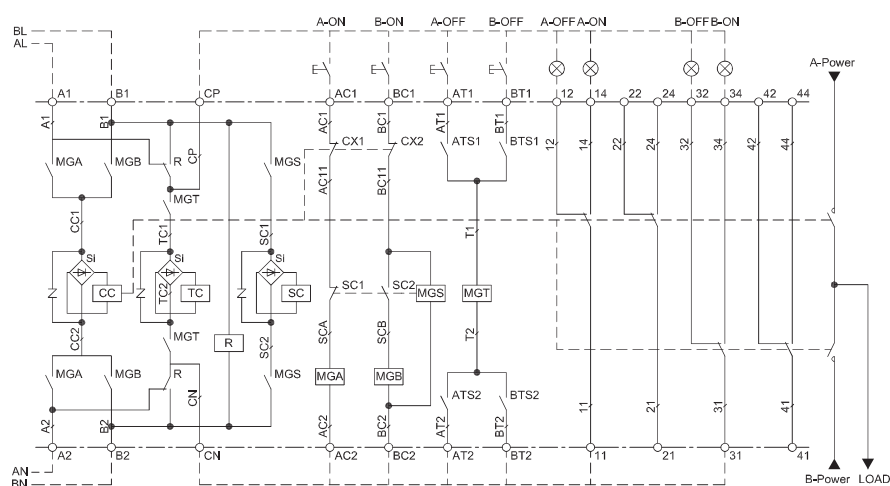

A1, A2	A-Power Terminal	MGA	A-Power Closing Magnetic Contactor
B1, B2	B-Power Terminal	MGB	B-Power Closing Magnetic Contactor
AC1, AC2	A-Power Closing Terminal	MGT	Tripping Magnetic Contactor
BC1, BC2	B-Power Closing Terminal	MGS	Selective Relay
AT1, AT2	A-Power Tripping Terminal	ATS, BTS	Closing Control Switch
BT1, BT2	B-Power Tripping Terminal	ATS1, ATS2	Tripping Control Switch
CC	Closing Coil	SC1, SC2	Selective Control Switch
TC	Tripping Coil	11 ~ 44	Indication Contacts
SC	Selective Coil	R	Source Selection Relay


PCN Type

ATS(800~6300A)




AC Circuit Diagram (AC 회로도) Draw-out

800A ~ 1600A

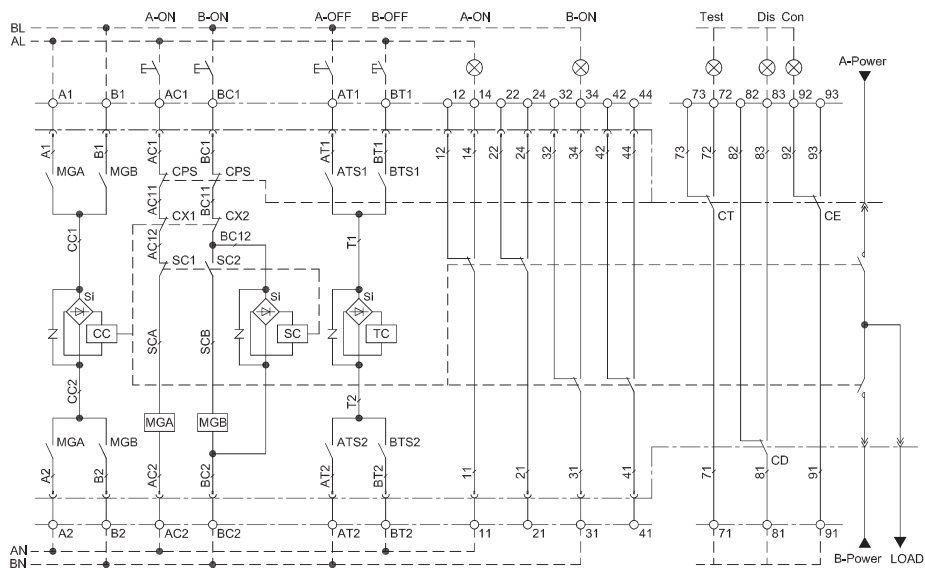

2000A ~ 6300A

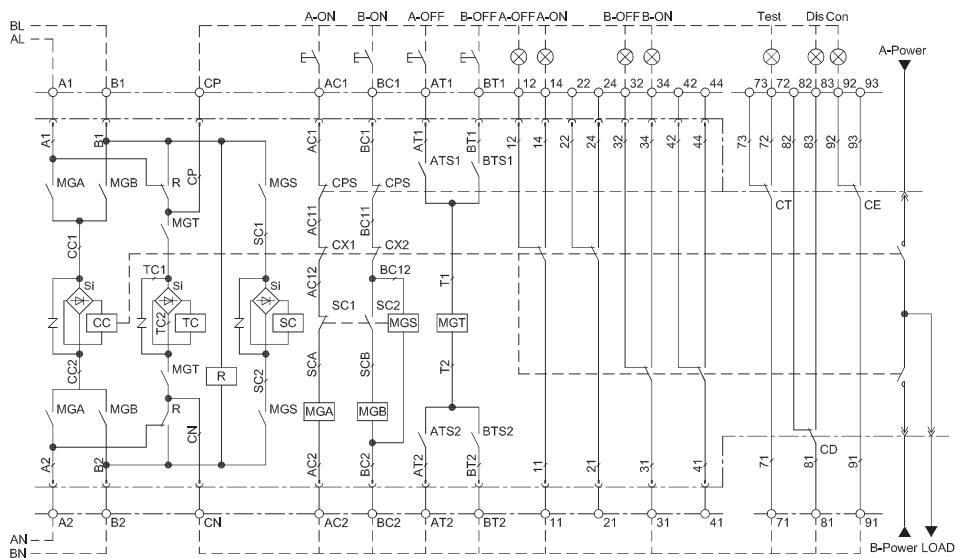


A1, A2	A-Power Terminal	MGA	A-Power Closing Magnetic Contactor
B1, B2	B-Power Terminal	MGB	B-Power Closing Magnetic Contactor
AC1, AC2	A-Power Closing Terminal	MGT	Tripping Magnetic Contactor
BC1, BC2	B-Power Closing Terminal	MGS	Selective Relay
AT1, AT2	A-Power Tripping Terminal	R	Source Selection Relay
BT1, BT2	B-Power Tripping Terminal	CPS	Closing Preventing Switch
CC	Closing Coil	CX1, CX2	Closing Control Switch
TC	Tripping Coil	ATS, AT5	Tripping Control Switch
SC	Selective Coil	SC1, SC2	Selective Control Switch
11 ~ 24	A-Power Indication Contacts	CT	Contacts for Test Position (Option)
31 ~ 44	B-Power Indication Contacts	CD	Contacts for Disconnected Position (Option)
Si	Silicon Rectifier	CE	Contacts for Connected Position (Option)




ATS(800~6300A)

DC Circuit Diagram (DC 회로도) 800 ~ 6300A

Fixed

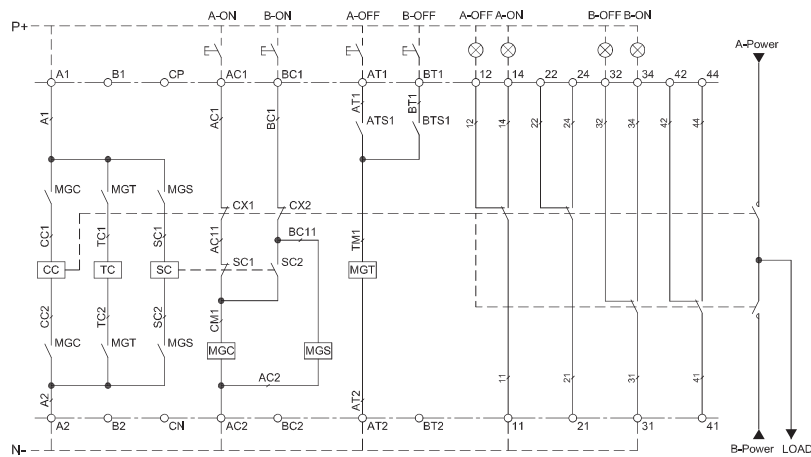

Draw-out

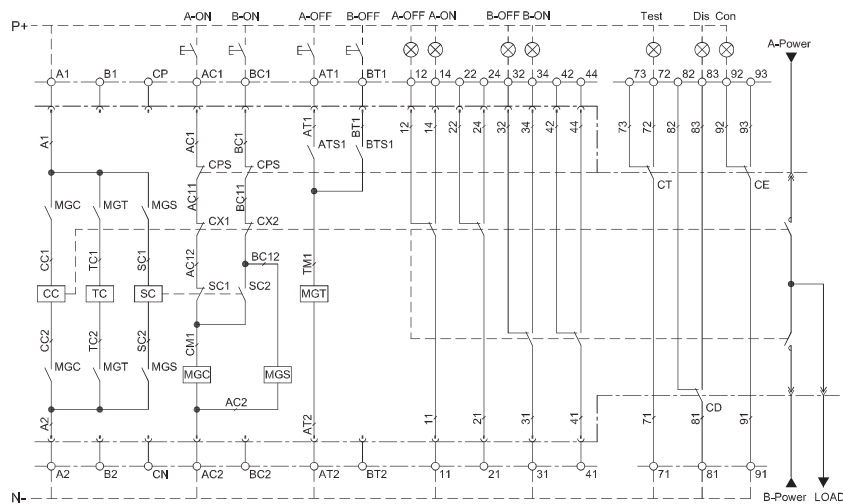

A1, A2	A-Power Terminal	MGC	Closing Magnetic Contactor
AC1, AC2	A-Power Closing Terminal	MGT	Tripping Magnetic Contactor
BC1, BC2	B-Power Closing Terminal	MGS	Selective Relay
AT1, AT2	A-Power Tripping Terminal	CPS	Closing Preventing Switch
BT1, BT2	B-Power Tripping Terminal	CX1, CX2	Closing Control Switch
CC	Closing Coil	ATS, BTS	Tripping Control Switch
TC	Tripping Coil	SC1, SC2	Selective Control Switch
SC	Selective Coil	CT	Contacts for Test Position (Option)
11 ~ 24	A-Power Indication Contacts	CD	Contacts of Disconnected Position (Option)
31 ~ 44	B-Power Indication Contacts	CE	Contacts for Connected Position (Option)


PCN Type

ATS(800~6300A)




Wiring Diagram (결선도)

Control Voltage AC

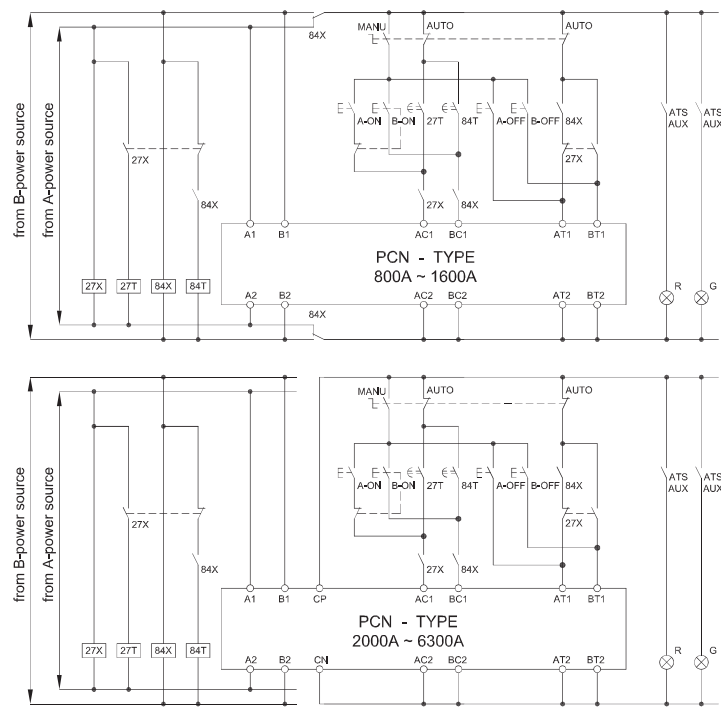

Control Voltage DC

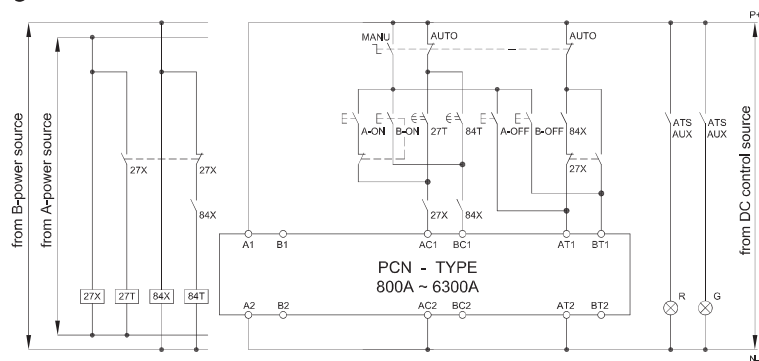

27X	Source-A Operating Relay	84X	Source-B Operating Relay
27T	A-Power Closing Dela Timer	84T	B-Power Closing Dela Timer
AC1, AC2	Automatic Operation	MANU	Manual Operation

Caution) More than 2.5mm² power cable used for 1600A ATS or less.
More than 4.0mm² power cable used for 2000A ATS or over.
More than 6.0mm² power cable used for 4000A ATS or over.

주의) ATS 1600A 이하 사용 시 전선의 굵기는 2.5mm² 이상 사용합니다.
ATS 2000A 이상 사용 시 전선의 굵기는 4.0mm² 이상 사용합니다.
ATS 4000A 이상 사용 시 전선의 굵기는 6.0mm² 이상 사용합니다.



ATS Controller

Automatic Transfer Switches 50151

ACD

◆ Information to Order_ 주문정보

ACD - ☐ - ☐
A B

A Type


- A : ATS A $\leftrightarrow$ B Transfer
- III-D : 2-Position or 3-Position Transfer + Sensing three phases of A-Power + Contact for Starting Generator + LCD Display + I/O
- M : 2-Position or 3-Position Transfer + Sensing three phases of A-Power + Contact for Starting Generator + RS485

B Wiring Cable 배선용

- 2 : 2M
- 3 : 3M
- - : None (무표시)

◆ Basic Function_ 기본기능

	Transfer Method 절체방법	Applicable ATS 적용 ATS	Functions 기능
ACD-A	2-Position Transfer	PC, PCN, PSO, T3, TO, TN	Basic Functions
ACD-III-D	2-Position or 3-Position Transfer		● Built-in Functions : LCD Display(KR/EN), Sensing Three Phases of A-Power, Generator Starting Contact, I/O, RS 485, Reserve Operation, Interlock Elevator, Event Recording * Control Power Required (DC 12~24 V) ● 내장 기능 : LCD 디스플레이(한글/영문), A측 3상 감지, 발전기동접점, I/O 포트, RS 485 통신, 예약운전, 엘리베이터 연동, 이벤트 기록 * 별도의 제어전원 필요 (DC 12~24 V)
ACD-M	2-Position or 3-Position Transfer	PC, PCN, PSO, T3, TO, TN, ATCB	● Built-in Functions : Sensing Three Phases of A-Power & B-Power, Generator Starting Button, Synchronized Transfer (within 30 degrees), RS 485, Phase Sequence Check ● 내장 기능 : A측/B측 3상 감지, 발전기 기동 버튼, 동기절체(30도 이내), RS 485 통신, 상회전 감지

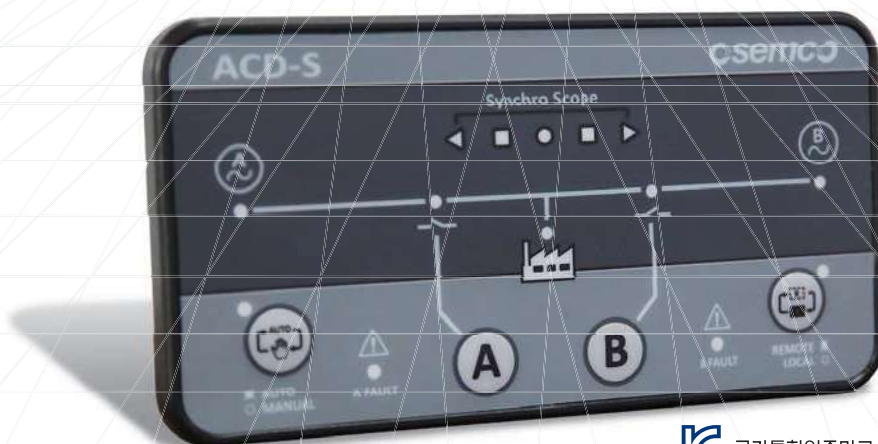



ATS Controller

ACD


◆ Comparative Summary_ 제품별 기능 및 적용

Classification (구분)			ACD-A	ACD-III-D	ACD-M
Function 기능	Basic Function 기본기능	Transition Method 절체 방법	A ⇌ B	A ⇌ B, A ⇌ OFF ⇌ B	A ⇌ B, A ⇌ OFF ⇌ B
		Synchronized Transfer 동기 절체	X	X	O
		Remote Control (Communication) 원격 제어 (통신)	X	O	O
		By-pass ATS Interface 바이패스 연동	X	O	O
		Automatic Control Fault Alarm 자동운전 고장경보	O	O	O
		Priority Selection 우선권 선택	O	O	O
		Voltage Setting 전압 설정	O (220V or 230V)	O (220V or 230V)	O (220V or 230V)
		Frequency Setting 주파수 설정 (50/60)	O	O	O
	Protection Function 보호기능	Over-voltage Sensing 과전압 감지	O	O	O
		Under-voltage Sensing 저전압 감지	O	O	O
		Low-frequency Sensing 저주파수 감지	O	O	O
		High-frequency Sensing 과주파수 감지	O	O	O
		Time Setting Range 시간 설정 범위	0~99sec	0~90min	0~99sec
		Sensing three phases 3상 감지	X	A-Power	A/B-Power
		Generator Starting Contact 발전기동 접점	X	O	O
		Phase Sequence Check 상하전 감지	X	X	O
Applicable Models 적용 제품	TN		△ (Optional)	O	O
	T3, T0		O	O	O
	PC / PSO		O	O	O
	PCN		△ (Optional)	O	O
	ATCB		X	O	O

※ ATS 조작전원이 DC인 경우, 당사와 협의 바랍니다.

※ If the ATS control power is DC voltage, please request us to make consultation.

◆ Outline Dimension_ 외형도

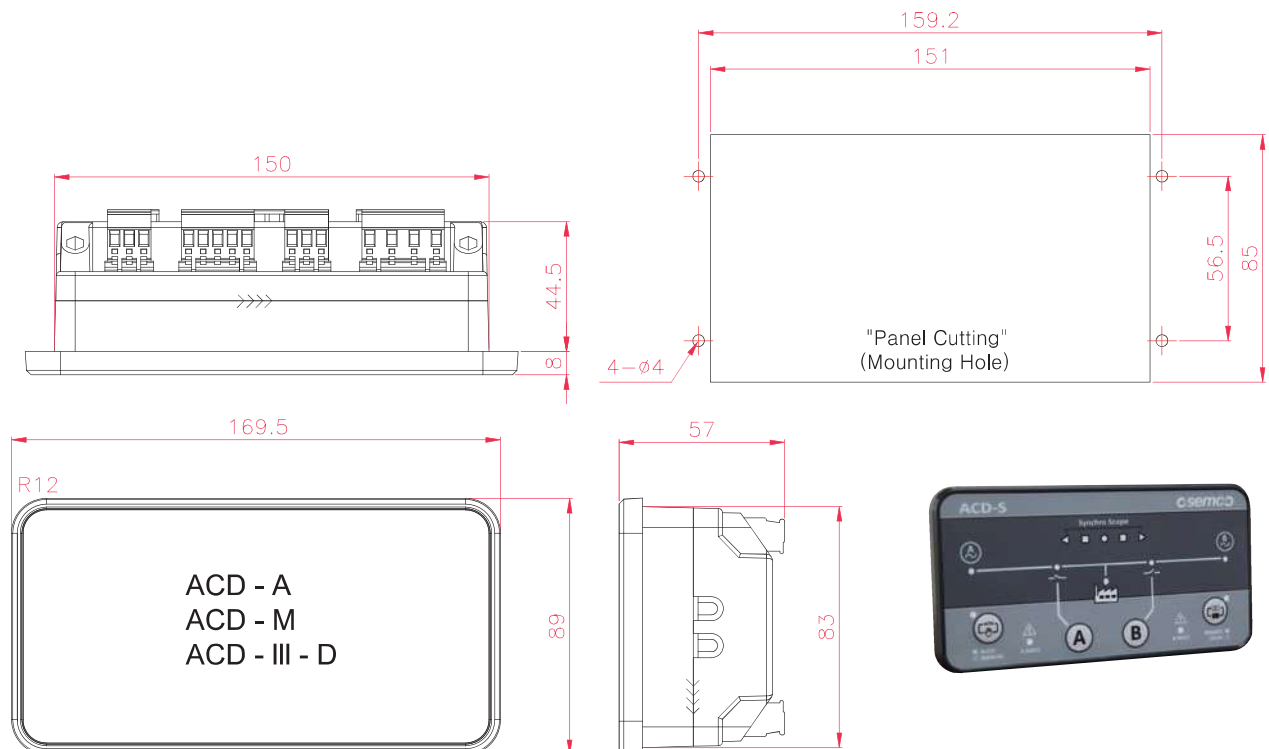




ACD-A

◆ External View_ 외관명칭


[모델명 : ACD-A]

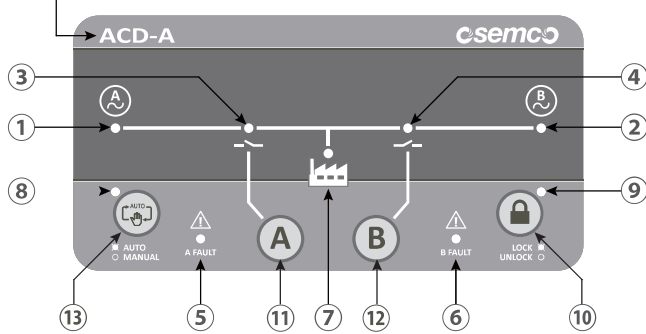

① A-POWER Lamp	⑨ Lock/Unlock Status Lamp
② B-POWER Lamp	⑩ Lock/Unlock Selection Button
③ ATS A-Closing Status Lamp	⑪ ATS A-Closing Button
④ ATS B-Closing Status Lamp	⑫ ATS B-Closing Button
⑤ ATS A-Fault Lamp	⑬ Auto/Manual Selection Button
⑥ ATS B-Fault Lamp	
⑦ LOAD-POWER Lamp	
⑧ Auto/Manual Status Lamp	

Wiring Diagram (결선도)

OSS - TN Type (AC 220V)
3Ø4W 380/220V

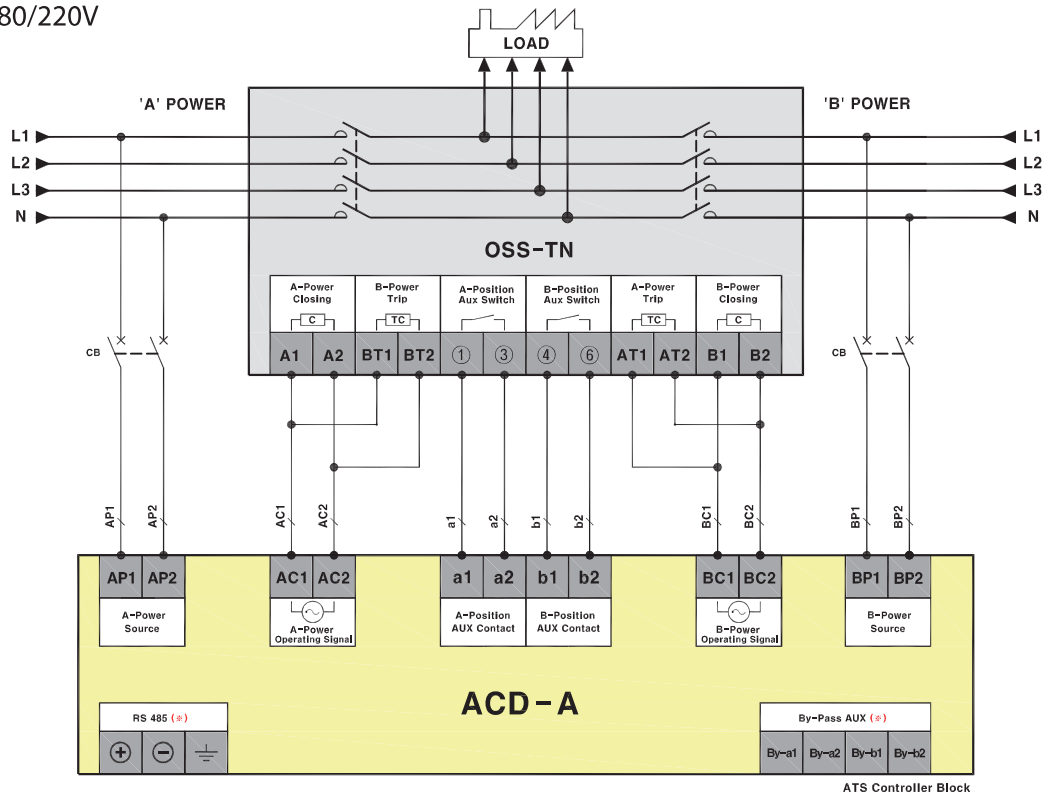


※ RS485통신 및 By-Pass AUX 단자는 옵션사양입니다.

※ RS 485 and By-Pass AUX Terminals on the ACD-A is optional.

ACD-A




OSS-T3 / TO Type (AC 220V)
3Ø4W 380/220V

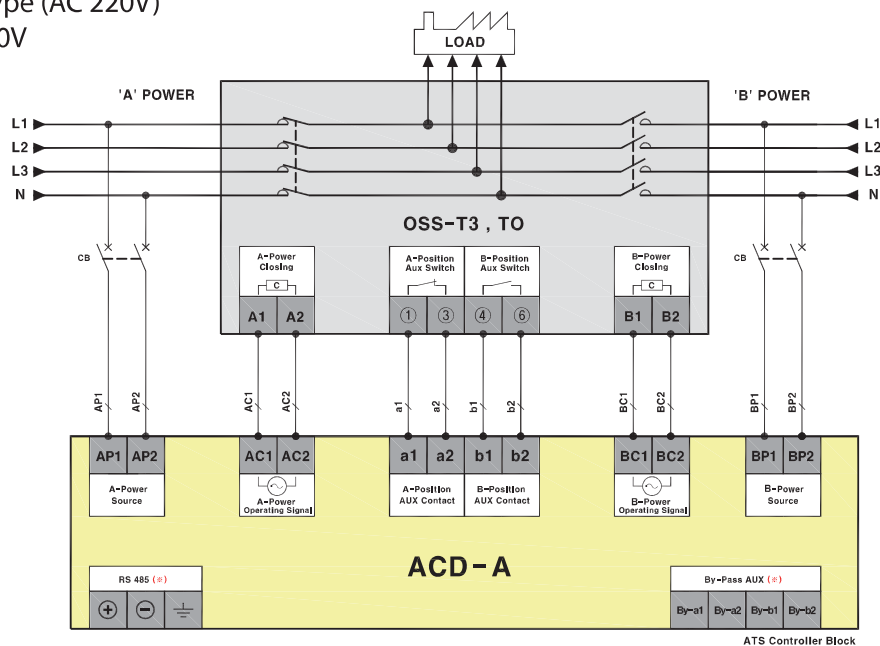

※ RS 485 and By-Pass AUX Terminals on the ACD-A is optional.

OSS - PC, PSO Type (AC 220V)
3Ø4W 380/220V

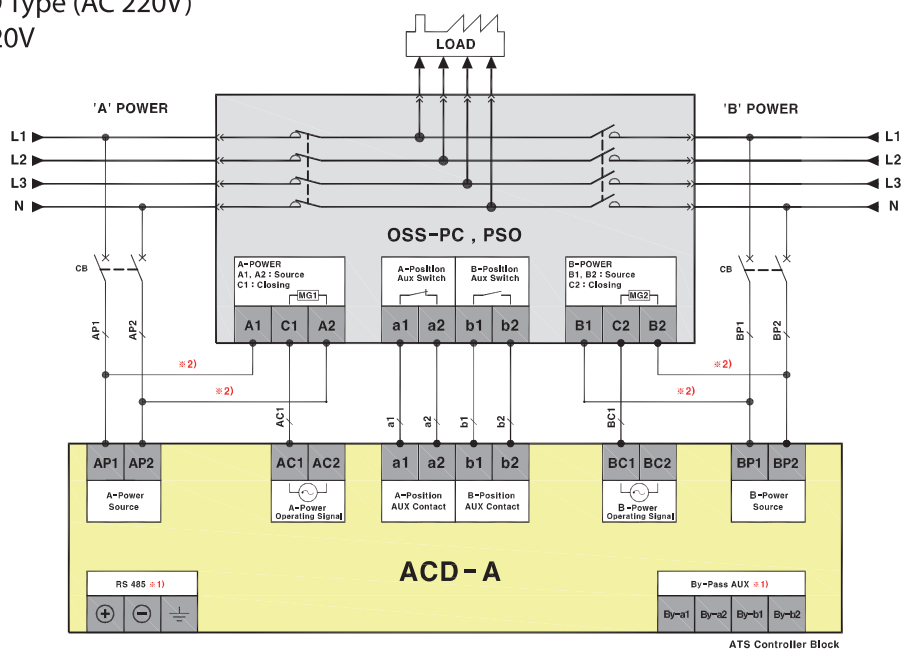

※ 2) More than 2.5mm² power cable used for 1,600A ATS or less.
More than 4.0mm² power cable used for 2,000A ATS or over.
More than 6.0mm² power cable used for 4,000A ATS or over.



◆ External View_ 외관명칭



표시램프	
①	Normal Power (Green)
②	Generator Power (Green)
③	Normal On (Red)
④	Generator On (Red)
⑤	Test (White)

◆ Control Button_ 조작버튼

Button Shape 버튼 모양	Button Name 버튼 이름	Function of Button 버튼 동작 설명
	ATS "A"(Normal) Manual Control Button ATS "A"(상용)측 수동제어 버튼	Manual input or manual open ATS to "A"(Normal) on manual condition (Operate after pressing about 0.5 seconds) * ON(input) function can be used according to ATS model or Operation set-up. 수동모드에서 ATS를 "A"(상용)측으로 수동 투입 또는 수동 오픈 시킴 (약 0.5초간 누를 경우 동작) * ATS 모델 및 조작 설정에 따라 ON(투입) 기능만 사용 될 수 있습니다.
	ATS "B"(Generating) Manual Control Button ATS "B"(발전)측 수동제어 버튼	Manual input or manual open ATS to "B"(Generating) on manual condition (Operate after pressing about 0.5 seconds) * ON(input) function can be used according to ATS model or Operation set-up. 수동모드에서ATS를 "B"(발전)측으로 수동 투입 또는 수동 오픈 시킴 (약 0.5초간 누를 경우 동작) * ATS 모델 및 조작 설정에 따라 ON(투입) 기능만 사용 될 수 있습니다
	Test 테스트	Use or cancel the automatic test to "B"(Generating) on automatic mode (Operate after pressing about 0.5 seconds) 자동모드에서 "B"(발전)측으로 자동 테스트 사용 또는 해지 (약 0.5초간 누를 경우 동작)
	Override 즉시실행	Use it when you ignore the set-up time to operate immediately on automatic mode. 자동모드에서 지연 대기 중인 설정 시간을 무시하고 즉시 진행할 경우 사용.

◆ Set-up Button_ 설정버튼

Button Shape 버튼 모양	Button Name 버튼 이름	Function of Button 버튼 동작 설명
	Setup / Enter 설정 / 저장	Change main screen to set-up screen (Press about 1 seconds) / Change set-up screen to main screen or enter changed value * Automatic operation and ATS control function can be stopped when you set up. 메인 화면에서 설정 화면으로 전환 (1초 이상 누름 유지) / 설정 화면에서 메인 화면으로 전환 또는 변경값 저장 * 설정 중 자동운전 및 ATS 조작기능은 정지됩니다.
	UP 증가	Change the screen from main screen / Shift or increase the set-up value from the set-up screen 메인 화면에서 화면 전환 (상용전원 3상 사용시 전압 상태 표시 전환기능) 설정 화면에서 이동 및 설정값 증가
	DOWN 감소	Change the screen from main screen / Shift or decrease the set-up value from the set-up screen 메인 화면에서 화면 전환 (상용전원 3상 사용시 전압 상태 표시 전환기능) 설정 화면에서 이동 및 설정값 감소
	MOVE 이동	Move to detailed set-up from the set-up screen / Move to set-up value from set-up screen 설정 화면에서 해당 메뉴 세부 설정 진입 / 설정중인 화면에서 설정중인 값의 자릿수 이동

ATS Controller


ACD-III-D



Wiring Diagram (결선도)

OSS-T3, TO Type(AC220V)

3Ø4W 380/220V

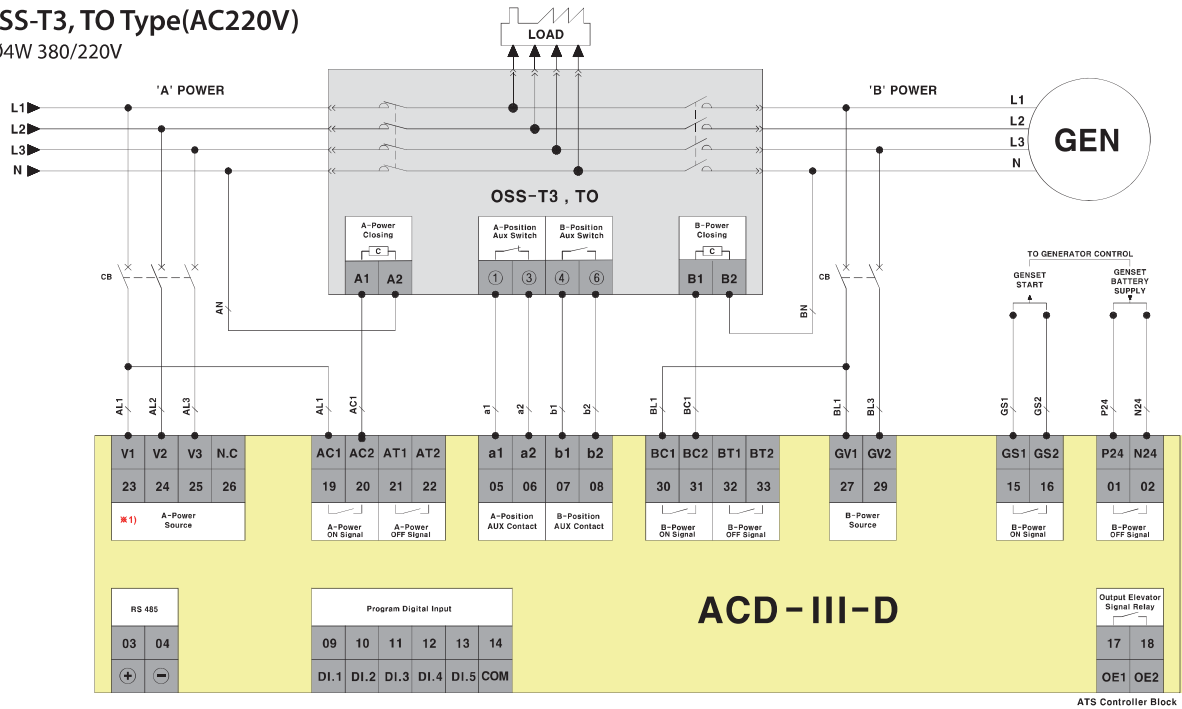


※1) A-Power Source 입력이 단상인 경우 V1, V3 단자에 전원을 입력 합니다.

※1) If the A-Power Source input is single phase, connect power to the V1, V3 terminals.

OSS-PC, PSO Type(AC220V)

3Ø4W 380/220V

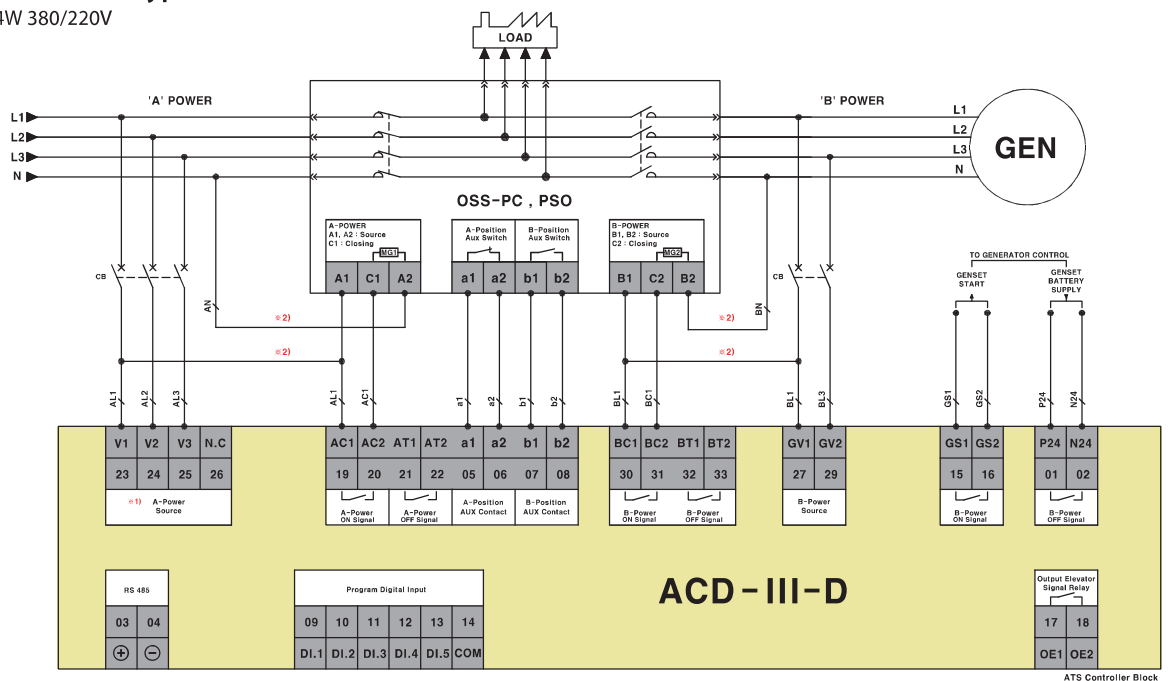

※1) A-Power Source 입력이 단상인 경우 V1, V3 단자에 전원을 입력 합니다.

※2) ATS 1,600A 이하 사용시 전선의 굵기는 2.5㎟ 이상 사용 합니다.
ATS 2,000A 이상 사용시 전선의 굵기는 4.0㎟ 이상 사용 합니다.
ATS 4,000A 이상 사용시 전선의 굵기는 6.0㎟ 이상 사용 합니다.

※1) If the A-Power Source input is single phase, connect power to the V1, V3 terminals.


※2) More than 2.5㎟ power cable used for 1,600A ATS or less.
More than 4.0㎟ power cable used for 2,000A ATS or over.
More than 6.0㎟ power cable used for 4,000A ATS or over.



ACD-III-D

Wiring Diagram (결선도)

OSS-TN Type(AC220V) 3Ø4W 380/220V

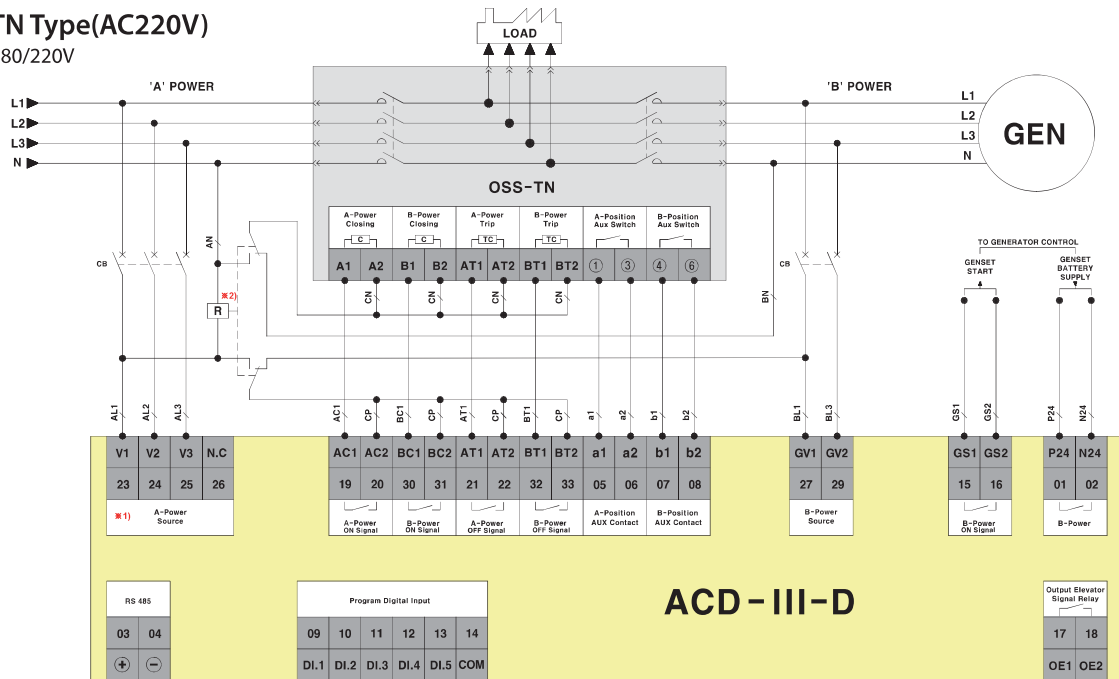

※1) A-Power Source 입력이 단상인 경우 V1, V3 단자에 전원을 입력 합니다.
※2) 배전시 AC220V 릴레이가 추가 됩니다.
릴레이 또는 마그네틱 접점은 AC220V 10A 이상 사용하셔야 합니다.

※1) If the A-Power Source input is single phase, connect power to the V1, V3 terminals.
※2) Relay, 220vac is required when you make wiring for 1N type.
Relay or Magnet Contacts have to be used more than AC220V 10A.



ATS Controller


ACD-III-D



Wiring Diagram (결선도)

OSS-PCN(800A~1600A) Type(AC220V)

3Ø4W 380/220V

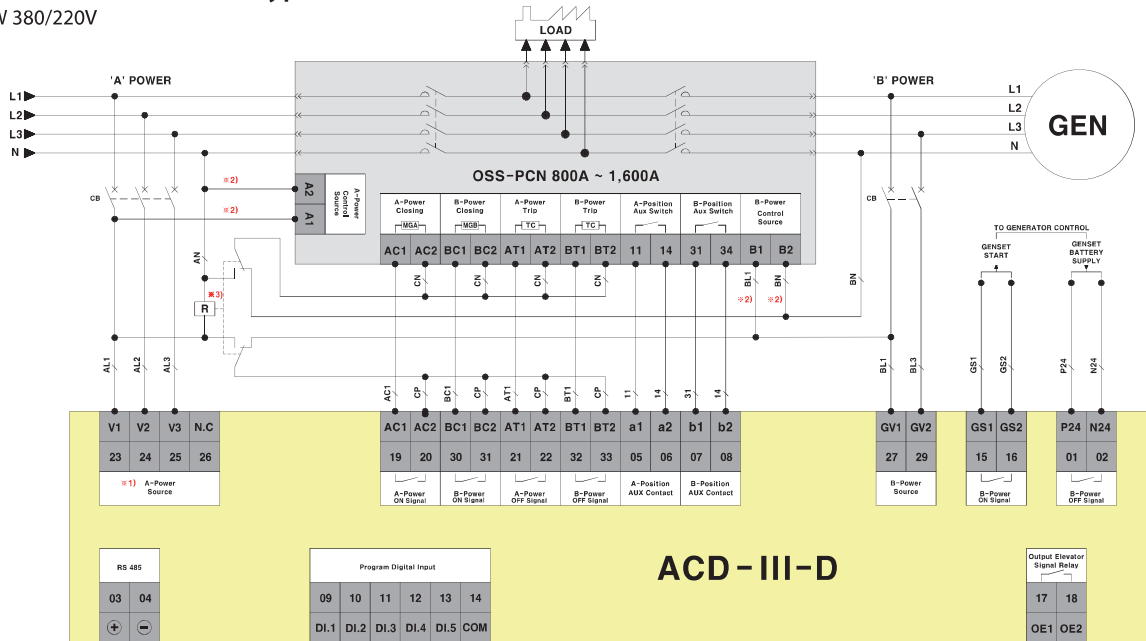


- ※1) A-Power Source 입력이 단상인 경우 V1, V3 단자에 전원을 입력 합니다.
- ※2) 전선의 굵기는 2.5mm² 이상 사용합니다.
- ※3) 배선시 AC220V 전압이게 주의 합니다.

- ※1) If the A-Power Source input is single phase, connect power to the V1, V3 terminals.
- ※2) More than 2.5mm² power cable used.
- ※3) Relay, 220vac is required when you make wiring for PCN type.

OSS-PCN(2000A~6300A) Type(AC220V)

3Ø4W 380/220V

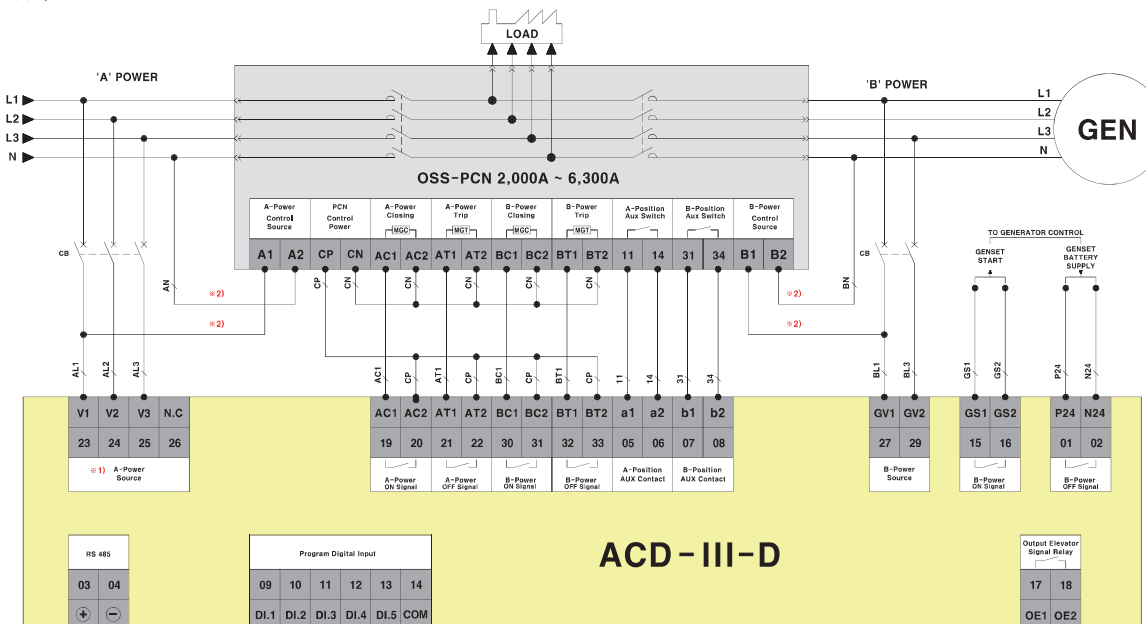


- ※1) A-Power Source 입력이 단상인 경우 V1, V3 단자에 전원을 입력 합니다.
- ※2) 2000A 이상의 전선 굵기는 4.0mm²를 사용합니다.
- ※3) 4000A 이상의 전선 굵기는 6.0mm²를 사용합니다.

- ※1) If the A-Power Source input is single phase, connect power to the V1, V3 terminals.
- ※2) More than 4.0mm² power cable used for 2,000A ATS or over.
- ※3) More than 6.0mm² power cable used for 4,000A ATS or over.



ACD-M

◆ External View_ 외관명칭

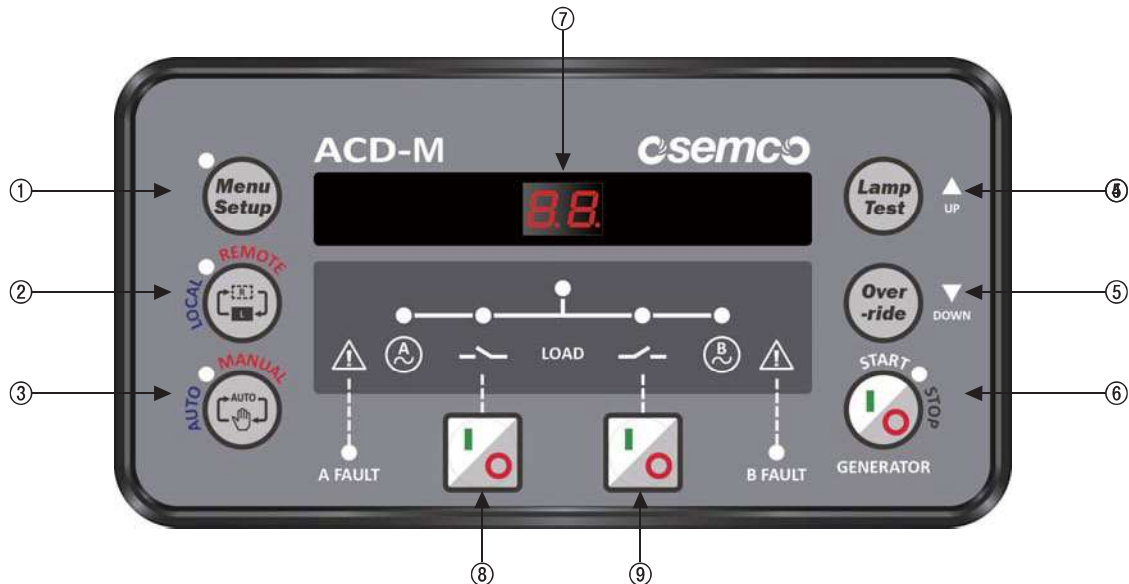

① Menu Setup Button	④ LAMP TEST/UP Button	⑦ FND Display
② LOCAL/REMOTE Selection Button	⑤ OVERRIDE/DOWN Button	⑧ ATS A-Power ON/OFF Button
③ AUTO/MANUAL Selection Button	⑥ GENERATOR START/STOP Button	⑨ ATS B-Power ON/OFF Button

◆ Specification_ 정격사양

Size (크기)	[mm]	(W)169.5 × (H)89.0 × (D)57.0
Weight (중량)	[kg]	1.0
Operating Temperature (온도)	[°C]	-20 ~ 70
LED Display (LED 디스플레이)		2-DIGIT FND, High-Brightness LED
Input Voltage (입력 전압)	L-N [V]	110 ~ 270
Input Frequency (입력 주파수)	[Hz]	50 ~ 60
Contact Capacity (접점용량)	ATS Control	250 VAC / 16 A
	Generator Start	250 VAC / 5A
Communication Port (통신 포트)		RS485 (9600 bps ~ 38400 bps)
Certification (인증)		KC (EMC)
		EMC, KC

◆ Basic Function_ 기본 기능

- Manual / Automatic Control 수동 및 자동 제어
- Local / Remote 로컬 및 원격 제어
- Transfer Method 절체방법
2-Position or 3-Position (A ⇄ B or A ⇄ OFF ⇄ B)
- Priority Selection 우선권 선택
A-Power Priority, B-Power Priority, No Priority
- Voltage Setting 전압 설정
220 Vac, 230 Vac, 240 Vac

◆ Protection Function_ 보호 기능

- Over-voltage Sensing 과전압 감지
- Under-voltage Sensing 저전압 감지
- Low-frequency Sensing 저주파수 감지
- High-frequency Sensing 고주파수 감지
- Open Phase Protection 결상 보호
- Phase Sequence Check 상회전 감시


ATS Controller

ACD-M



Wiring Diagram (결선도)

OSS-T3, TO Type(AC220V) 3Ø4W 380/220V

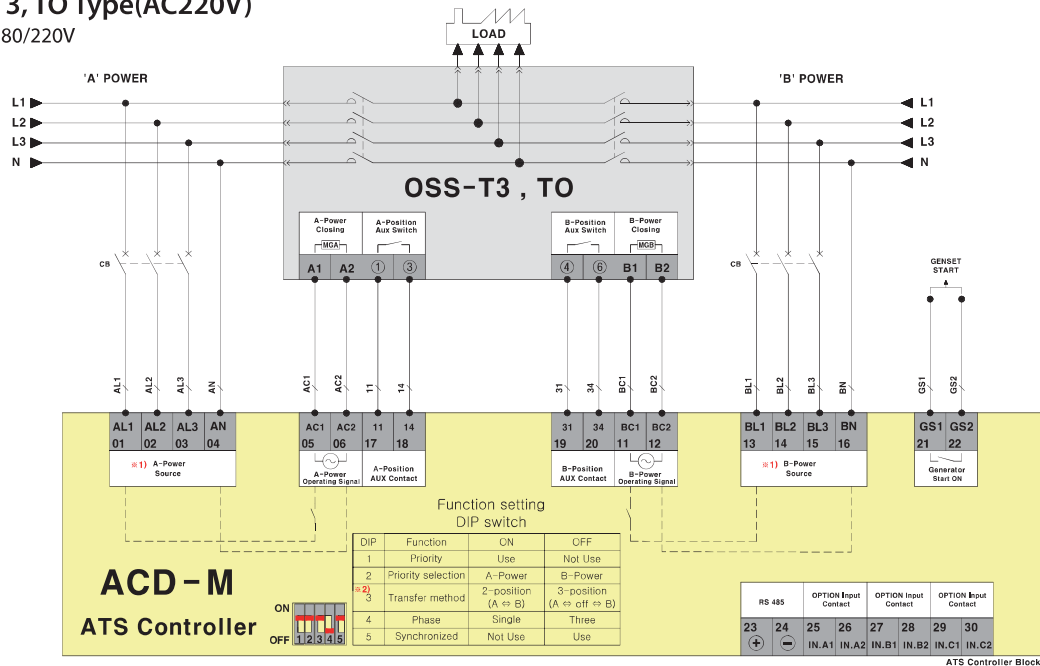


ACD-M
ATS Controller

※1) A/B-Power Source 입력이 단상인 경우 AL1, AN 과 BL1, BN 단자에 전원을 입력 합니다.
※2) 3번 DIP 스위치는 ON하여 주십시오.

※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) Turn ON the No. 3 DIP switch.

OSS-PC, PSO Type(AC220V) 3Ø4W 380/220V

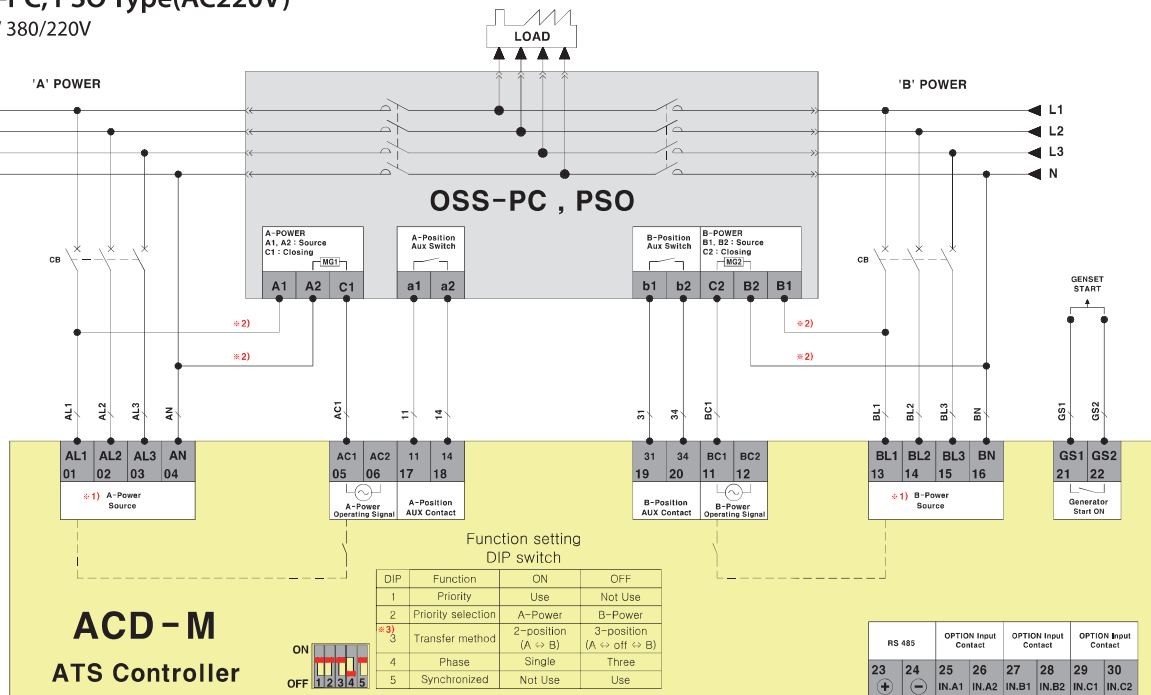

ACD-M
ATS Controller

※1) A/B-Power Source 입력이 단상인 경우 AL1, AN 과 BL1, BN 단자에 전원을 입력 합니다.
※2) ATS 1,600A 이하 사용시 전선의 굵기는 2.5㎟ 이상 사용 합니다.
ATS 2,000A 이상 사용시 전선의 굵기는 4.0㎟ 이상 사용 합니다.
ATS 4,000A 이상 사용시 전선의 굵기는 6.0㎟ 이상 사용 합니다.
※3) 3번 DIP 스위치는 ON하여 주십시오.


※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) More than 2.5㎟ power cable used for 1,600A ATS or less.
More than 4.0㎟ power cable used for 2,000A ATS or over.
More than 6.0㎟ power cable used for 4,000A ATS or over.
※3) Turn ON the No. 3 DIP switch.



ACD-M


Wiring Diagram (결선도)

OSS-TN Type(AC220V)
3-Position (A ↔ OFF ↔ B)
3Ø4W 380/220V

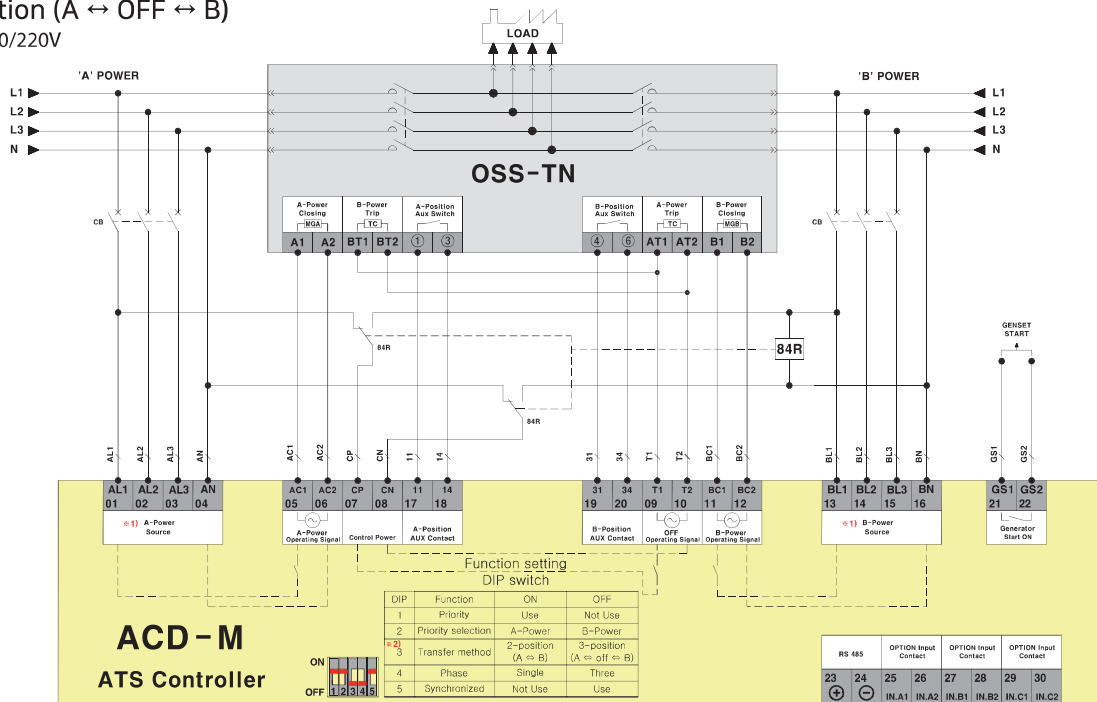

※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) Turn OFF the No. 3 DIP switch.

OSS-TN Type(AC220V)
2-Position (A ↔ B)
3Ø4W 380/220V

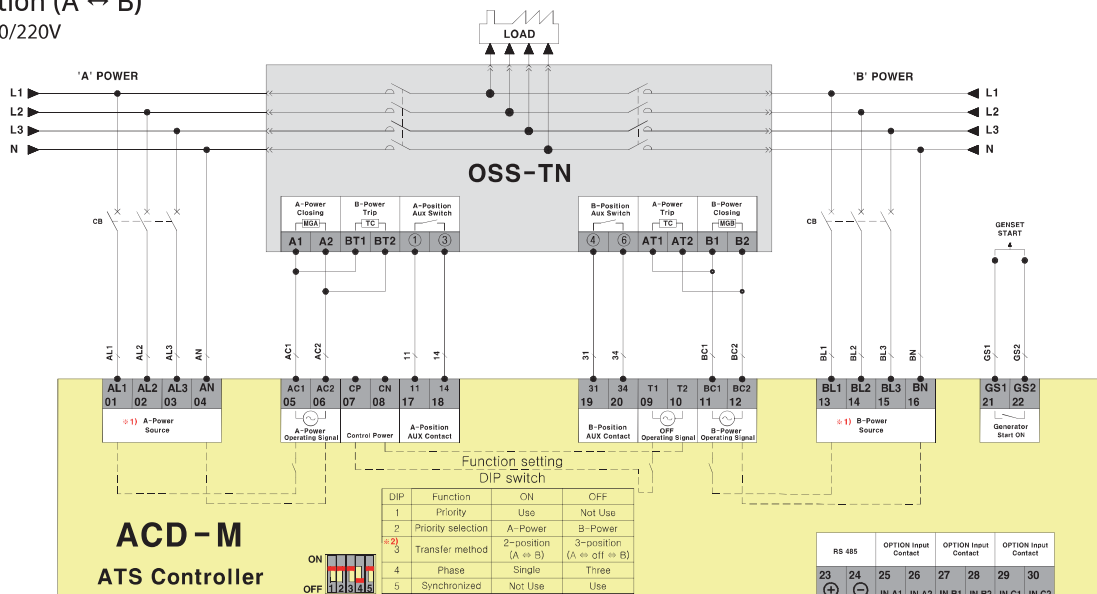

※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) Turn ON the No. 3 DIP switch.


ATS Controller

ACD-M



Wiring Diagram (결선도)


OSS-PCN(800A~1600A) Type(AC220V) 3Ø4W 380/220V

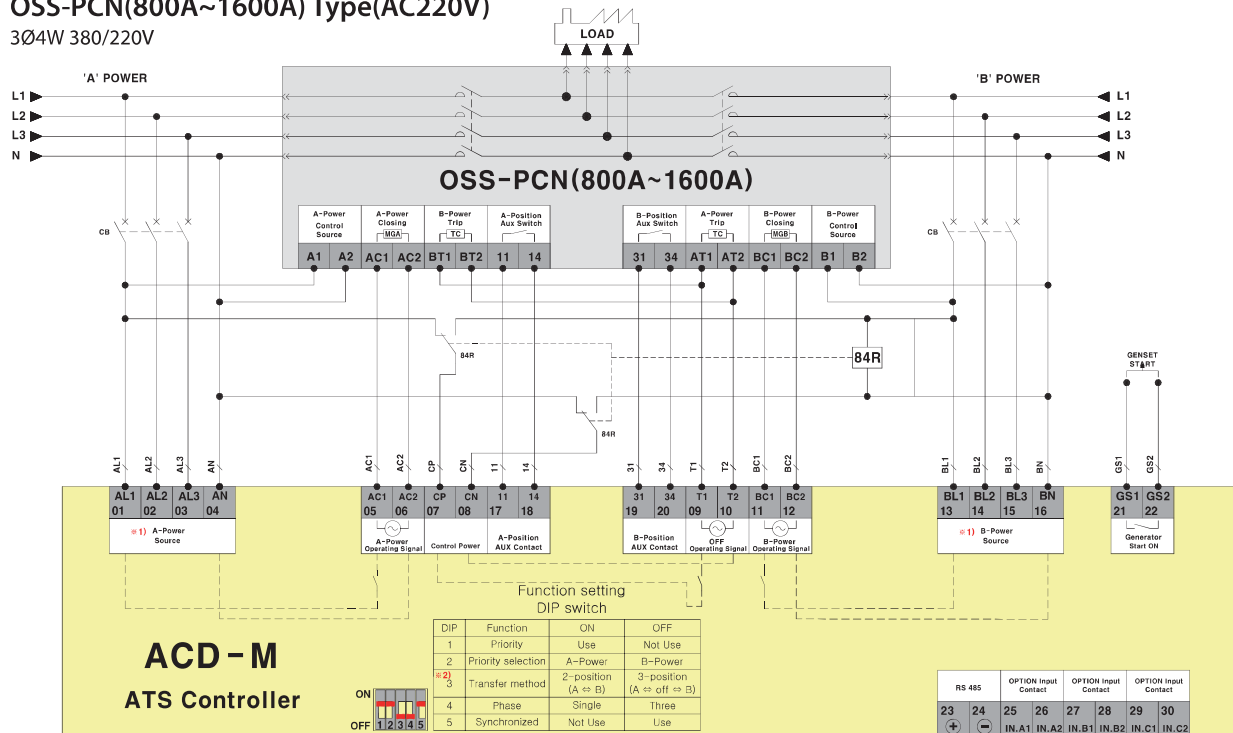

※1) A/B-Power Source 입력에 단상인 경우 AL1, AN 과 BL1, BN 단자에 전원을 입력 합니다.
※2) 3번 DIP 스위치는 OFF하여 주십시오.

※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) Turn OFF the No. 3 DIP switch.

OSS-PCN(2000A~6300A) Type(AC220V) 3Ø4W 380/220V

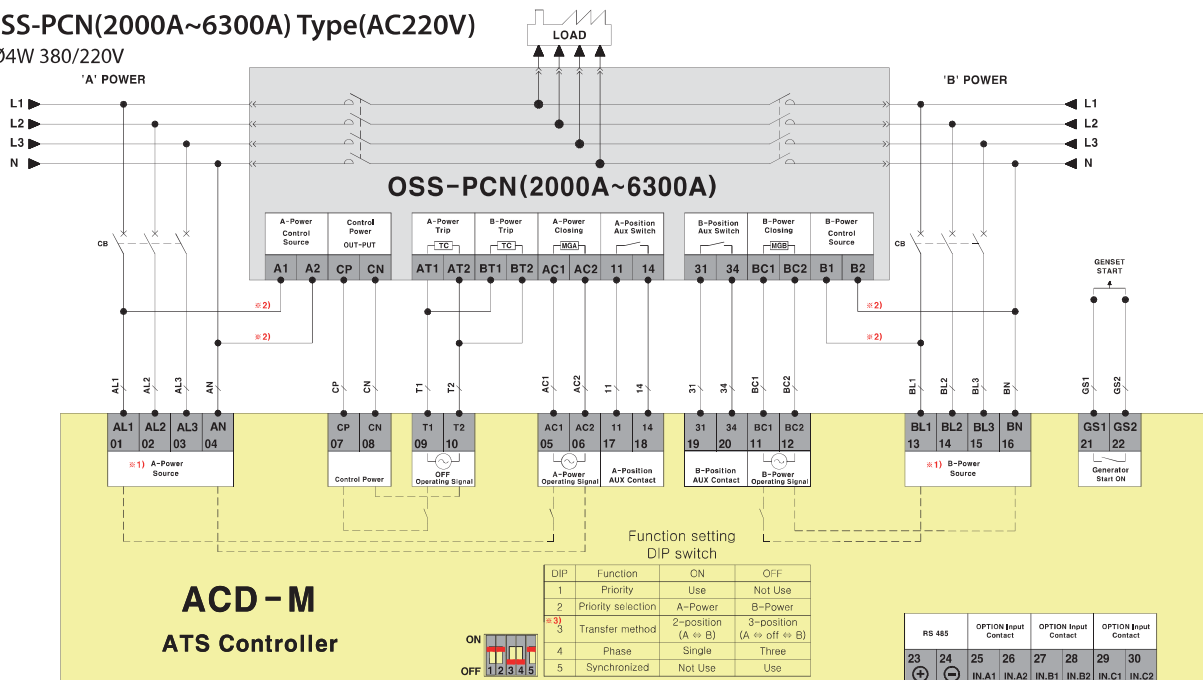

※1) A/B-Power Source 입력에 단상인 경우 AL1, AN과 BL1, BN 단자에 전원을 입력 합니다.
※2) ATS 2,000A 이상 사용시 전선의 굵기는 4.0mm² 이상 사용 합니다.
ATS 4,000A 이상 사용시 전선의 굵기는 6.0mm² 이상 사용 합니다.
※3) 3번 DIP 스위치는 OFF 하여 주십시오.

※1) If the A/B-Power Source input is single phase, connect power to the AL1, AN & BL1, BN terminals.
※2) More than 4.0mm² power cable used for 2,000A ATS or over.
More than 6.0mm² power cable used for 4,000A ATS or over.
※3) Turn OFF the No. 3 DIP switch.



ACD-M

MEMO

This image shows a full page of blank graph paper. The grid consists of thin, light gray horizontal and vertical lines that intersect to form small squares across the entire surface. There are no margins, text, or other markings on the paper.

Technical Details




I ATS Selection Considerations_ ATS 선정 시 고려사항

▶ ATS with synchronous transfer function_동기절체 기능을 갖는 ATS (ATS + Control Device)

When rotating equipment (such as fans or compressors) is present on the load side, it is very effective to convert back to commercial power on the utility side.

For example, when an electric motor load is connected to the generator side and is switched to commercial power, the electric motor is switched to commercial power while retaining the electrical characteristics (voltage, frequency, etc.) of the generator.

If a 180-degree phase difference occurs between the generator and the commercial power source, excessive current of more than the rated current may occur. To prevent this, synchronous switching (within a phase angle of 30 degrees) considering the phase angle between the generator and commercial power source can be performed to prevent accidents caused by a large phase difference. (CONTROLLER : ACD-M)

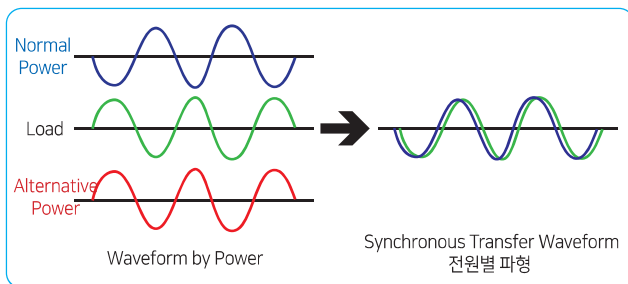


Synchronous transfer when the phase angles of the commercial power and the power supplied to the load match when the standby power is being supplied to the load

부하 측에 회전기(Fan, Compressor)가 존재할 때, 상용 측으로 재 전환 시 매우 유효합니다.

예를 들면, 전동기 부하가 발전기 측에 연결된 상태에서 상용전원으로 복전 시 전동기는 발전기의 전기특성(전압, 주파수 등)을 그대로 지닌 채 상용전원으로 절체됩니다.

이때, 만약 발전기와 상용전원의 위상간에 정반대 180도 위상차가 생기면 정격전류 이상의 과도한 전류가 발생합니다. 이를 방지하기 위하여 발전기와 상용전원 간의 위상각을 고려한 동기절체(위상각 30도 이내)를 하여 큰 위상각 차이로 인한 사고를 방지할 수 있습니다.

(CONTROLLER : ACD-M)

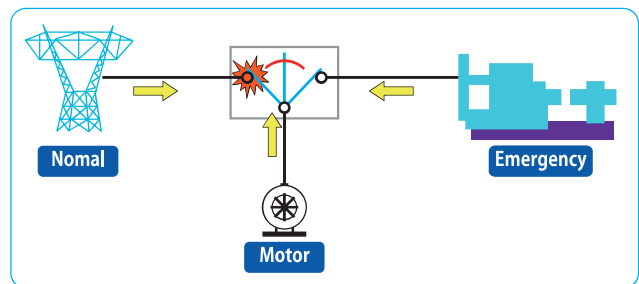


예비전원이 부하에 공급중일 때 상용전원과 부하에 공급되는 전원의 위상각이 일치할 때 동기절체

▶ 3-Position ATS_중간정지형 ATS (OSS-TN, PCN, ATCB)

In the case of inductive loads such as electric motors, they will continue to rotate due to inertia even when the commercial power is interrupted.

At this time, the electric motor operates as a generator, and back electromotive force (BEMF) is induced on the line side. To prevent the back electromotive force from flowing into the line side, an ATS is positioned at the neutral position and switched to the backup power supply after the motor has completely stopped, providing a stable power supply to the electric motor.


(CONTROLLER : ACD-M, ACD-III-D)

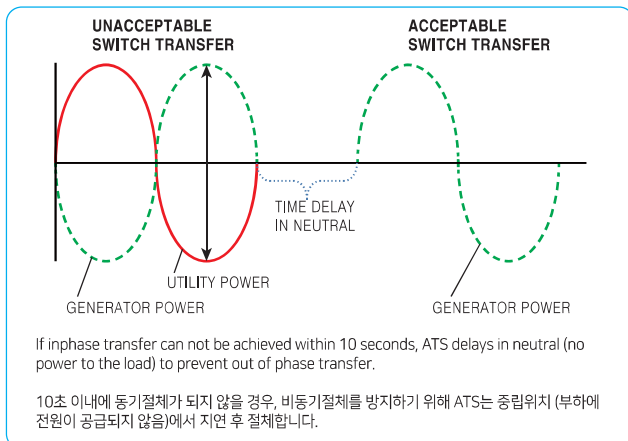

전동기와 같은 유도성 부하의 경우, 상용전원이 정전되었을 경우에도 관성에 의해 회전을 하게 됩니다.

이때, 전동기는 발전기로 동작하게 되며 모선 측으로 역기전력(BEMF)이 유입되므로 ATS를 중립위치에 위치하여 모선 측으로 역기전력이 유입되는 것을 방지하고 전동기가 완전히 멈춘 후 예비전원으로 절체하여 전동기에 안정적인 전원을 공급합니다.

(CONTROLLER : ACD-M, ACD-III-D)

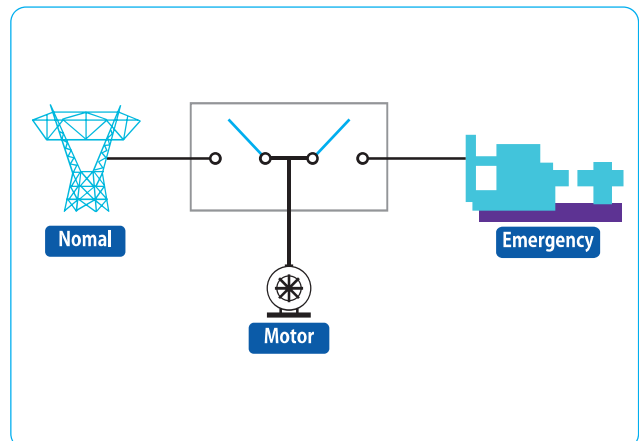



I ATS Selection Considerations_ ATS 선정 시 고려사항

▶ Standard Operating Conditions (표준사용환경)

Ambient Temperature: -5° C~+40° C (but, the average temperature for 24 hours shall be lower than +35° C)

Altitude: Below 2000m

Environmental conditions

Relative humidity shall be less than 85% at max. temp. +40°C, less than 90% at 20°C

It shall not be allowed to use or store within the area of petrochemicals, ammonia, and corrosive gas.

Storage Temp.: -20°C~+60°C (but, the average temperature for 24 hours shall be lower than +35°C)

주위온도 : -5°C ~ +40°C (단, 24시간 평균온도가 +35°C 이하)

표고 2000m 이하

환경조건

최대온도 +40°C에서 상대습도 85% 이하, 20°C에서는 90% 이하

유화, 암모니아 및 부식성가스 범위에서는 I 용 또는 보관 불가 H₂S ≤ 0.01ppm, SO₂ ≤ 0.01ppm, NH₃ ≤ a few ppm)

보관온도 : -2°C ~ +60°C (단, 24시간 평균온도가 +35°C 이하)

▶ Applicable current by the temperature (온도별 사용전류)

Under the environment with over than 40° C, please note the rating current as follow

기준 주위온도인 40°C를 넘는 환경에서 사용하는 경우는 아래 표와 같이 정격전류를 보정하여 사용하여 주시기 바랍니다.

Unit / 단위: Ampere

Ambient temperature \ Rated current	630A	800A	1000A	1250A	1600A	2000A	2500A	3150A	4000A	5000A
40°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
45°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
50°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
55°C	630	800	1,000	1,250	1,550	2,000	2,450	3,000	3,900	4,850
60°C	630	800	1,000	1,200	1,500	2,000	2,350	2,900	3,750	4,700
60°C ~ 100°C	315	400	500	630	700	1,000	1,200	1,300	2,000	2,500

Note) IEC 60947-1 Standard is applied to the data for 40°C. 주) 주위온도 40°C의 Data는 IEC 60947-1의 규격을 적용하였습니다.

▶ Main Circuit Terminal Connection Tightening Torques (주회로 단자 접속 체결 토르그)

Unit / 단위 : kgf.cm

	M5	M6	M8	M10	M12
Torque	28 ~ 37	48 ~ 65	85 ~ 130	400 ~ 500	400 ~ 500

▶ Selection of TR Capacity

TR capacity should be selected more than the value calculated by the following formula.

Operation Voltage x Operation Current x 0.5 = ()VA

e.g.) Operation Voltage AC 220V, Operation Current 4A
220 x 4 x 0.5 = 440VA, TR capacity of more than 440 VA is recommended.

▶ Selection of Control Relay

The capacity of UVR, Operating Relay and Timer contactor should be higher than ATS operating current.

Note: If the control power source is not stable, it is recommended to use Automatic Voltage Regulator.

▶ 조작용 TR용량 선정

조작회로용 TR 용량은 하기 계산식에 의한 계산치 이상의 용량을 사용하여 주십시오.

조작전압 x 조작전류 x 0.5 = ()VA

예) 조작전압 AC220V 조작전류 4A 220 x 4 x 0.5 = 440VA
440VA 이상의 TR을 사용하여 주십시오.

▶ 제어 Relay의 선정

전압 Relay 27, 84 및 Timer는 접점 통전 전류가 ATS 조작전류 이상의 것을 사용하여 주십시오. 제어 Relay의 Chattering등을 고려하여 조작 전류의 차단이 가능한 Relay를 선정하여 사용하십시오. 보다 안전합니다.

주) 조작전원이 불안정한 경우에는 전압 확립 Relay를 사용하여 주십시오.

Safety Manual | 안전 지침서

▶ Safety Notice

This safety manual describes major informations for safe operation. Before handling this machinery, please be acquainted thoroughly with this manual, product handling, safety information and all other precautions before installation or maintenance.

이 지침서는 취급시 안전을 위한 주요한 내용을 기술하였습니다.

기기 취급에 앞서 취급설명서와 안전지침서를 숙지하시어 올바르게 사용하여 주십시오.

기기의 지식, 안전의 정보 그리고 주의사항의 모든 것을 습득한 뒤 사용하십시오.



Danger 위험

Emergency situation, which may cause death or serious disaster if there is mistake.

취급을 잘못했을 경우 사망 또는 중대한 재해가 발생할 수 있는 급박한 상황



Caution 주의

A potentially problematic situation, which may cause slight personal injury and/or damage.

취급을 잘못했을 경우 사망 또는 중대한 재해가 발생할 수 있는 급박한 상황

These safety notices are divided as "Danger" and "Caution" according to the hazard level.

이 주의서에는 안전주의 사항의 Level을 위험정도에 따라 [위험], [주의]로 구분하고 있습니다.



Caution 주의

Do not enter the area under the Automatic Transfer Switches (ATS) when it is lifted or suspended using a lifter or chain block. The ATS may suddenly drop. The ATS is heavy. Entering such an area may cause serious injury.

Lifter로 들어올리거나 Hoist 등으로 고정하여 들어올릴 때는 ATS의 아래에는 절대 들어가지 마십시오. ATS는 제품의 중량에 따라 낙하시 위험을 초래할 수 있습니다.



Caution 주의

Installation should be performed by qualified persons.

Prior to commencing any installation, open the upstream circuit breaker to isolate all power/voltage sources.

Otherwise, electric shock may occur.

Tighten terminal screws securely according to the specified torque.

Otherwise, a fire may occur.

Fix the Drawout type ATS firmly on a flat level using mounting screws.

Otherwise, drawout operation may cause the ATS to fall.

Avoid blocking of ATS's arc gas vents to ensure the adequate arc space.

Blocking of the arc gas vents could result in failure of ATS.

Do not place the ATS in such area of high temperature, high humidity, dusty air, corrosive gas, strong vibration and shock or other unusual conditions.

Installation in such areas could cause a fire or malfunction.

Be careful to prevent foreign material of debris, concrete powder, iron powder, etc and rainwater from entering into the ATS.

These materials inside the ATS could cause a fire or malfunction.

For 4 pole ATS, connect the neutral wire of 3-phase, 4-wire cable to N-phase (on the right side).

설치는 유자격자 (전기공사기사, 전기공사기능사)가 행하십시오.

설치에 앞서 모든 전원을 차단하기 위해 앞단의 차단기나 또는 그러한 종류의 제품을 반드시 Open 시키십시오.

감전의 위험이 있습니다.

단자 Bdt는 표준체결 Torque로 확실하게 체결하십시오. 화재의 위험이 있습니다.

수평하고 평평한 면에 단단하게 취부하여 고정시키십시오. 인출조작시 전도의 위험이 있습니다.

아크가스 배출구는 막히지 않도록 아크공간(절연거리)을 충분히 확보하십시오. 개폐성을 저하시킵니다.

고온, 다습, 분진, 부식성가스, 진동, 충격 등 좋지 못한 환경에 설치하지 마십시오.

화재 및 오동작이 발생할 수 있습니다.

먼지, 콘크리트가루, 철분 등의 이물질 및 빗물 등이 ATS내부에 들어가지 않도록 시공하십시오.

화재 및 오동작이 발생할 수 있습니다.

4극형의 경우 중성 선은 반드시 N 상극(우측)에 접속하십시오.

Operation Precautions

조작시의 주의사항



Danger 위험

Do not touch the live terminal parts.
Otherwise, electric shock may occur.
Do not leave the ATS in the drawout position.
The ATS is heavy. Dropping the ATS could cause serious injury.

통전되고 있는 주회로 및 제어회로 단자부에는 접촉하지 마십시오. 감전의 위험이 있습니다.
인출 위치상에 ATS를 방치하지 마십시오. ATS는 중량물이어서 낙하시 비상한 위험을 초래할 수 있습니다.
ATS 인출시에는 무 부하상태에서 조작하십시오.



Caution 주의

The cable size of control power should be selected considering operation current.
Otherwise, a fire could occur.
ATS should be operated by manual handle only under no-load condition. Operation by manual handle is strictly prohibited except emergency case.
Otherwise, damage to the ATS may occur.

조작전원의 전선의 굵기는 조작전류를 감안하여 선정하여 주십시오.
절체실패시 화재를 일으킬 수 있습니다.
ATS 수동 핸들에 의한 조작은 무부하 상태에서 조작하며, 비상시 외에는 사용을 금합니다.
조작미숙시 개폐특성을 보증할 수 없습니다.

Maintenance and Inspection Precautions

보수, 점검과 부품 교환시의 주의사항



Caution 주의

Maintenance, inspection or components replacement should be performed by qualified persons.
Prior to commencing any work, open the upstream circuit breaker to isolate all power/voltage sources. Otherwise, electric shock may occur.
Prior to commencing internal inspection for ATS, Be sure that main circuit and control source of ATS should be off.
Otherwise, fingers or tools could be pinched in the internal mechanism, causing injury
Retighten the terminal screws periodically according to the specified torque.
Otherwise, a fire may occur.
Retighten the arcing contact mounting screws periodically according to the specified torque.
Otherwise, a fire or malfunction may occur.
Be sure to reinstall the arc chute if removed.
Failure to do so or incorrect installation may result in a fire or cause of burns.
Do not touch the live parts or structural parts close to live parts immediately after stop of power supply to ATS.
Otherwise, remaining heat may cause burns.
Do not approach near the arc gas vent of arc chute while ATS is under transfer.
Otherwise, burns may result from high temperature of arc gas.

보수, 점검과 부품교환은 전문지식을 보유한 사람이 행하십시오.
작업은 상위차단기를 OFF 시키고 주회로, 제어회로 모두 충전되어 있지 않은 것을 확인한 뒤 행하십시오.
감전의 위험이 있습니다.
내부점검은 주회로 전원 및 조작전원을 차단 후 행하십시오.
손가락 및 공구가 기구부에 끼여 다칠 위험이 있습니다.
주회로 단자볼트는 정기적으로 표준 취부 Torque로써 증가시켜 취부하십시오.
풀림은 화재 발생의 원인이 될 수 있습니다.
아크 접점 Screw를 정기적으로 표준 취부 Torque로써 다시 취부하십시오.
화재나 오동작의 원인이 될 수 있습니다.
외부의 소호실은 반드시 취부하십시오.
잘못된 취부 또는 취부가 되지 않을시 화상 또는 화재의 원인이 됩니다.
통전정지 직후는 개폐기도전부, 특히 접점과 도전부에 근접된 구조물에 접촉하지 마십시오.
잔류 열에 의해 화상의 위험이 있습니다.
절체중 소호실 아크가스 배출구에 신체를 근접하지 마십시오.
전류차단시 고온가스가 배출되어 화상의 위험이 있습니다.



O-Sung Electric Machinery Co., Ltd.
오성기전주식회사

Head Office & Factory:

ADDR : 136, Hantaemal-gil, Wollong-myeon, Paju-si, Gyeonggi-do, KOREA
TEL : 82-31-944-3521
FAX : 82-31-944-3525
E-MAIL : os@osemco.com
WEBSITE : <http://www.osemco.com>

본사 / 공장

주소 : 경기도 파주시 월롱면 한태말길 136
전화 : (031) 944-3521
팩스 : (031) 944-3525
이메일 : os@osemco.com
홈페이지 : <http://www.osemco.com>

Catalog No. ATS-2402

※ Product specifications may change without notice for quality improvement purpose.

※ 본 제품의 사양은 제품의 품질향상 목적으로 예고없이 변경될 수 있습니다.